

December 1, 2016

Mr. Timothy Ames
Kenmore Tonawanda UFSD
1500 Colvin Boulevard
Buffalo, NY 14223

**Re: Lead in Water Sampling Report
Kenmore Tonawanda UFSD
Kenmore East High School**

Dear Mr. Ames:

At your request, Sienna Environmental Technologies conducted water sampling, screening for lead contaminants at the above referenced property in accordance with 1370-a and 1110, Subpart 67-4 of Title 10 (Health) of the Official Compilation of Codes, Rules and Regulations of the State of New York, and US EPA guidelines.

If you have any questions, or if we can be of assistance in any other way, please do not hesitate to call. Thank you for the opportunity to be of service to Kenmore Tonawanda UFSD.

Sincerely,
Sienna Environmental Technologies, LLC



Raymond Cich
Operations Manager

**Lead in Water Sampling
In Accordance with
NYCRR Title 10, Subpart 67-4**

OF THE:

**Kenmore Tonawanda UFSD
Kenmore East High School**

PREPARED BY:



SIENNA
ENVIRONMENTAL TECHNOLOGIES
350 Elmwood Avenue  Buffalo, New York 14222
ph: 716.332.3134  www.siennaet.com

PREPARED FOR:

**Kenmore Tonawanda UFSD
1500 Colvin Boulevard
Buffalo, NY 14223**

CONDITIONS AS OF:

October 25, 2016



Summary Tabulation

1. Lead in Water Sampling

- 1.1 Introduction
- 1.2 Summary Table of Water Analysis that exceeds the action Level
- 1.3 Discussion and Recommendations

Appendices

- A General Conditions of Inspection
- B Chains of Custody and Laboratory Reports
- C Sample Location Maps
- D NYCRR Title 10, Subpart 67-4



1. Lead in Water Sampling

1.1 Introduction

Sienna Environmental Technologies performed client directed sampling of potable water outlets. The sampling event was conducted on October 7, 21, and 25, 2016 prior to the facilities opening in the morning and before any water was used; known as a “first-draw” sample. The outlets tested were reported to be out of service for a minimum of 8 hours, but not more than 18 hours, prior to sample collection. Sampling was conducted at outlets specified by the client at the following school:

- Kenmore East High School

Sienna Environmental Technologies was charged with:

1. Collecting a “first-draw” sample volume of 250 milliliters (mL), collected from cold water outlets after not being used for 8-18 hours. Sample locations were client directed.
2. Sending samples to an independent laboratory for lead analysis by ICP Method 200.8 in conformance with NYS and US EPA guidelines.
3. Providing a report of the sampling and analysis of the potable water for lead contamination to the School District.

1.2 Summary of Non-Compliant Water Analysis

NYCRR Title 10, Subpart 67-4 recommends that any water fountains and/or outlets be taken out of service if analysis indicates lead levels which exceed 15 parts per billion (ppb) based on a 250 mL first-draw sample. 15 ppb is equivalent to 15 micrograms per liter (µg/L). The following is a list of outlets in excess of 15 ppb. For a comprehensive list of outlets sampled, see appendix B.

Sample Date	Client ID Sample No.	Sample Description		Result (µg/L)
		Location of Outlet	Type of Outlet	
Kenmore East High School				
10-07-2016	KE-CFC-181-24	Room 181	Classroom Faucet Cold	32.2
10-07-2016	KE-DW-182-25	Room 182	Drinking Water Bubbler	21.0
10-07-2016	KE-CFL-157-50	Room 157	Classroom Faucet Cold	27.4
10-07-2016	KE-CFC-151-52	Room 151	Classroom Faucet Cold	45.8
10-07-2016	KE-CFC-149-54	Room 149	Classroom Faucet Cold	23.1
10-07-2016	KE-BFC-136e-60	Room 136e	Bathroom Faucet Cold	17.9
10-07-2016	KE-BFC-136f-61	Room 136f	Bathroom Faucet Cold	63.7
10-07-2016	KE-BFC-136f-62	Room 136f	Bathroom Faucet Cold	17.7
10-07-2016	KE-BFC-113a-84	Room 113a	Bathroom Faucet Cold	21.4
10-07-2016	KE-CFC-108a-87	Room 108a	Classroom Faucet Cold	19.2
10-07-2016	KE-CFC-108-88	Room 108	Classroom Faucet Cold	57.5
10-07-2016	KE-CFC-101-91	Room 101	Classroom Faucet Cold	230
10-07-2016	KE-BFC-102-93	Room 102	Bathroom Faucet Cold	20.3
10-07-2016	KE-CFC-219-99	Room 219	Classroom Faucet Cold	18.2
10-07-2016	KE-CFC-241-110	Room 241	Classroom Faucet Cold	50.4
10-07-2016	KE-CFC-243-112	Room 243	Classroom Faucet Cold	27.7

Sample Date	Client ID Sample No.	Sample Description		Result (µg/L)
		Location of Outlet	Type of Outlet	
10-07-2016	KE-CFC-251-117	Room 251	Classroom Faucet Cold	40.5
10-07-2016	KE-CFC-251a-118	Room 251a	Classroom Faucet Cold	103
10-07-2016	KE-CFC-255-125	Room 255	Classroom Faucet Cold	20.2
10-07-2016	KE-CFC-257a-129	Room 257a	Classroom Faucet Cold	58.7
10-21-2016	KE-CSC-311-144	Room 311	Custodial Slop Sink Cold	37.7
10-21-2016	KE-CFC-323-163	Room 323	Classroom Faucet Cold	41.3
10-21-2016	KE-CFC-323-164	Room 323	Classroom Faucet Cold	35.0
10-21-2016	KE-CFC-323-165	Room 323	Classroom Faucet Cold	25.9
10-21-2016	KE-CFC-323-166	Room 323	Classroom Faucet Cold	15.4
10-21-2016	KE-BFC-MSB-190	Men's Staff Bathroom	Bathroom Faucet Cold	16.8
10-21-2016	KE-CSH-JC-193	3 rd Floor Janitor's Closet	Custodial Slop Sink Hot	23.2
10-21-2016	KE-CFC-335-203	Room 335	Classroom Faucet Cold	33.7
10-21-2016	KE-CFC-337-213	Room 337	Classroom Faucet Cold	32.5
10-21-2016	KE-CFC-337-220	Room 337	Classroom Faucet Cold	36.1
10-21-2016	KE-CFC-343-229	Room 343	Classroom Faucet Cold	15.7
10-21-2016	KE-CFC-349-244	Room 349	Classroom Faucet Cold	35.8
10-21-2016	KE-CFC-349-245	Room 349	Classroom Faucet Cold	51.0
10-21-2016	KE-CFC-349-246	Room 349	Classroom Faucet Cold	31.9
10-21-2016	KE-CFC-351-248	Room 351	Classroom Faucet Cold	29.6
10-21-2016	KE-CFC-351-249	Room 351	Classroom Faucet Cold	26.5
10-21-2016	KE-CFC-351-250	Room 351	Classroom Faucet Cold	28.2
10-21-2016	KE-CFC-351-251	Room 351	Classroom Faucet Cold	62.1
10-21-2016	KE-CFC-351-252	Room 351	Classroom Faucet Cold	53.3
10-21-2016	KE-CFC-351-253	Room 351	Classroom Faucet Cold	52.6
10-21-2016	KE-CFC-355-257	Room 355	Classroom Faucet Cold	23.5
10-21-2016	KE-CFC-355-258	Room 355	Classroom Faucet Cold	17.0
10-21-2016	KE-CFC-355-264	Room 355	Classroom Faucet Cold	22.7
10-21-2016	KE-CFC-357-267	Room 357	Classroom Faucet Cold	27.5
10-21-2016	KE-CFC-357-273	Room 357	Classroom Faucet Cold	18.8
10-25-2016	KE-EXW-DW-274	Exterior West	Drinking Water Bubbler	15.5
10-25-2016	KE-EXN-HBC-275	Exterior North	Hose Bib Cold	33.6
10-25-2016	KE-EXN-HBC-276	Exterior North	Hose Bib Cold	21.2
10-25-2016	KE-EXN-HBC-277	Exterior North	Hose Bib Cold	348
10-25-2016	KE-EXE-HBC-279	Exterior East	Hose Bib Cold	92.8
10-25-2016	KE-EXS-HBC-280	Exterior South	Hose Bib Cold	369
10-25-2016	KE-EXS-HBC-281	Exterior South	Hose Bib Cold	152

1.3 Discussion and Recommendations

The testing provided is representative of the water that may be consumed at the beginning of the day or after infrequent use. It consists of water that has been in contact with the fixture and the plumbing connecting the faucet or the lateral pipes. Section 67-4.4 "Response" should be followed as your next steps to comply with NYCRR Title 10, Subpart 67-4.

Once section 67-4.4 has been completed, Sienna recommends the following actions for samples that exceed the action limit:

- Collect an additional first draw sample for analysis.
- Collect a follow-up flush sample. This sample is collected after the first draw sample is collected and the faucet is allowed to run for 30 seconds and is representative of the water that is in the plumbing upstream from the faucet.

This testing protocol will aid in identifying the potential source of the elevated lead level. If the lead level in the first draw sample is higher than that in the follow-up flush sample, the source of lead is the water faucet and/or the plumbing upstream from the faucet. If the lead level in follow-up flush sample is very low, i.e. close to 5 ppb, very little lead is coming from the plumbing upstream from the faucet. The majority or all of the lead in the water is from the faucet and/or the plumbing connecting the faucet to the lateral. If the lead level in the follow-up flush sample significantly exceeds 5 ppb (i.e. close to 10 ppb), lead from the plumbing upstream from the faucet may be contributing to these results.

In Addition, NYCRR Title 10, Subpart 67-4 states that you may find the United States Environmental Protection Agency's guidance document helpful, titled "3Ts for Reducing Lead in Drinking Water in Schools, Revised Technical Guidance".

https://www.epa.gov/sites/production/files/2015-09/documents/toolkit_leadschools_guide_3ts_leadschools.pdf

This document includes sample notifications letters, press releases, and provides guidance through the process of reducing lead exposure.



Appendix A General Conditions of Sampling

1. Sienna Environmental Technologies, LLC neither accepts nor implies any liability for the implementation of the recommendations found within this report.
2. The results of the laboratory analytical reports that may be contained herein are the product of the knowledge, experience and expertise of the laboratory retained to perform such services. Sienna Environmental Technologies neither accepts nor implies any liability for sample analysis reports compiled by others.
3. This report is based on the condition and contents present at the site on the day of the inspection. Sienna Environmental Technologies, LLC is not liable for materials, chemicals or other substances of concern that may have been removed or introduced to the site, prior to the inspection date or subsequent to that date.



Appendix B Chains of Custody and Laboratory Reports

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

ANALYTICAL REPORT

TestAmerica Laboratories, Inc.

TestAmerica Savannah

5102 LaRoche Avenue

Savannah, GA 31404

Tel: (912)354-7858

TestAmerica Job ID: 680-130863-1

TestAmerica Sample Delivery Group: SET 2845H

Client Project/Site: KenTon CSD - Kenmore East High School

Revision: 1


For:

Sienna Environmental Technologies LLC

350 Elmwood Avenue

Buffalo, New York 14222

Attn: Suzanne Kelley



Authorized for release by:

10/28/2016 2:44:28 PM

Melissa Deyo, Project Manager I

(716)504-9874

melissa.deyo@testamericainc.com

LINKS

Review your project
results through

TotalAccess

Have a Question?



Visit us at:

www.testamericainc.com

The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

Table of Contents

Cover Page	1
Table of Contents	2
Definitions/Glossary	3
Case Narrative	4
Detection Summary	5
Client Sample Results	18
QC Sample Results	37
QC Association Summary	42
Lab Chronicle	50
Certification Summary	76
Method Summary	77
Sample Summary	78
Chain of Custody	81
Receipt Checklists	94



Definitions/Glossary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Qualifiers

Metals

Qualifier	Qualifier Description
B	Compound was found in the blank and sample.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Job ID: 680-130863-1

Laboratory: TestAmerica Savannah

Narrative

Job Narrative 680-130863-1

Receipt

The samples were received on 10/14/2016 9:40 AM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperatures of the 2 coolers at receipt time were 20.2° C and 21.9° C.

Metals

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-KFC-173a-01

Lab Sample ID: 680-130863-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.6		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-02

Lab Sample ID: 680-130863-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-03

Lab Sample ID: 680-130863-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.85		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-04

Lab Sample ID: 680-130863-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.57		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-05

Lab Sample ID: 680-130863-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.32		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KCC-173a-06

Lab Sample ID: 680-130863-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-07

Lab Sample ID: 680-130863-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-08

Lab Sample ID: 680-130863-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	13.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-09

Lab Sample ID: 680-130863-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-10

Lab Sample ID: 680-130863-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.1		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-11

Lab Sample ID: 680-130863-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-KFC-173a-11 (Continued)

Lab Sample ID: 680-130863-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-12

Lab Sample ID: 680-130863-12

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.8	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-KFC-173a-13

Lab Sample ID: 680-130863-13

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.3	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-173b-14

Lab Sample ID: 680-130863-14

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.2	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-171a-15

Lab Sample ID: 680-130863-15

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.54	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-171-16

Lab Sample ID: 680-130863-16

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.3		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-171-17

Lab Sample ID: 680-130863-17

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-175-18

Lab Sample ID: 680-130863-18

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-175-19

Lab Sample ID: 680-130863-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.8		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-177-20

Lab Sample ID: 680-130863-20

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-IMC-177-21

Lab Sample ID: 680-130863-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-IMC-177-21 (Continued)

Lab Sample ID: 680-130863-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.47		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-IMC-179-22

Lab Sample ID: 680-130863-22

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.57		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-181-23

Lab Sample ID: 680-130863-23

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	14.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-181-24

Lab Sample ID: 680-130863-24

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	32.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-DW-182-25

Lab Sample ID: 680-130863-25

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	21.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-182-26

Lab Sample ID: 680-130863-26

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.9		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-172a-27

Lab Sample ID: 680-130863-27

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.22	J	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-HWC-172a-28

Lab Sample ID: 680-130863-28

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.7	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-HWC-172a-29

Lab Sample ID: 680-130863-29

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.0	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-HWC-172a-30

Lab Sample ID: 680-130863-30

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.6	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-172b-31

Lab Sample ID: 680-130863-31

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-172b-31 (Continued)

Lab Sample ID: 680-130863-31

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.2	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-DW-172c-32

Lab Sample ID: 680-130863-32

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.6	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-172-33

Lab Sample ID: 680-130863-33

No Detections.

Client Sample ID: KE-HWC-172-34

Lab Sample ID: 680-130863-34

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-HWC-172-35

Lab Sample ID: 680-130863-35

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-HWC-172-36

Lab Sample ID: 680-130863-36

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.7	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-172e-37

Lab Sample ID: 680-130863-37

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.71		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-154-38

Lab Sample ID: 680-130863-38

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.21	J	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-HWC-154-39

Lab Sample ID: 680-130863-39

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-HWC-154-40

Lab Sample ID: 680-130863-40

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.55		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-154-HWC-41

Lab Sample ID: 680-130863-41

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.58		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-154e-DW-42

Lab Sample ID: 680-130863-42

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-154f-BFC-43

Lab Sample ID: 680-130863-43

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.22	J	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-154b-WC-44

Lab Sample ID: 680-130863-44

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.17	J	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-154b-HWC-45

Lab Sample ID: 680-130863-45

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-154b-HWC-46

Lab Sample ID: 680-130863-46

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.3	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-154b-HWC-47

Lab Sample ID: 680-130863-47

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.1	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-NWC-48

Lab Sample ID: 680-130863-48

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.1	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-NWC-49

Lab Sample ID: 680-130863-49

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.75	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFL-157-50

Lab Sample ID: 680-130863-50

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	27.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-157-51

Lab Sample ID: 680-130863-51

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.6	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-151-52

Lab Sample ID: 680-130863-52

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-151-52 (Continued)

Lab Sample ID: 680-130863-52

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	45.8		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-151-53

Lab Sample ID: 680-130863-53

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.6		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-149-54

Lab Sample ID: 680-130863-54

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	23.1		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-143a-55

Lab Sample ID: 680-130863-55

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.98		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-NEC-56

Lab Sample ID: 680-130863-56

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-SPR-57

Lab Sample ID: 680-130863-57

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.9		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-REC-58

Lab Sample ID: 680-130863-58

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-136e-59

Lab Sample ID: 680-130863-59

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	13.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-136e-60

Lab Sample ID: 680-130863-60

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	17.9		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-136f-61

Lab Sample ID: 680-130863-61

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	63.7		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-136f-62

Lab Sample ID: 680-130863-62

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-136f-62 (Continued)

Lab Sample ID: 680-130863-62

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	17.7		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-163a-63

Lab Sample ID: 680-130863-63

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-163-64

Lab Sample ID: 680-130863-64

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.7		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-163-65

Lab Sample ID: 680-130863-65

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161a-66

Lab Sample ID: 680-130863-66

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.8		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161a-67

Lab Sample ID: 680-130863-67

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161a-68

Lab Sample ID: 680-130863-68

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.96		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161a-69

Lab Sample ID: 680-130863-69

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.3		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161a-70

Lab Sample ID: 680-130863-70

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.1		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161a-71

Lab Sample ID: 680-130863-71

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.1		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161b-72

Lab Sample ID: 680-130863-72

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-161b-72 (Continued)

Lab Sample ID: 680-130863-72

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161b-73

Lab Sample ID: 680-130863-73

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161b-74

Lab Sample ID: 680-130863-74

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161b-75

Lab Sample ID: 680-130863-75

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.1		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161b-76

Lab Sample ID: 680-130863-76

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.89		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-161b-77

Lab Sample ID: 680-130863-77

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.69		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KW-WC-SCC-78

Lab Sample ID: 680-130863-78

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.9		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KW-WC-SCC-79

Lab Sample ID: 680-130863-79

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.5	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-120a-80

Lab Sample ID: 680-130863-80

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.2	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-121a-81

Lab Sample ID: 680-130863-81

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	12.9	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-121b-82

Lab Sample ID: 680-130863-82

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-121b-82 (Continued)

Lab Sample ID: 680-130863-82

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.9	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-115-83

Lab Sample ID: 680-130863-83

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.4	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-113a-84

Lab Sample ID: 680-130863-84

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	21.4	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-SEC-85

Lab Sample ID: 680-130863-85

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.61		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-110-86

Lab Sample ID: 680-130863-86

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-108a-87

Lab Sample ID: 680-130863-87

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	19.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-108-88

Lab Sample ID: 680-130863-88

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	57.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-SEC-89

Lab Sample ID: 680-130863-89

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.2	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-101-91

Lab Sample ID: 680-130863-90

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	230		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-102a-92

Lab Sample ID: 680-130863-91

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-102-93

Lab Sample ID: 680-130863-92

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-102-93 (Continued)

Lab Sample ID: 680-130863-92

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	20.3		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-100-94

Lab Sample ID: 680-130863-93

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	12.7		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-220-95

Lab Sample ID: 680-130863-94

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.46		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-220a-96

Lab Sample ID: 680-130863-95

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.3		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-SEC-97

Lab Sample ID: 680-130863-96

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.5	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-SEC-98

Lab Sample ID: 680-130863-97

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.76		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-219-99

Lab Sample ID: 680-130863-98

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	18.2	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-224-100

Lab Sample ID: 680-130863-99

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-DW-234-101

Lab Sample ID: 680-130863-100

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.1		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-223-102

Lab Sample ID: 680-130863-101

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.8		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-223a-103

Lab Sample ID: 680-130863-102

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-223a-103 (Continued)

Lab Sample ID: 680-130863-102

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	14.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-223a-104

Lab Sample ID: 680-130863-103

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.8		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-223a-105

Lab Sample ID: 680-130863-104

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	13.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-223b-106

Lab Sample ID: 680-130863-105

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	13.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-BFC-223b-107

Lab Sample ID: 680-130863-106

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.8		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-235-108

Lab Sample ID: 680-130863-107

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	13.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-241-109

Lab Sample ID: 680-130863-108

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-241-110

Lab Sample ID: 680-130863-109

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	50.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-243-111

Lab Sample ID: 680-130863-110

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.6		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-243-112

Lab Sample ID: 680-130863-111

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	27.7		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-NEC-113

Lab Sample ID: 680-130863-112

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-WC-NEC-113 (Continued)

Lab Sample ID: 680-130863-112

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-251-114

Lab Sample ID: 680-130863-113

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-251-115

Lab Sample ID: 680-130863-114

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-251-116

Lab Sample ID: 680-130863-115

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	12.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-251-117

Lab Sample ID: 680-130863-116

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	40.5		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-251a-118

Lab Sample ID: 680-130863-117

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	103	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-NWC-119

Lab Sample ID: 680-130863-118

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.5	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-253-120

Lab Sample ID: 680-130863-119

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.9	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-253-121

Lab Sample ID: 680-130863-120

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.7		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-253-122

Lab Sample ID: 680-130863-121

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.0		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-253-123

Lab Sample ID: 680-130863-122

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-253-123 (Continued)

Lab Sample ID: 680-130863-122

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.9		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-253-124

Lab Sample ID: 680-130863-123

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.3		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-255-125

Lab Sample ID: 680-130863-124

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	20.2		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-256-126

Lab Sample ID: 680-130863-125

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.8		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-257-127

Lab Sample ID: 680-130863-126

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.9	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-257a-128

Lab Sample ID: 680-130863-127

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.4		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-CFC-257a-129

Lab Sample ID: 680-130863-128

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	58.7	B	0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

Client Sample ID: KE-WC-SWC-130

Lab Sample ID: 680-130863-129

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.43		0.30	0.060	ug/L	1		200.8-1994 R5.4	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-KFC-173a-01

Date Collected: 10/07/16 03:15

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-1

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.6		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 00:02	1

Client Sample ID: KE-KFC-173a-02

Date Collected: 10/07/16 03:15

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-2

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.4		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 00:31	1

Client Sample ID: KE-KFC-173a-03

Date Collected: 10/07/16 03:16

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-3

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.85		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 01:56	1

Client Sample ID: KE-KFC-173a-04

Date Collected: 10/07/16 03:16

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-4

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.57		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 13:31	1

Client Sample ID: KE-KFC-173a-05

Date Collected: 10/07/16 03:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-5

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.32		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 14:55	1

Client Sample ID: KE-KCC-173a-06

Date Collected: 10/07/16 03:18

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-6

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.2		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 21:45	1

Client Sample ID: KE-KFC-173a-07

Date Collected: 10/07/16 03:19

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-7

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.4		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 23:05	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-KFC-173a-08

Date Collected: 10/07/16 03:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-8

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	13.5		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 03:17	1

Client Sample ID: KE-KFC-173a-09

Date Collected: 10/07/16 03:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-9

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.2		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 04:42	1

Client Sample ID: KE-KFC-173a-10

Date Collected: 10/07/16 03:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-10

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.1		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 12:41	1

Client Sample ID: KE-KFC-173a-11

Date Collected: 10/07/16 03:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-11

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.2		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:07	1

Client Sample ID: KE-KFC-173a-12

Date Collected: 10/07/16 03:22

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-12

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.8	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 04:15	1

Client Sample ID: KE-KFC-173a-13

Date Collected: 10/07/16 03:23

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-13

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.3	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 05:54	1

Client Sample ID: KE-BFC-173b-14

Date Collected: 10/07/16 03:26

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-14

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.2	B	0.30	0.060	ug/L	-	10/17/16 13:25	10/19/16 03:04	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-171a-15

Date Collected: 10/07/16 03:30

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-15

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.54	B	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 05:26	1

Client Sample ID: KE-WC-171-16

Date Collected: 10/07/16 03:32

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-16

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.3		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 22:09	1

Client Sample ID: KE-WC-171-17

Date Collected: 10/07/16 03:32

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-17

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.4		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 23:10	1

Client Sample ID: KE-WC-175-18

Date Collected: 10/07/16 03:35

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-18

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.4		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 03:40	1

Client Sample ID: KE-WC-175-19

Date Collected: 10/07/16 03:35

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-19

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.8		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 04:56	1

Client Sample ID: KE-CFC-177-20

Date Collected: 10/07/16 03:38

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-20

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.2		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 05:34	1

Client Sample ID: KE-IMC-177-21

Date Collected: 10/07/16 03:39

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-21

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.47		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 01:51	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-IMC-179-22

Date Collected: 10/07/16 03:43

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-22

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.57		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:14	1

Client Sample ID: KE-CFC-181-23

Date Collected: 10/07/16 03:45

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-23

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	14.4		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:20	1

Client Sample ID: KE-CFC-181-24

Date Collected: 10/07/16 03:45

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-24

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	32.2		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 00:54	1

Client Sample ID: KE-DW-182-25

Date Collected: 10/07/16 03:48

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-25

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	21.0		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 02:10	1

Client Sample ID: KE-BFC-182-26

Date Collected: 10/07/16 03:49

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-26

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.9		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 13:54	1

Client Sample ID: KE-WC-172a-27

Date Collected: 10/07/16 03:57

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-27

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.22	J	0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 15:09	1

Client Sample ID: KE-HWC-172a-28

Date Collected: 10/07/16 03:59

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-28

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.7	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 06:04	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-HWC-172a-29

Date Collected: 10/07/16 03:59

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-29

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.0	B	0.30	0.060	ug/L	—	10/17/16 13:25	10/19/16 03:13	1

Client Sample ID: KE-HWC-172a-30

Date Collected: 10/07/16 03:59

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-30

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.6	B	0.30	0.060	ug/L	—	10/17/16 13:25	10/19/16 03:08	1

Client Sample ID: KE-BFC-172b-31

Date Collected: 10/07/16 04:01

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-31

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.2	B	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 05:02	1

Client Sample ID: KE-DW-172c-32

Date Collected: 10/07/16 04:02

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-32

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.6	B	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 05:59	1

Client Sample ID: KE-WC-172-33

Date Collected: 10/07/16 04:05

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-33

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L	—	10/17/16 11:18	10/27/16 13:31	1

Client Sample ID: KE-HWC-172-34

Date Collected: 10/07/16 04:06

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-34

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.0		0.30	0.060	ug/L	—	10/17/16 11:18	10/27/16 13:12	1

Client Sample ID: KE-HWC-172-35

Date Collected: 10/07/16 04:06

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-35

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.0		0.30	0.060	ug/L	—	10/17/16 11:18	10/27/16 13:17	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-HWC-172-36

Date Collected: 10/07/16 04:06

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-36

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.7	B	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 05:12	1

Client Sample ID: KE-BFC-172e-37

Date Collected: 10/07/16 04:09

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-37

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.71		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 22:32	1

Client Sample ID: KE-WC-154-38

Date Collected: 10/07/16 04:18

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-38

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.21	J	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 23:24	1

Client Sample ID: KE-HWC-154-39

Date Collected: 10/07/16 04:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-39

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.2		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 04:04	1

Client Sample ID: KE-HWC-154-40

Date Collected: 10/07/16 04:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-40

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.55		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 05:01	1

Client Sample ID: KE-154-HWC-41

Date Collected: 10/07/16 04:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-41

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.58		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 01:18	1

Client Sample ID: KE-154e-DW-42

Date Collected: 10/07/16 04:22

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-42

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.5		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 02:15	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-154f-BFC-43

Date Collected: 10/07/16 04:22

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-43

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.22	J	0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 14:18	1

Client Sample ID: KE-154b-WC-44

Date Collected: 10/07/16 04:26

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-44

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.17	J	0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 15:14	1

Client Sample ID: KE-154b-HWC-45

Date Collected: 10/07/16 04:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-45

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.2		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 02:48	1

Client Sample ID: KE-154b-HWC-46

Date Collected: 10/07/16 04:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-46

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.3	B	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 05:16	1

Client Sample ID: KE-154b-HWC-47

Date Collected: 10/07/16 04:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-47

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.1	B	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 06:08	1

Client Sample ID: KE-WC-NWC-48

Date Collected: 10/07/16 04:31

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-48

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.1	B	0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 05:30	1

Client Sample ID: KE-WC-NWC-49

Date Collected: 10/07/16 04:33

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-49

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.75	B	0.30	0.060	ug/L	—	10/17/16 13:25	10/19/16 03:18	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFL-157-50

Date Collected: 10/07/16 04:35

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-50

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	27.4		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 14:22	1

Client Sample ID: KE-CFC-157-51

Date Collected: 10/07/16 04:35

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-51

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.6	B	0.30	0.060	ug/L	—	10/17/16 13:25	10/19/16 03:46	1

Client Sample ID: KE-CFC-151-52

Date Collected: 10/07/16 04:40

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-52

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	45.8		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 15:18	1

Client Sample ID: KE-CFC-151-53

Date Collected: 10/07/16 04:40

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-53

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.6		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 14:50	1

Client Sample ID: KE-CFC-149-54

Date Collected: 10/07/16 04:43

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-54

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	23.1		0.30	0.060	ug/L	—	10/17/16 11:18	10/27/16 13:25	1

Client Sample ID: KE-CFC-143a-55

Date Collected: 10/07/16 04:49

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-55

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.98		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 22:37	1

Client Sample ID: KE-WC-NEC-56

Date Collected: 10/07/16 04:52

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-56

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.5		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 05:15	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-WC-SPR-57

Date Collected: 10/07/16 04:55

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-57

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.9		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 01:27	1

Client Sample ID: KE-CFC-REC-58

Date Collected: 10/07/16 04:57

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-58

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.5		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 04:18	1

Client Sample ID: KE-BFC-136e-59

Date Collected: 10/07/16 05:00

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-59

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	13.5		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 04:14	1

Client Sample ID: KE-BFC-136e-60

Date Collected: 10/07/16 05:00

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-60

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	17.9		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 02:24	1

Client Sample ID: KE-BFC-136f-61

Date Collected: 10/07/16 05:02

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-61

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	63.7		0.30	0.060	ug/L	—	10/17/16 11:18	10/20/16 14:27	1

Client Sample ID: KE-BFC-136f-62

Date Collected: 10/07/16 05:02

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-62

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	17.7		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 23:29	1

Client Sample ID: KE-BFC-163a-63

Date Collected: 10/07/16 05:07

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-63

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.2		0.30	0.060	ug/L	—	10/17/16 11:18	10/19/16 23:34	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-163-64

Date Collected: 10/07/16 05:11

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-64

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.7		0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 22:42	1

Client Sample ID: KE-CFC-163-65

Date Collected: 10/07/16 05:11

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-65

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.4		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 04:09	1

Client Sample ID: KE-BFC-161a-66

Date Collected: 10/07/16 05:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-66

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.8		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 05:06	1

Client Sample ID: KE-BFC-161a-67

Date Collected: 10/07/16 05:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-67

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.0		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 02:20	1

Client Sample ID: KE-BFC-161a-68

Date Collected: 10/07/16 05:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-68

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.96		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 01:23	1

Client Sample ID: KE-BFC-161a-69

Date Collected: 10/07/16 05:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-69

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.3		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 16:01	1

Client Sample ID: KE-BFC-161a-70

Date Collected: 10/07/16 05:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-70

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.1		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 01:32	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-161a-71

Date Collected: 10/07/16 05:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-71

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.1		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 02:29	1

Client Sample ID: KE-BFC-161b-72

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-72

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.4		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 14:32	1

Client Sample ID: KE-BFC-161b-73

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-73

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.0		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:39	1

Client Sample ID: KE-BFC-161b-74

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-74

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.2		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 15:28	1

Client Sample ID: KE-BFC-161b-75

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-75

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.1		0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 23:57	1

Client Sample ID: KE-BFC-161b-76

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-76

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.89		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:49	1

Client Sample ID: KE-BFC-161b-77

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-77

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.69		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:46	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KW-WC-SCC-78

Date Collected: 10/07/16 05:24

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-78

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.9		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:44	1

Client Sample ID: KW-WC-SCC-79

Date Collected: 10/07/16 05:24

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-79

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.5	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 05:21	1

Client Sample ID: KE-BFC-120a-80

Date Collected: 10/07/16 05:27

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-80

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.2	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 06:18	1

Client Sample ID: KE-CFC-121a-81

Date Collected: 10/07/16 05:30

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-81

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	12.9	B	0.30	0.060	ug/L	-	10/17/16 13:25	10/19/16 03:37	1

Client Sample ID: KE-BFC-121b-82

Date Collected: 10/07/16 05:30

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-82

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.9	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 06:13	1

Client Sample ID: KE-CFC-115-83

Date Collected: 10/07/16 05:37

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-83

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.4	B	0.30	0.060	ug/L	-	10/17/16 13:25	10/19/16 03:32	1

Client Sample ID: KE-BFC-113a-84

Date Collected: 10/07/16 05:39

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-84

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	21.4	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 05:07	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-WC-SEC-85

Date Collected: 10/07/16 05:41

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-85

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.61		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 15:23	1

Client Sample ID: KE-CFC-110-86

Date Collected: 10/07/16 05:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-86

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.0		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 04:37	1

Client Sample ID: KE-CFC-108a-87

Date Collected: 10/07/16 05:45

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-87

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	19.2		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 13:22	1

Client Sample ID: KE-CFC-108-88

Date Collected: 10/07/16 05:46

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-88

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	57.5		0.30	0.060	ug/L	-	10/17/16 11:18	10/27/16 12:54	1

Client Sample ID: KE-WC-SEC-89

Date Collected: 10/07/16 05:47

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-89

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.2	B	0.30	0.060	ug/L	-	10/17/16 11:18	10/19/16 05:40	1

Client Sample ID: KE-CFC-101-91

Date Collected: 10/07/16 05:52

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-90

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	230		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 16:05	1

Client Sample ID: KE-BFC-102a-92

Date Collected: 10/07/16 05:55

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-91

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.2		0.30	0.060	ug/L	-	10/17/16 11:18	10/20/16 01:42	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-102-93

Date Collected: 10/07/16 05:57

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-92

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	20.3		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 15:37	1

Client Sample ID: KE-CFC-100-94

Date Collected: 10/07/16 06:01

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-93

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	12.7		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 15:47	1

Client Sample ID: KE-BFC-220-95

Date Collected: 10/07/16 06:08

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-94

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.46		0.30	0.060	ug/L		10/17/16 11:18	10/27/16 14:00	1

Client Sample ID: KE-BFC-220a-96

Date Collected: 10/07/16 06:09

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-95

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.3		0.30	0.060	ug/L		10/17/16 11:18	10/27/16 13:41	1

Client Sample ID: KE-WC-SEC-97

Date Collected: 10/07/16 06:11

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-96

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.5	B	0.30	0.060	ug/L		10/17/16 11:18	10/19/16 04:38	1

Client Sample ID: KE-WC-SEC-98

Date Collected: 10/07/16 06:12

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-97

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.76		0.30	0.060	ug/L		10/17/16 11:18	10/27/16 13:52	1

Client Sample ID: KE-CFC-219-99

Date Collected: 10/07/16 06:16

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-98

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	18.2	B	0.30	0.060	ug/L		10/17/16 11:18	10/19/16 06:23	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-224-100

Date Collected: 10/07/16 06:19

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-99

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.0		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 04:33	1

Client Sample ID: KE-DW-234-101

Date Collected: 10/07/16 06:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-100

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.1		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 04:28	1

Client Sample ID: KE-WC-223-102

Date Collected: 10/07/16 06:25

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-101

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.8		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 22:56	1

Client Sample ID: KE-BFC-223a-103

Date Collected: 10/07/16 06:27

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-102

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	14.5		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 22:51	1

Client Sample ID: KE-BFC-223a-104

Date Collected: 10/07/16 06:27

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-103

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.8		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 22:46	1

Client Sample ID: KE-BFC-223a-105

Date Collected: 10/07/16 06:27

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-104

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	13.2		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 23:38	1

Client Sample ID: KE-BFC-223b-106

Date Collected: 10/07/16 06:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-105

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	13.2		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 23:43	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-223b-107

Date Collected: 10/07/16 06:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-106

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.8		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 02:34	1

Client Sample ID: KE-CFC-235-108

Date Collected: 10/07/16 06:30

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-107

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	13.0		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 14:36	1

Client Sample ID: KE-CFC-241-109

Date Collected: 10/07/16 06:34

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-108

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.0		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 23:48	1

Client Sample ID: KE-CFC-241-110

Date Collected: 10/07/16 06:34

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-109

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	50.4		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 16:10	1

Client Sample ID: KE-CFC-243-111

Date Collected: 10/07/16 06:37

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-110

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.6		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 02:44	1

Client Sample ID: KE-CFC-243-112

Date Collected: 10/07/16 06:37

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-111

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	27.7		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 02:39	1

Client Sample ID: KE-WC-NEC-113

Date Collected: 10/07/16 06:39

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-112

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.0		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 15:32	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-251-114

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-113

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.4		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 05:11	1

Client Sample ID: KE-CFC-251-115

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-114

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.2		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 04:23	1

Client Sample ID: KE-CFC-251-116

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-115

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	12.0		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 23:53	1

Client Sample ID: KE-CFC-251-117

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-116

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	40.5		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 23:01	1

Client Sample ID: KE-CFC-251a-118

Date Collected: 10/07/16 06:46

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-117

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	103	B	0.30	0.060	ug/L		10/17/16 13:25	10/19/16 02:59	1

Client Sample ID: KE-WC-NWC-119

Date Collected: 10/07/16 06:47

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-118

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.5	B	0.30	0.060	ug/L		10/17/16 11:18	10/19/16 06:32	1

Client Sample ID: KE-CFC-253-120

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-119

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.9	B	0.30	0.060	ug/L		10/17/16 11:18	10/19/16 05:35	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-253-121

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-120

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.7		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 14:46	1

Client Sample ID: KE-CFC-253-122

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-121

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.0		0.30	0.060	ug/L		10/17/16 11:18	10/27/16 13:54	1

Client Sample ID: KE-CFC-253-123

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-122

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.9		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 15:42	1

Client Sample ID: KE-CFC-253-124

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-123

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.3		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 01:46	1

Client Sample ID: KE-CFC-255-125

Date Collected: 10/07/16 06:51

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-124

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	20.2		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 01:37	1

Client Sample ID: KE-CFC-256-126

Date Collected: 10/07/16 06:51

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-125

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.8		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 14:41	1

Client Sample ID: KE-CFC-257-127

Date Collected: 10/07/16 06:55

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-126

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.9	B	0.30	0.060	ug/L		10/17/16 11:18	10/19/16 06:27	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-257a-128

Lab Sample ID: 680-130863-127

Date Collected: 10/07/16 06:56

Matrix: Water

Date Received: 10/14/16 09:40

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.4		0.30	0.060	ug/L		10/17/16 11:18	10/27/16 13:57	1

Client Sample ID: KE-CFC-257a-129

Lab Sample ID: 680-130863-128

Date Collected: 10/07/16 06:56

Matrix: Water

Date Received: 10/14/16 09:40

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	58.7	B	0.30	0.060	ug/L		10/17/16 13:25	10/19/16 03:42	1

Client Sample ID: KE-WC-SWC-130

Lab Sample ID: 680-130863-129

Date Collected: 10/07/16 06:58

Matrix: Water

Date Received: 10/14/16 09:40

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.43		0.30	0.060	ug/L		10/17/16 11:18	10/27/16 13:09	1

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Lab Sample ID: MB 680-453519/1-A
Matrix: Water
Analysis Batch: 455281

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 453519

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		10/17/16 11:18	10/27/16 12:33	1

Lab Sample ID: LCS 680-453519/2-A
Matrix: Water
Analysis Batch: 455281

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 453519

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	50.0	49.30		ug/L		99	85 - 115

Lab Sample ID: 680-130863-10 MS
Matrix: Water
Analysis Batch: 455281

Client Sample ID: KE-KFC-173a-10
Prep Type: Total/NA
Prep Batch: 453519

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	3.1		20.0	21.98		ug/L		94	70 - 130

Lab Sample ID: 680-130863-10 MSD
Matrix: Water
Analysis Batch: 455281

Client Sample ID: KE-KFC-173a-10
Prep Type: Total/NA
Prep Batch: 453519

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	3.1		20.0	21.93		ug/L		94	70 - 130	0	20

Lab Sample ID: 680-130863-88 MS
Matrix: Water
Analysis Batch: 455281

Client Sample ID: KE-CFC-108-88
Prep Type: Total/NA
Prep Batch: 453519

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	57.5		20.0	77.52		ug/L		100	70 - 130

Lab Sample ID: 680-130863-88 MSD
Matrix: Water
Analysis Batch: 455281

Client Sample ID: KE-CFC-108-88
Prep Type: Total/NA
Prep Batch: 453519

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	57.5		20.0	77.88		ug/L		102	70 - 130	0	20

Lab Sample ID: MB 680-453520/1-A
Matrix: Water
Analysis Batch: 454015

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 453520

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		10/17/16 11:18	10/19/16 21:31	1

Lab Sample ID: LCS 680-453520/2-A
Matrix: Water
Analysis Batch: 454015

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 453520

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	50.0	50.40		ug/L		101	85 - 115

TestAmerica Savannah

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Lab Sample ID: 680-130863-6 MS
Matrix: Water
Analysis Batch: 454015

Client Sample ID: KE-KCC-173a-06
Prep Type: Total/NA
Prep Batch: 453520

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	1.2		20.0	20.92		ug/L		99	70 - 130

Lab Sample ID: 680-130863-6 MSD
Matrix: Water
Analysis Batch: 454015

Client Sample ID: KE-KCC-173a-06
Prep Type: Total/NA
Prep Batch: 453520

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	1.2		20.0	20.89		ug/L		99	70 - 130	0	20

Lab Sample ID: 680-130863-16 MS
Matrix: Water
Analysis Batch: 454015

Client Sample ID: KE-WC-171-16
Prep Type: Total/NA
Prep Batch: 453520

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	1.3		20.0	20.80		ug/L		98	70 - 130

Lab Sample ID: 680-130863-16 MSD
Matrix: Water
Analysis Batch: 454015

Client Sample ID: KE-WC-171-16
Prep Type: Total/NA
Prep Batch: 453520

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	1.3		20.0	20.91		ug/L		98	70 - 130	1	20

Lab Sample ID: MB 680-453559/1-A
Matrix: Water
Analysis Batch: 454015

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 453559

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 03:03	1

Lab Sample ID: LCS 680-453559/2-A
Matrix: Water
Analysis Batch: 454015

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 453559

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	50.0	50.58		ug/L		101	85 - 115

Lab Sample ID: 680-130863-8 MS
Matrix: Water
Analysis Batch: 454015

Client Sample ID: KE-KFC-173a-08
Prep Type: Total/NA
Prep Batch: 453559

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	13.5		20.0	33.29		ug/L		99	70 - 130

Lab Sample ID: 680-130863-8 MSD
Matrix: Water
Analysis Batch: 454015

Client Sample ID: KE-KFC-173a-08
Prep Type: Total/NA
Prep Batch: 453559

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	13.5		20.0	33.60		ug/L		101	70 - 130	1	20

TestAmerica Savannah

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Method: 200.8-1994 R5.4 - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-130863-18 MS

Matrix: Water

Analysis Batch: 454015

Client Sample ID: KE-WC-175-18

Prep Type: Total/NA

Prep Batch: 453559

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	1.4		20.0	21.07		ug/L		98	70 - 130

Lab Sample ID: 680-130863-18 MSD

Matrix: Water

Analysis Batch: 454015

Client Sample ID: KE-WC-175-18

Prep Type: Total/NA

Prep Batch: 453559

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	1.4		20.0	21.23		ug/L		99	70 - 130	1	20

Lab Sample ID: MB 680-453563/1-A

Matrix: Water

Analysis Batch: 454015

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 453563

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 00:16	1

Lab Sample ID: LCS 680-453563/2-A

Matrix: Water

Analysis Batch: 454015

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 453563

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	50.0	49.30		ug/L		99	85 - 115

Lab Sample ID: 680-130863-2 MS

Matrix: Water

Analysis Batch: 454015

Client Sample ID: KE-KFC-173a-02

Prep Type: Total/NA

Prep Batch: 453563

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	2.4		20.0	22.05		ug/L		98	70 - 130

Lab Sample ID: 680-130863-2 MSD

Matrix: Water

Analysis Batch: 454015

Client Sample ID: KE-KFC-173a-02

Prep Type: Total/NA

Prep Batch: 453563

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	2.4		20.0	22.03		ug/L		98	70 - 130	0	20

Lab Sample ID: 680-130863-24 MS

Matrix: Water

Analysis Batch: 454015

Client Sample ID: KE-CFC-181-24

Prep Type: Total/NA

Prep Batch: 453563

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	32.2		20.0	51.88		ug/L		99	70 - 130

Lab Sample ID: 680-130863-24 MSD

Matrix: Water

Analysis Batch: 454015

Client Sample ID: KE-CFC-181-24

Prep Type: Total/NA

Prep Batch: 453563

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	32.2		20.0	51.84		ug/L		98	70 - 130	0	20

TestAmerica Savannah

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Lab Sample ID: MB 680-453564/1-A
Matrix: Water
Analysis Batch: 454233

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 453564

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		10/17/16 11:18	10/20/16 13:17	1

Lab Sample ID: LCS 680-453564/2-A
Matrix: Water
Analysis Batch: 454233

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 453564

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Lead	50.0	50.64		ug/L		101	85 - 115

Lab Sample ID: 680-130863-4 MS
Matrix: Water
Analysis Batch: 454233

Client Sample ID: KE-KFC-173a-04
Prep Type: Total/NA
Prep Batch: 453564

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits
Lead	0.57		20.0	20.80		ug/L		101	70 - 130

Lab Sample ID: 680-130863-4 MSD
Matrix: Water
Analysis Batch: 454233

Client Sample ID: KE-KFC-173a-04
Prep Type: Total/NA
Prep Batch: 453564

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Lead	0.57		20.0	21.34		ug/L		104	70 - 130	3	20

Lab Sample ID: 680-130863-26 MS
Matrix: Water
Analysis Batch: 454233

Client Sample ID: KE-BFC-182-26
Prep Type: Total/NA
Prep Batch: 453564

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits
Lead	10.9		20.0	32.49		ug/L		108	70 - 130

Lab Sample ID: 680-130863-26 MSD
Matrix: Water
Analysis Batch: 454233

Client Sample ID: KE-BFC-182-26
Prep Type: Total/NA
Prep Batch: 453564

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Lead	10.9		20.0	32.42		ug/L		108	70 - 130	0	20

Lab Sample ID: MB 680-453566/1-A
Matrix: Water
Analysis Batch: 453850

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 453566

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.0696	J	0.30	0.060	ug/L		10/17/16 11:18	10/19/16 04:00	1

Lab Sample ID: LCS 680-453566/2-A
Matrix: Water
Analysis Batch: 453850

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 453566

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Lead	50.0	47.40		ug/L		95	85 - 115

TestAmerica Savannah

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Method: 200.8-1994 R5.4 - Metals (ICP/MS) (Continued)

Lab Sample ID: 680-130863-12 MS

Matrix: Water

Analysis Batch: 453850

Client Sample ID: KE-KFC-173a-12

Prep Type: Total/NA

Prep Batch: 453566

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	10.8	B	20.0	30.48		ug/L		98	70 - 130

Lab Sample ID: 680-130863-12 MSD

Matrix: Water

Analysis Batch: 453850

Client Sample ID: KE-KFC-173a-12

Prep Type: Total/NA

Prep Batch: 453566

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	10.8	B	20.0	30.48		ug/L		98	70 - 130	0	20

Lab Sample ID: 680-130863-96 MS

Matrix: Water

Analysis Batch: 453850

Client Sample ID: KE-WC-SEC-97

Prep Type: Total/NA

Prep Batch: 453566

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	1.5	B	20.0	20.61		ug/L		95	70 - 130

Lab Sample ID: 680-130863-96 MSD

Matrix: Water

Analysis Batch: 453850

Client Sample ID: KE-WC-SEC-97

Prep Type: Total/NA

Prep Batch: 453566

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	1.5	B	20.0	20.58		ug/L		95	70 - 130	0	20

Lab Sample ID: MB 680-453570/1-A

Matrix: Water

Analysis Batch: 453850

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 453570

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.0677	J	0.30	0.060	ug/L		10/17/16 13:25	10/19/16 01:38	1

Lab Sample ID: LCS 680-453570/2-A

Matrix: Water

Analysis Batch: 453850

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 453570

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	50.0	47.07		ug/L		94	85 - 115

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals

Prep Batch: 453519

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-10	KE-KFC-173a-10	Total/NA	Water	200	
680-130863-11	KE-KFC-173a-11	Total/NA	Water	200	
680-130863-22	KE-IMC-179-22	Total/NA	Water	200	
680-130863-23	KE-CFC-181-23	Total/NA	Water	200	
680-130863-33	KE-WC-172-33	Total/NA	Water	200	
680-130863-34	KE-HWC-172-34	Total/NA	Water	200	
680-130863-35	KE-HWC-172-35	Total/NA	Water	200	
680-130863-54	KE-CFC-149-54	Total/NA	Water	200	
680-130863-73	KE-BFC-161b-73	Total/NA	Water	200	
680-130863-76	KE-BFC-161b-76	Total/NA	Water	200	
680-130863-77	KE-BFC-161b-77	Total/NA	Water	200	
680-130863-78	KW-WC-SCC-78	Total/NA	Water	200	
680-130863-87	KE-CFC-108a-87	Total/NA	Water	200	
680-130863-88	KE-CFC-108-88	Total/NA	Water	200	
680-130863-94	KE-BFC-220-95	Total/NA	Water	200	
680-130863-95	KE-BFC-220a-96	Total/NA	Water	200	
680-130863-97	KE-WC-SEC-98	Total/NA	Water	200	
680-130863-121	KE-CFC-253-122	Total/NA	Water	200	
680-130863-127	KE-CFC-257a-128	Total/NA	Water	200	
680-130863-129	KE-WC-SWC-130	Total/NA	Water	200	
MB 680-453519/1-A	Method Blank	Total/NA	Water	200	
LCS 680-453519/2-A	Lab Control Sample	Total/NA	Water	200	
680-130863-10 MS	KE-KFC-173a-10	Total/NA	Water	200	
680-130863-10 MSD	KE-KFC-173a-10	Total/NA	Water	200	
680-130863-88 MS	KE-CFC-108-88	Total/NA	Water	200	
680-130863-88 MSD	KE-CFC-108-88	Total/NA	Water	200	

Prep Batch: 453520

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-1	KE-KFC-173a-01	Total/NA	Water	200	
680-130863-6	KE-KCC-173a-06	Total/NA	Water	200	
680-130863-7	KE-KFC-173a-07	Total/NA	Water	200	
680-130863-16	KE-WC-171-16	Total/NA	Water	200	
680-130863-17	KE-WC-171-17	Total/NA	Water	200	
680-130863-37	KE-BFC-172e-37	Total/NA	Water	200	
680-130863-38	KE-WC-154-38	Total/NA	Water	200	
680-130863-55	KE-CFC-143a-55	Total/NA	Water	200	
680-130863-62	KE-BFC-136f-62	Total/NA	Water	200	
680-130863-63	KE-BFC-163a-63	Total/NA	Water	200	
680-130863-64	KE-CFC-163-64	Total/NA	Water	200	
680-130863-75	KE-BFC-161b-75	Total/NA	Water	200	
680-130863-101	KE-WC-223-102	Total/NA	Water	200	
680-130863-102	KE-BFC-223a-103	Total/NA	Water	200	
680-130863-103	KE-BFC-223a-104	Total/NA	Water	200	
680-130863-104	KE-BFC-223a-105	Total/NA	Water	200	
680-130863-105	KE-BFC-223b-106	Total/NA	Water	200	
680-130863-108	KE-CFC-241-109	Total/NA	Water	200	
680-130863-115	KE-CFC-251-116	Total/NA	Water	200	
680-130863-116	KE-CFC-251-117	Total/NA	Water	200	
MB 680-453520/1-A	Method Blank	Total/NA	Water	200	
LCS 680-453520/2-A	Lab Control Sample	Total/NA	Water	200	

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals (Continued)

Prep Batch: 453520 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-6 MS	KE-KCC-173a-06	Total/NA	Water	200	
680-130863-6 MSD	KE-KCC-173a-06	Total/NA	Water	200	
680-130863-16 MS	KE-WC-171-16	Total/NA	Water	200	
680-130863-16 MSD	KE-WC-171-16	Total/NA	Water	200	

Prep Batch: 453559

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-8	KE-KFC-173a-08	Total/NA	Water	200	
680-130863-9	KE-KFC-173a-09	Total/NA	Water	200	
680-130863-18	KE-WC-175-18	Total/NA	Water	200	
680-130863-19	KE-WC-175-19	Total/NA	Water	200	
680-130863-20	KE-CFC-177-20	Total/NA	Water	200	
680-130863-39	KE-HWC-154-39	Total/NA	Water	200	
680-130863-40	KE-HWC-154-40	Total/NA	Water	200	
680-130863-56	KE-WC-NEC-56	Total/NA	Water	200	
680-130863-58	KE-CFC-REC-58	Total/NA	Water	200	
680-130863-59	KE-BFC-136e-59	Total/NA	Water	200	
680-130863-65	KE-CFC-163-65	Total/NA	Water	200	
680-130863-66	KE-BFC-161a-66	Total/NA	Water	200	
680-130863-69	KE-BFC-161a-69	Total/NA	Water	200	
680-130863-86	KE-CFC-110-86	Total/NA	Water	200	
680-130863-90	KE-CFC-101-91	Total/NA	Water	200	
680-130863-99	KE-CFC-224-100	Total/NA	Water	200	
680-130863-100	KE-DW-234-101	Total/NA	Water	200	
680-130863-109	KE-CFC-241-110	Total/NA	Water	200	
680-130863-113	KE-CFC-251-114	Total/NA	Water	200	
680-130863-114	KE-CFC-251-115	Total/NA	Water	200	
MB 680-453559/1-A	Method Blank	Total/NA	Water	200	
LCS 680-453559/2-A	Lab Control Sample	Total/NA	Water	200	
680-130863-8 MS	KE-KFC-173a-08	Total/NA	Water	200	
680-130863-8 MSD	KE-KFC-173a-08	Total/NA	Water	200	
680-130863-18 MS	KE-WC-175-18	Total/NA	Water	200	
680-130863-18 MSD	KE-WC-175-18	Total/NA	Water	200	

Prep Batch: 453563

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-2	KE-KFC-173a-02	Total/NA	Water	200	
680-130863-3	KE-KFC-173a-03	Total/NA	Water	200	
680-130863-21	KE-IMC-177-21	Total/NA	Water	200	
680-130863-24	KE-CFC-181-24	Total/NA	Water	200	
680-130863-25	KE-DW-182-25	Total/NA	Water	200	
680-130863-41	KE-154-HWC-41	Total/NA	Water	200	
680-130863-42	KE-154e-DW-42	Total/NA	Water	200	
680-130863-45	KE-154b-HWC-45	Total/NA	Water	200	
680-130863-57	KE-WC-SPR-57	Total/NA	Water	200	
680-130863-60	KE-BFC-136e-60	Total/NA	Water	200	
680-130863-67	KE-BFC-161a-67	Total/NA	Water	200	
680-130863-68	KE-BFC-161a-68	Total/NA	Water	200	
680-130863-70	KE-BFC-161a-70	Total/NA	Water	200	
680-130863-71	KE-BFC-161a-71	Total/NA	Water	200	
680-130863-91	KE-BFC-102a-92	Total/NA	Water	200	

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals (Continued)

Prep Batch: 453563 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-106	KE-BFC-223b-107	Total/NA	Water	200	
680-130863-110	KE-CFC-243-111	Total/NA	Water	200	
680-130863-111	KE-CFC-243-112	Total/NA	Water	200	
680-130863-123	KE-CFC-253-124	Total/NA	Water	200	
680-130863-124	KE-CFC-255-125	Total/NA	Water	200	
MB 680-453563/1-A	Method Blank	Total/NA	Water	200	
LCS 680-453563/2-A	Lab Control Sample	Total/NA	Water	200	
680-130863-2 MS	KE-KFC-173a-02	Total/NA	Water	200	
680-130863-2 MSD	KE-KFC-173a-02	Total/NA	Water	200	
680-130863-24 MS	KE-CFC-181-24	Total/NA	Water	200	
680-130863-24 MSD	KE-CFC-181-24	Total/NA	Water	200	

Prep Batch: 453564

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-4	KE-KFC-173a-04	Total/NA	Water	200	
680-130863-5	KE-KFC-173a-05	Total/NA	Water	200	
680-130863-26	KE-BFC-182-26	Total/NA	Water	200	
680-130863-27	KE-WC-172a-27	Total/NA	Water	200	
680-130863-43	KE-154f-BFC-43	Total/NA	Water	200	
680-130863-44	KE-154b-WC-44	Total/NA	Water	200	
680-130863-50	KE-CFL-157-50	Total/NA	Water	200	
680-130863-52	KE-CFC-151-52	Total/NA	Water	200	
680-130863-53	KE-CFC-151-53	Total/NA	Water	200	
680-130863-61	KE-BFC-136f-61	Total/NA	Water	200	
680-130863-72	KE-BFC-161b-72	Total/NA	Water	200	
680-130863-74	KE-BFC-161b-74	Total/NA	Water	200	
680-130863-85	KE-WC-SEC-85	Total/NA	Water	200	
680-130863-92	KE-BFC-102-93	Total/NA	Water	200	
680-130863-93	KE-CFC-100-94	Total/NA	Water	200	
680-130863-107	KE-CFC-235-108	Total/NA	Water	200	
680-130863-112	KE-WC-NEC-113	Total/NA	Water	200	
680-130863-120	KE-CFC-253-121	Total/NA	Water	200	
680-130863-122	KE-CFC-253-123	Total/NA	Water	200	
680-130863-125	KE-CFC-256-126	Total/NA	Water	200	
MB 680-453564/1-A	Method Blank	Total/NA	Water	200	
LCS 680-453564/2-A	Lab Control Sample	Total/NA	Water	200	
680-130863-4 MS	KE-KFC-173a-04	Total/NA	Water	200	
680-130863-4 MSD	KE-KFC-173a-04	Total/NA	Water	200	
680-130863-26 MS	KE-BFC-182-26	Total/NA	Water	200	
680-130863-26 MSD	KE-BFC-182-26	Total/NA	Water	200	

Prep Batch: 453566

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-12	KE-KFC-173a-12	Total/NA	Water	200	
680-130863-13	KE-KFC-173a-13	Total/NA	Water	200	
680-130863-15	KE-CFC-171a-15	Total/NA	Water	200	
680-130863-28	KE-HWC-172a-28	Total/NA	Water	200	
680-130863-31	KE-BFC-172b-31	Total/NA	Water	200	
680-130863-32	KE-DW-172c-32	Total/NA	Water	200	
680-130863-36	KE-HWC-172-36	Total/NA	Water	200	
680-130863-46	KE-154b-HWC-46	Total/NA	Water	200	

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals (Continued)

Prep Batch: 453566 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-47	KE-154b-HWC-47	Total/NA	Water	200	
680-130863-48	KE-WC-NWC-48	Total/NA	Water	200	
680-130863-79	KW-WC-SCC-79	Total/NA	Water	200	
680-130863-80	KE-BFC-120a-80	Total/NA	Water	200	
680-130863-82	KE-BFC-121b-82	Total/NA	Water	200	
680-130863-84	KE-BFC-113a-84	Total/NA	Water	200	
680-130863-89	KE-WC-SEC-89	Total/NA	Water	200	
680-130863-96	KE-WC-SEC-97	Total/NA	Water	200	
680-130863-98	KE-CFC-219-99	Total/NA	Water	200	
680-130863-118	KE-WC-NWC-119	Total/NA	Water	200	
680-130863-119	KE-CFC-253-120	Total/NA	Water	200	
680-130863-126	KE-CFC-257-127	Total/NA	Water	200	
MB 680-453566/1-A	Method Blank	Total/NA	Water	200	
LCS 680-453566/2-A	Lab Control Sample	Total/NA	Water	200	
680-130863-12 MS	KE-KFC-173a-12	Total/NA	Water	200	
680-130863-12 MSD	KE-KFC-173a-12	Total/NA	Water	200	
680-130863-96 MS	KE-WC-SEC-97	Total/NA	Water	200	
680-130863-96 MSD	KE-WC-SEC-97	Total/NA	Water	200	

Prep Batch: 453570

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-14	KE-BFC-173b-14	Total/NA	Water	200	
680-130863-29	KE-HWC-172a-29	Total/NA	Water	200	
680-130863-30	KE-HWC-172a-30	Total/NA	Water	200	
680-130863-49	KE-WC-NWC-49	Total/NA	Water	200	
680-130863-51	KE-CFC-157-51	Total/NA	Water	200	
680-130863-81	KE-CFC-121a-81	Total/NA	Water	200	
680-130863-83	KE-CFC-115-83	Total/NA	Water	200	
680-130863-117	KE-CFC-251a-118	Total/NA	Water	200	
680-130863-128	KE-CFC-257a-129	Total/NA	Water	200	
MB 680-453570/1-A	Method Blank	Total/NA	Water	200	
LCS 680-453570/2-A	Lab Control Sample	Total/NA	Water	200	

Analysis Batch: 453850

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-12	KE-KFC-173a-12	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-13	KE-KFC-173a-13	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-14	KE-BFC-173b-14	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-15	KE-CFC-171a-15	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-28	KE-HWC-172a-28	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-29	KE-HWC-172a-29	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-30	KE-HWC-172a-30	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-31	KE-BFC-172b-31	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-32	KE-DW-172c-32	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-36	KE-HWC-172-36	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-46	KE-154b-HWC-46	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-47	KE-154b-HWC-47	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-48	KE-WC-NWC-48	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-49	KE-WC-NWC-49	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-51	KE-CFC-157-51	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-79	KW-WC-SCC-79	Total/NA	Water	200.8-1994 R5.4	453566

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals (Continued)

Analysis Batch: 453850 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-80	KE-BFC-120a-80	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-81	KE-CFC-121a-81	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-82	KE-BFC-121b-82	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-83	KE-CFC-115-83	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-84	KE-BFC-113a-84	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-89	KE-WC-SEC-89	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-96	KE-WC-SEC-97	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-98	KE-CFC-219-99	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-117	KE-CFC-251a-118	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-118	KE-WC-NWC-119	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-119	KE-CFC-253-120	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-126	KE-CFC-257-127	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-128	KE-CFC-257a-129	Total/NA	Water	200.8-1994 R5.4	453570
MB 680-453566/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	453566
MB 680-453570/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	453570
LCS 680-453566/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	453566
LCS 680-453570/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	453570
680-130863-12 MS	KE-KFC-173a-12	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-12 MSD	KE-KFC-173a-12	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-96 MS	KE-WC-SEC-97	Total/NA	Water	200.8-1994 R5.4	453566
680-130863-96 MSD	KE-WC-SEC-97	Total/NA	Water	200.8-1994 R5.4	453566

Analysis Batch: 454015

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-1	KE-KFC-173a-01	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-2	KE-KFC-173a-02	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-3	KE-KFC-173a-03	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-6	KE-KCC-173a-06	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-7	KE-KFC-173a-07	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-8	KE-KFC-173a-08	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-9	KE-KFC-173a-09	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-16	KE-WC-171-16	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-17	KE-WC-171-17	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-18	KE-WC-175-18	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-19	KE-WC-175-19	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-20	KE-CFC-177-20	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-21	KE-IMC-177-21	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-24	KE-CFC-181-24	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-25	KE-DW-182-25	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-37	KE-BFC-172e-37	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-38	KE-WC-154-38	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-39	KE-HWC-154-39	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-40	KE-HWC-154-40	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-41	KE-154-HWC-41	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-42	KE-154e-DW-42	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-45	KE-154b-HWC-45	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-55	KE-CFC-143a-55	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-56	KE-WC-NEC-56	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-57	KE-WC-SPR-57	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-58	KE-CFC-REC-58	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-59	KE-BFC-136e-59	Total/NA	Water	200.8-1994 R5.4	453559

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals (Continued)

Analysis Batch: 454015 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-60	KE-BFC-136e-60	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-62	KE-BFC-136f-62	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-63	KE-BFC-163a-63	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-64	KE-CFC-163-64	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-65	KE-CFC-163-65	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-66	KE-BFC-161a-66	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-67	KE-BFC-161a-67	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-68	KE-BFC-161a-68	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-70	KE-BFC-161a-70	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-71	KE-BFC-161a-71	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-75	KE-BFC-161b-75	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-86	KE-CFC-110-86	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-91	KE-BFC-102a-92	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-99	KE-CFC-224-100	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-100	KE-DW-234-101	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-101	KE-WC-223-102	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-102	KE-BFC-223a-103	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-103	KE-BFC-223a-104	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-104	KE-BFC-223a-105	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-105	KE-BFC-223b-106	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-106	KE-BFC-223b-107	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-108	KE-CFC-241-109	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-110	KE-CFC-243-111	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-111	KE-CFC-243-112	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-113	KE-CFC-251-114	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-114	KE-CFC-251-115	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-115	KE-CFC-251-116	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-116	KE-CFC-251-117	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-123	KE-CFC-253-124	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-124	KE-CFC-255-125	Total/NA	Water	200.8-1994 R5.4	453563
MB 680-453520/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	453520
MB 680-453559/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	453559
MB 680-453563/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	453563
LCS 680-453520/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	453520
LCS 680-453559/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	453559
LCS 680-453563/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-2 MS	KE-KFC-173a-02	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-2 MSD	KE-KFC-173a-02	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-6 MS	KE-KCC-173a-06	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-6 MSD	KE-KCC-173a-06	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-8 MS	KE-KFC-173a-08	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-8 MSD	KE-KFC-173a-08	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-16 MS	KE-WC-171-16	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-16 MSD	KE-WC-171-16	Total/NA	Water	200.8-1994 R5.4	453520
680-130863-18 MS	KE-WC-175-18	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-18 MSD	KE-WC-175-18	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-24 MS	KE-CFC-181-24	Total/NA	Water	200.8-1994 R5.4	453563
680-130863-24 MSD	KE-CFC-181-24	Total/NA	Water	200.8-1994 R5.4	453563

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals (Continued)

Analysis Batch: 454233

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-4	KE-KFC-173a-04	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-5	KE-KFC-173a-05	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-26	KE-BFC-182-26	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-27	KE-WC-172a-27	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-43	KE-154f-BFC-43	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-44	KE-154b-WC-44	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-50	KE-CFL-157-50	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-52	KE-CFC-151-52	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-53	KE-CFC-151-53	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-61	KE-BFC-136f-61	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-69	KE-BFC-161a-69	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-72	KE-BFC-161b-72	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-74	KE-BFC-161b-74	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-85	KE-WC-SEC-85	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-90	KE-CFC-101-91	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-92	KE-BFC-102-93	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-93	KE-CFC-100-94	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-107	KE-CFC-235-108	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-109	KE-CFC-241-110	Total/NA	Water	200.8-1994 R5.4	453559
680-130863-112	KE-WC-NEC-113	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-120	KE-CFC-253-121	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-122	KE-CFC-253-123	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-125	KE-CFC-256-126	Total/NA	Water	200.8-1994 R5.4	453564
MB 680-453564/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	453564
LCS 680-453564/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-4 MS	KE-KFC-173a-04	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-4 MSD	KE-KFC-173a-04	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-26 MS	KE-BFC-182-26	Total/NA	Water	200.8-1994 R5.4	453564
680-130863-26 MSD	KE-BFC-182-26	Total/NA	Water	200.8-1994 R5.4	453564

Analysis Batch: 455281

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-10	KE-KFC-173a-10	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-11	KE-KFC-173a-11	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-22	KE-IMC-179-22	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-23	KE-CFC-181-23	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-33	KE-WC-172-33	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-34	KE-HWC-172-34	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-35	KE-HWC-172-35	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-54	KE-CFC-149-54	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-73	KE-BFC-161b-73	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-76	KE-BFC-161b-76	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-77	KE-BFC-161b-77	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-78	KW-WC-SCC-78	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-87	KE-CFC-108a-87	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-88	KE-CFC-108-88	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-94	KE-BFC-220-95	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-95	KE-BFC-220a-96	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-97	KE-WC-SEC-98	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-121	KE-CFC-253-122	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-127	KE-CFC-257a-128	Total/NA	Water	200.8-1994 R5.4	453519

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Metals (Continued)

Analysis Batch: 455281 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-130863-129	KE-WC-SWC-130	Total/NA	Water	200.8-1994 R5.4	453519
MB 680-453519/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	453519
LCS 680-453519/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-10 MS	KE-KFC-173a-10	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-10 MSD	KE-KFC-173a-10	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-88 MS	KE-CFC-108-88	Total/NA	Water	200.8-1994 R5.4	453519
680-130863-88 MSD	KE-CFC-108-88	Total/NA	Water	200.8-1994 R5.4	453519

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-KFC-173a-01

Date Collected: 10/07/16 03:15

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 00:02	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-02

Date Collected: 10/07/16 03:15

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 00:31	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-03

Date Collected: 10/07/16 03:16

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:56	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-04

Date Collected: 10/07/16 03:16

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 13:31	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-05

Date Collected: 10/07/16 03:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:55	BWR	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-KCC-173a-06

Date Collected: 10/07/16 03:18

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-6

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 21:45	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-07

Date Collected: 10/07/16 03:19

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-7

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:05	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-08

Date Collected: 10/07/16 03:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-8

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 03:17	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-09

Date Collected: 10/07/16 03:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-9

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:42	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-10

Date Collected: 10/07/16 03:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-10

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 12:41	BJB	TAL SAV
Instrument ID: ICPMSD										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-KFC-173a-11

Date Collected: 10/07/16 03:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-11

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:07	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-KFC-173a-12

Date Collected: 10/07/16 03:22

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-12

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 04:15	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-KFC-173a-13

Date Collected: 10/07/16 03:23

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-13

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:54	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-173b-14

Date Collected: 10/07/16 03:26

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-14

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:04	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-171a-15

Date Collected: 10/07/16 03:30

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-15

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:26	BWR	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-WC-171-16

Date Collected: 10/07/16 03:32

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-16

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 22:09	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-171-17

Date Collected: 10/07/16 03:32

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-17

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:10	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-175-18

Date Collected: 10/07/16 03:35

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-18

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 03:40	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-175-19

Date Collected: 10/07/16 03:35

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-19

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:56	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-177-20

Date Collected: 10/07/16 03:38

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-20

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 05:34	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-IMC-177-21

Date Collected: 10/07/16 03:39

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-21

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:51	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-IMC-179-22

Date Collected: 10/07/16 03:43

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-22

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:14	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-CFC-181-23

Date Collected: 10/07/16 03:45

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-23

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:20	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-CFC-181-24

Date Collected: 10/07/16 03:45

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-24

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 00:54	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-DW-182-25

Date Collected: 10/07/16 03:48

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-25

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:10	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-182-26

Date Collected: 10/07/16 03:49

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-26

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 13:54	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-172a-27

Date Collected: 10/07/16 03:57

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-27

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:09	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-HWC-172a-28

Date Collected: 10/07/16 03:59

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-28

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 06:04	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-HWC-172a-29

Date Collected: 10/07/16 03:59

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-29

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:13	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-HWC-172a-30

Date Collected: 10/07/16 03:59

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-30

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:08	BWR	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-172b-31

Lab Sample ID: 680-130863-31

Date Collected: 10/07/16 04:01

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:02	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-DW-172c-32

Lab Sample ID: 680-130863-32

Date Collected: 10/07/16 04:02

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:59	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-172-33

Lab Sample ID: 680-130863-33

Date Collected: 10/07/16 04:05

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:31	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-HWC-172-34

Lab Sample ID: 680-130863-34

Date Collected: 10/07/16 04:06

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:12	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-HWC-172-35

Lab Sample ID: 680-130863-35

Date Collected: 10/07/16 04:06

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:17	BJB	TAL SAV
Instrument ID: ICPMSD										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-HWC-172-36

Date Collected: 10/07/16 04:06

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-36

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:12	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-172e-37

Date Collected: 10/07/16 04:09

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-37

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 22:32	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-154-38

Date Collected: 10/07/16 04:18

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-38

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:24	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-HWC-154-39

Date Collected: 10/07/16 04:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-39

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:04	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-HWC-154-40

Date Collected: 10/07/16 04:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-40

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 05:01	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-154-HWC-41

Date Collected: 10/07/16 04:20

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-41

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:18	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-154e-DW-42

Date Collected: 10/07/16 04:22

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-42

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:15	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-154f-BFC-43

Date Collected: 10/07/16 04:22

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-43

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:18	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-154b-WC-44

Date Collected: 10/07/16 04:26

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-44

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:14	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-154b-HWC-45

Date Collected: 10/07/16 04:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-45

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:48	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-154b-HWC-46

Lab Sample ID: 680-130863-46

Date Collected: 10/07/16 04:28

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:16	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-154b-HWC-47

Lab Sample ID: 680-130863-47

Date Collected: 10/07/16 04:28

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 06:08	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-NWC-48

Lab Sample ID: 680-130863-48

Date Collected: 10/07/16 04:31

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:30	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-NWC-49

Lab Sample ID: 680-130863-49

Date Collected: 10/07/16 04:33

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:18	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFL-157-50

Lab Sample ID: 680-130863-50

Date Collected: 10/07/16 04:35

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:22	BWR	TAL SAV
Instrument ID: ICPMSB										

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-157-51

Date Collected: 10/07/16 04:35

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-51

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:46	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-151-52

Date Collected: 10/07/16 04:40

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-52

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:18	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-151-53

Date Collected: 10/07/16 04:40

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-53

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:50	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-149-54

Date Collected: 10/07/16 04:43

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-54

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:25	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-CFC-143a-55

Date Collected: 10/07/16 04:49

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-55

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 22:37	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-WC-NEC-56

Date Collected: 10/07/16 04:52

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-56

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 05:15	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-SPR-57

Date Collected: 10/07/16 04:55

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-57

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:27	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-REC-58

Date Collected: 10/07/16 04:57

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-58

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:18	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-136e-59

Date Collected: 10/07/16 05:00

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-59

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:14	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-136e-60

Date Collected: 10/07/16 05:00

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-60

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:24	BJB	TAL SAV
Instrument ID: ICPMSB										

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-136f-61

Date Collected: 10/07/16 05:02

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-61

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:27	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-136f-62

Date Collected: 10/07/16 05:02

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-62

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:29	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-163a-63

Date Collected: 10/07/16 05:07

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-63

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:34	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-163-64

Date Collected: 10/07/16 05:11

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-64

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 22:42	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-163-65

Date Collected: 10/07/16 05:11

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-65

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:09	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-161a-66

Lab Sample ID: 680-130863-66

Date Collected: 10/07/16 05:17

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 05:06	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-161a-67

Lab Sample ID: 680-130863-67

Date Collected: 10/07/16 05:17

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:20	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-161a-68

Lab Sample ID: 680-130863-68

Date Collected: 10/07/16 05:17

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:23	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-161a-69

Lab Sample ID: 680-130863-69

Date Collected: 10/07/16 05:17

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 16:01	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-161a-70

Lab Sample ID: 680-130863-70

Date Collected: 10/07/16 05:17

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:32	BJB	TAL SAV
Instrument ID: ICPMSB										

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-161a-71

Date Collected: 10/07/16 05:17

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-71

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:29	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-161b-72

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-72

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:32	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-161b-73

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-73

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:39	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-BFC-161b-74

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-74

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:28	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-161b-75

Date Collected: 10/07/16 05:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-75

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:57	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-161b-76

Lab Sample ID: 680-130863-76

Date Collected: 10/07/16 05:21

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:49	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-BFC-161b-77

Lab Sample ID: 680-130863-77

Date Collected: 10/07/16 05:21

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:46	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KW-WC-SCC-78

Lab Sample ID: 680-130863-78

Date Collected: 10/07/16 05:24

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:44	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KW-WC-SCC-79

Lab Sample ID: 680-130863-79

Date Collected: 10/07/16 05:24

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:21	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-120a-80

Lab Sample ID: 680-130863-80

Date Collected: 10/07/16 05:27

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 06:18	BWR	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-121a-81

Lab Sample ID: 680-130863-81

Date Collected: 10/07/16 05:30

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:37	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-121b-82

Lab Sample ID: 680-130863-82

Date Collected: 10/07/16 05:30

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 06:13	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-115-83

Lab Sample ID: 680-130863-83

Date Collected: 10/07/16 05:37

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:32	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-113a-84

Lab Sample ID: 680-130863-84

Date Collected: 10/07/16 05:39

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:07	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-SEC-85

Lab Sample ID: 680-130863-85

Date Collected: 10/07/16 05:41

Matrix: Water

Date Received: 10/14/16 09:40

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:23	BWR	TAL SAV
Instrument ID: ICPMSB										

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-110-86

Date Collected: 10/07/16 05:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-86

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:37	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-108a-87

Date Collected: 10/07/16 05:45

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-87

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:22	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-CFC-108-88

Date Collected: 10/07/16 05:46

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-88

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 12:54	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-WC-SEC-89

Date Collected: 10/07/16 05:47

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-89

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:40	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-101-91

Date Collected: 10/07/16 05:52

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-90

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 16:05	BWR	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-102a-92

Date Collected: 10/07/16 05:55

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-91

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:42	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-102-93

Date Collected: 10/07/16 05:57

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-92

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:37	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-100-94

Date Collected: 10/07/16 06:01

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-93

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:47	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-220-95

Date Collected: 10/07/16 06:08

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-94

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 14:00	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-BFC-220a-96

Date Collected: 10/07/16 06:09

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-95

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:41	BJB	TAL SAV
Instrument ID: ICPMSD										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-WC-SEC-97

Date Collected: 10/07/16 06:11

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-96

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 04:38	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-SEC-98

Date Collected: 10/07/16 06:12

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-97

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:52	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-CFC-219-99

Date Collected: 10/07/16 06:16

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-98

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 06:23	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-224-100

Date Collected: 10/07/16 06:19

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-99

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:33	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-DW-234-101

Date Collected: 10/07/16 06:21

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-100

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:28	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-WC-223-102

Date Collected: 10/07/16 06:25

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-101

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 22:56	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-223a-103

Date Collected: 10/07/16 06:27

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-102

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 22:51	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-223a-104

Date Collected: 10/07/16 06:27

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-103

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 22:46	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-223a-105

Date Collected: 10/07/16 06:27

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-104

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:38	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-BFC-223b-106

Date Collected: 10/07/16 06:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-105

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:43	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-BFC-223b-107

Date Collected: 10/07/16 06:28

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-106

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:34	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-235-108

Date Collected: 10/07/16 06:30

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-107

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:36	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-241-109

Date Collected: 10/07/16 06:34

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-108

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:48	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-241-110

Date Collected: 10/07/16 06:34

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-109

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 16:10	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-243-111

Date Collected: 10/07/16 06:37

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-110

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:44	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-243-112

Date Collected: 10/07/16 06:37

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-111

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 02:39	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-NEC-113

Date Collected: 10/07/16 06:39

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-112

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:32	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-251-114

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-113

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 05:11	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-251-115

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-114

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453559	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 04:23	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-251-116

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-115

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:53	BJB	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-251-117

Date Collected: 10/07/16 06:44

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-116

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453520	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/19/16 23:01	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-251a-118

Date Collected: 10/07/16 06:46

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-117

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 02:59	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-NWC-119

Date Collected: 10/07/16 06:47

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-118

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 06:32	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-253-120

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-119

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 05:35	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-253-121

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-120

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:46	BWR	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-253-122

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-121

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:54	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-CFC-253-123

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-122

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 15:42	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-253-124

Date Collected: 10/07/16 06:50

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-123

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:46	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-255-125

Date Collected: 10/07/16 06:51

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-124

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453563	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454015	10/20/16 01:37	BJB	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-256-126

Date Collected: 10/07/16 06:51

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-125

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453564	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			454233	10/20/16 14:41	BWR	TAL SAV
Instrument ID: ICPMSB										

TestAmerica Savannah

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Client Sample ID: KE-CFC-257-127

Date Collected: 10/07/16 06:55

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-126

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453566	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 06:27	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-CFC-257a-128

Date Collected: 10/07/16 06:56

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-127

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:57	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-CFC-257a-129

Date Collected: 10/07/16 06:56

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-128

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453570	10/17/16 13:25	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			453850	10/19/16 03:42	BWR	TAL SAV
Instrument ID: ICPMSB										

Client Sample ID: KE-WC-SWC-130

Date Collected: 10/07/16 06:58

Date Received: 10/14/16 09:40

Lab Sample ID: 680-130863-129

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	453519	10/17/16 11:18	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455281	10/27/16 13:09	BJB	TAL SAV
Instrument ID: ICPMSD										

Laboratory References:

TAL SAV = TestAmerica Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

Certification Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Laboratory: TestAmerica Savannah

The certifications listed below are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
New York	NELAP	2	10842	03-31-17

Laboratory: TestAmerica Buffalo

The certifications listed below are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
New York	NELAP	2	10026	03-31-17

Method Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Method	Method Description	Protocol	Laboratory
200.8-1994 R5.4	Metals (ICP/MS)	EPA	TAL SAV

Protocol References:

EPA = US Environmental Protection Agency

Laboratory References:

TAL SAV = TestAmerica Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

Sample Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-130863-1	KE-KFC-173a-01	Water	10/07/16 03:15	10/14/16 09:40
680-130863-2	KE-KFC-173a-02	Water	10/07/16 03:15	10/14/16 09:40
680-130863-3	KE-KFC-173a-03	Water	10/07/16 03:16	10/14/16 09:40
680-130863-4	KE-KFC-173a-04	Water	10/07/16 03:16	10/14/16 09:40
680-130863-5	KE-KFC-173a-05	Water	10/07/16 03:17	10/14/16 09:40
680-130863-6	KE-KCC-173a-06	Water	10/07/16 03:18	10/14/16 09:40
680-130863-7	KE-KFC-173a-07	Water	10/07/16 03:19	10/14/16 09:40
680-130863-8	KE-KFC-173a-08	Water	10/07/16 03:20	10/14/16 09:40
680-130863-9	KE-KFC-173a-09	Water	10/07/16 03:20	10/14/16 09:40
680-130863-10	KE-KFC-173a-10	Water	10/07/16 03:21	10/14/16 09:40
680-130863-11	KE-KFC-173a-11	Water	10/07/16 03:21	10/14/16 09:40
680-130863-12	KE-KFC-173a-12	Water	10/07/16 03:22	10/14/16 09:40
680-130863-13	KE-KFC-173a-13	Water	10/07/16 03:23	10/14/16 09:40
680-130863-14	KE-BFC-173b-14	Water	10/07/16 03:26	10/14/16 09:40
680-130863-15	KE-CFC-171a-15	Water	10/07/16 03:30	10/14/16 09:40
680-130863-16	KE-WC-171-16	Water	10/07/16 03:32	10/14/16 09:40
680-130863-17	KE-WC-171-17	Water	10/07/16 03:32	10/14/16 09:40
680-130863-18	KE-WC-175-18	Water	10/07/16 03:35	10/14/16 09:40
680-130863-19	KE-WC-175-19	Water	10/07/16 03:35	10/14/16 09:40
680-130863-20	KE-CFC-177-20	Water	10/07/16 03:38	10/14/16 09:40
680-130863-21	KE-IMC-177-21	Water	10/07/16 03:39	10/14/16 09:40
680-130863-22	KE-IMC-179-22	Water	10/07/16 03:43	10/14/16 09:40
680-130863-23	KE-CFC-181-23	Water	10/07/16 03:45	10/14/16 09:40
680-130863-24	KE-CFC-181-24	Water	10/07/16 03:45	10/14/16 09:40
680-130863-25	KE-DW-182-25	Water	10/07/16 03:48	10/14/16 09:40
680-130863-26	KE-BFC-182-26	Water	10/07/16 03:49	10/14/16 09:40
680-130863-27	KE-WC-172a-27	Water	10/07/16 03:57	10/14/16 09:40
680-130863-28	KE-HWC-172a-28	Water	10/07/16 03:59	10/14/16 09:40
680-130863-29	KE-HWC-172a-29	Water	10/07/16 03:59	10/14/16 09:40
680-130863-30	KE-HWC-172a-30	Water	10/07/16 03:59	10/14/16 09:40
680-130863-31	KE-BFC-172b-31	Water	10/07/16 04:01	10/14/16 09:40
680-130863-32	KE-DW-172c-32	Water	10/07/16 04:02	10/14/16 09:40
680-130863-33	KE-WC-172-33	Water	10/07/16 04:05	10/14/16 09:40
680-130863-34	KE-HWC-172-34	Water	10/07/16 04:06	10/14/16 09:40
680-130863-35	KE-HWC-172-35	Water	10/07/16 04:06	10/14/16 09:40
680-130863-36	KE-HWC-172-36	Water	10/07/16 04:06	10/14/16 09:40
680-130863-37	KE-BFC-172e-37	Water	10/07/16 04:09	10/14/16 09:40
680-130863-38	KE-WC-154-38	Water	10/07/16 04:18	10/14/16 09:40
680-130863-39	KE-HWC-154-39	Water	10/07/16 04:20	10/14/16 09:40
680-130863-40	KE-HWC-154-40	Water	10/07/16 04:20	10/14/16 09:40
680-130863-41	KE-154-HWC-41	Water	10/07/16 04:20	10/14/16 09:40
680-130863-42	KE-154e-DW-42	Water	10/07/16 04:22	10/14/16 09:40
680-130863-43	KE-154f-BFC-43	Water	10/07/16 04:22	10/14/16 09:40
680-130863-44	KE-154b-WC-44	Water	10/07/16 04:26	10/14/16 09:40
680-130863-45	KE-154b-HWC-45	Water	10/07/16 04:28	10/14/16 09:40
680-130863-46	KE-154b-HWC-46	Water	10/07/16 04:28	10/14/16 09:40
680-130863-47	KE-154b-HWC-47	Water	10/07/16 04:28	10/14/16 09:40
680-130863-48	KE-WC-NWC-48	Water	10/07/16 04:31	10/14/16 09:40
680-130863-49	KE-WC-NWC-49	Water	10/07/16 04:33	10/14/16 09:40
680-130863-50	KE-CFL-157-50	Water	10/07/16 04:35	10/14/16 09:40
680-130863-51	KE-CFC-157-51	Water	10/07/16 04:35	10/14/16 09:40
680-130863-52	KE-CFC-151-52	Water	10/07/16 04:40	10/14/16 09:40
680-130863-53	KE-CFC-151-53	Water	10/07/16 04:40	10/14/16 09:40

TestAmerica Savannah

Sample Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-130863-54	KE-CFC-149-54	Water	10/07/16 04:43	10/14/16 09:40
680-130863-55	KE-CFC-143a-55	Water	10/07/16 04:49	10/14/16 09:40
680-130863-56	KE-WC-NEC-56	Water	10/07/16 04:52	10/14/16 09:40
680-130863-57	KE-WC-SPR-57	Water	10/07/16 04:55	10/14/16 09:40
680-130863-58	KE-CFC-REC-58	Water	10/07/16 04:57	10/14/16 09:40
680-130863-59	KE-BFC-136e-59	Water	10/07/16 05:00	10/14/16 09:40
680-130863-60	KE-BFC-136e-60	Water	10/07/16 05:00	10/14/16 09:40
680-130863-61	KE-BFC-136f-61	Water	10/07/16 05:02	10/14/16 09:40
680-130863-62	KE-BFC-136f-62	Water	10/07/16 05:02	10/14/16 09:40
680-130863-63	KE-BFC-163a-63	Water	10/07/16 05:07	10/14/16 09:40
680-130863-64	KE-CFC-163-64	Water	10/07/16 05:11	10/14/16 09:40
680-130863-65	KE-CFC-163-65	Water	10/07/16 05:11	10/14/16 09:40
680-130863-66	KE-BFC-161a-66	Water	10/07/16 05:17	10/14/16 09:40
680-130863-67	KE-BFC-161a-67	Water	10/07/16 05:17	10/14/16 09:40
680-130863-68	KE-BFC-161a-68	Water	10/07/16 05:17	10/14/16 09:40
680-130863-69	KE-BFC-161a-69	Water	10/07/16 05:17	10/14/16 09:40
680-130863-70	KE-BFC-161a-70	Water	10/07/16 05:17	10/14/16 09:40
680-130863-71	KE-BFC-161a-71	Water	10/07/16 05:17	10/14/16 09:40
680-130863-72	KE-BFC-161b-72	Water	10/07/16 05:21	10/14/16 09:40
680-130863-73	KE-BFC-161b-73	Water	10/07/16 05:21	10/14/16 09:40
680-130863-74	KE-BFC-161b-74	Water	10/07/16 05:21	10/14/16 09:40
680-130863-75	KE-BFC-161b-75	Water	10/07/16 05:21	10/14/16 09:40
680-130863-76	KE-BFC-161b-76	Water	10/07/16 05:21	10/14/16 09:40
680-130863-77	KE-BFC-161b-77	Water	10/07/16 05:21	10/14/16 09:40
680-130863-78	KW-WC-SCC-78	Water	10/07/16 05:24	10/14/16 09:40
680-130863-79	KW-WC-SCC-79	Water	10/07/16 05:24	10/14/16 09:40
680-130863-80	KE-BFC-120a-80	Water	10/07/16 05:27	10/14/16 09:40
680-130863-81	KE-CFC-121a-81	Water	10/07/16 05:30	10/14/16 09:40
680-130863-82	KE-BFC-121b-82	Water	10/07/16 05:30	10/14/16 09:40
680-130863-83	KE-CFC-115-83	Water	10/07/16 05:37	10/14/16 09:40
680-130863-84	KE-BFC-113a-84	Water	10/07/16 05:39	10/14/16 09:40
680-130863-85	KE-WC-SEC-85	Water	10/07/16 05:41	10/14/16 09:40
680-130863-86	KE-CFC-110-86	Water	10/07/16 05:44	10/14/16 09:40
680-130863-87	KE-CFC-108a-87	Water	10/07/16 05:45	10/14/16 09:40
680-130863-88	KE-CFC-108-88	Water	10/07/16 05:46	10/14/16 09:40
680-130863-89	KE-WC-SEC-89	Water	10/07/16 05:47	10/14/16 09:40
680-130863-90	KE-CFC-101-91	Water	10/07/16 05:52	10/14/16 09:40
680-130863-91	KE-BFC-102a-92	Water	10/07/16 05:55	10/14/16 09:40
680-130863-92	KE-BFC-102-93	Water	10/07/16 05:57	10/14/16 09:40
680-130863-93	KE-CFC-100-94	Water	10/07/16 06:01	10/14/16 09:40
680-130863-94	KE-BFC-220-95	Water	10/07/16 06:08	10/14/16 09:40
680-130863-95	KE-BFC-220a-96	Water	10/07/16 06:09	10/14/16 09:40
680-130863-96	KE-WC-SEC-97	Water	10/07/16 06:11	10/14/16 09:40
680-130863-97	KE-WC-SEC-98	Water	10/07/16 06:12	10/14/16 09:40
680-130863-98	KE-CFC-219-99	Water	10/07/16 06:16	10/14/16 09:40
680-130863-99	KE-CFC-224-100	Water	10/07/16 06:19	10/14/16 09:40
680-130863-100	KE-DW-234-101	Water	10/07/16 06:21	10/14/16 09:40
680-130863-101	KE-WC-223-102	Water	10/07/16 06:25	10/14/16 09:40
680-130863-102	KE-BFC-223a-103	Water	10/07/16 06:27	10/14/16 09:40
680-130863-103	KE-BFC-223a-104	Water	10/07/16 06:27	10/14/16 09:40
680-130863-104	KE-BFC-223a-105	Water	10/07/16 06:27	10/14/16 09:40
680-130863-105	KE-BFC-223b-106	Water	10/07/16 06:28	10/14/16 09:40
680-130863-106	KE-BFC-223b-107	Water	10/07/16 06:28	10/14/16 09:40

TestAmerica Savannah

Sample Summary

Client: Sienna Environmental Technologies LLC
Project/Site: KenTon CSD - Kenmore East High School

TestAmerica Job ID: 680-130863-1
SDG: SET 2845H

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-130863-107	KE-CFC-235-108	Water	10/07/16 06:30	10/14/16 09:40
680-130863-108	KE-CFC-241-109	Water	10/07/16 06:34	10/14/16 09:40
680-130863-109	KE-CFC-241-110	Water	10/07/16 06:34	10/14/16 09:40
680-130863-110	KE-CFC-243-111	Water	10/07/16 06:37	10/14/16 09:40
680-130863-111	KE-CFC-243-112	Water	10/07/16 06:37	10/14/16 09:40
680-130863-112	KE-WC-NEC-113	Water	10/07/16 06:39	10/14/16 09:40
680-130863-113	KE-CFC-251-114	Water	10/07/16 06:44	10/14/16 09:40
680-130863-114	KE-CFC-251-115	Water	10/07/16 06:44	10/14/16 09:40
680-130863-115	KE-CFC-251-116	Water	10/07/16 06:44	10/14/16 09:40
680-130863-116	KE-CFC-251-117	Water	10/07/16 06:44	10/14/16 09:40
680-130863-117	KE-CFC-251a-118	Water	10/07/16 06:46	10/14/16 09:40
680-130863-118	KE-WC-NWC-119	Water	10/07/16 06:47	10/14/16 09:40
680-130863-119	KE-CFC-253-120	Water	10/07/16 06:50	10/14/16 09:40
680-130863-120	KE-CFC-253-121	Water	10/07/16 06:50	10/14/16 09:40
680-130863-121	KE-CFC-253-122	Water	10/07/16 06:50	10/14/16 09:40
680-130863-122	KE-CFC-253-123	Water	10/07/16 06:50	10/14/16 09:40
680-130863-123	KE-CFC-253-124	Water	10/07/16 06:50	10/14/16 09:40
680-130863-124	KE-CFC-255-125	Water	10/07/16 06:51	10/14/16 09:40
680-130863-125	KE-CFC-256-126	Water	10/07/16 06:51	10/14/16 09:40
680-130863-126	KE-CFC-257-127	Water	10/07/16 06:55	10/14/16 09:40
680-130863-127	KE-CFC-257a-128	Water	10/07/16 06:56	10/14/16 09:40
680-130863-128	KE-CFC-257a-129	Water	10/07/16 06:56	10/14/16 09:40
680-130863-129	KE-WC-SWC-130	Water	10/07/16 06:58	10/14/16 09:40



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies Account #: XXXXXXXXXX
Address: 350 Elmwood Ave. City/State/Zip: Buffalo, NY 14222
Phone: 716-332-3134 Email: labresults@siennaet.com Fax: 716-332-3136
Project Name / Collection Address: KenTon CSD - Kenmore East High School City/State: Tonawanda, NY
(Required)
Age of Property: _____ Well Tag # (if Applicable): _____ Collected by: Jesse Balz & Randy Bauer Certification #: _____
SET #: 2845-H Relinquished by: Jesse Balz Signature: _____ Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Reporting Format:			Individual	LAB USE	
					Metals	Field Parameters	Other			
TURNAROUND TIMES: 4 - 5 Days					Every effort will be made to meet specified turnaround time. However due to increased water sampling across the nation, turnaround times will vary.					
					200 & Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	Temp at Time of Receipt:
01	KE-KFC-173a-01	173a, South wall, east	10/7/2016	0315	✓					
02	KE-KFC-173a-02	173a, South east, island	10/7/2016	0315	✓					
03	KE-KFC-173a-03	173a, West wall, South	10/7/2016	0316	✓					
04	KE-KFC-173a-04	173a, Northeast, column	10/7/2016	0316	✓					
05	KE-KFC-173a-05	173a, Center island	10/7/2016	0317	✓					
06	KE-KCC-173a-06	173a, South wall, Center	10/7/2016	0318	✓					
07	KE-KFC-173a-07	173a, East wall, South	10/7/2016	0319	✓					
08	KE-KFC-173a-08	173a, South wall, left	10/7/2016	0320	✓					
09	KE-KFC-173a-09	173a, South wall, right	10/7/2016	0320	✓					
10	KE-KFC-173a-10	173a, West wall, left	10/7/2016	0321	✓					



680-130863 Chain of Custody

Received By: [Signature] PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

Date: 10/14/16 Time: 0940 Temp. Received: 20.1/20.2

Shipping Tracking #: 818/21.9

Page 1 of 1

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC
Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)
Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies Account #: 2020000003
Address: 350 Elmwood Ave. City/State/Zip: Buffalo, NY 14222
Phone: 716-332-3134 Email: labresults@siennaet.com Fax: 716-332-3136
Project Name / Collection Address: Ken Ton CSD- Kenmore East High School City/State: Tonawanda, NY Zip: 14150
(Required)
Age of Property: _____ Well Tag # (If Applicable): _____ Collected by: Jesse Balz & Randy Bauer Certification #: _____
SET #: 2845-H Relinquished by: Jesse Balz Signature: _____ Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					200 ug Lead	Copper	Other	Field pH at time of Collection	Temp. at time of Collection	
11	KE-LFC-173a-11	173a, West wall, middle	10/7/2016	0321	✓					
12	KE-LFC-173a-12	173a, West wall, Right	10/7/2016	0322	✓					
13	KE-LFC-173a-13	173a, East wall, West end	10/7/2016	0323	✓					
14	KE-BFC-173b-14	173b, West wall	10/7/2016	0326	✓					
15	KE-CFC-171a-15	171a, West wall	10/7/2016	0330	✓					
16	KE-WC-171-16	171, North wall, left	10/7/2016	0332	✓					
17	KE-WC-171-17	171, North wall, Right	10/7/2016	0332	✓					
18	KE-WC-175-18	175, North wall, left	10/7/2016	0335	✓					
19	KE-WC-175-19	175, North wall, Right	10/7/2016	0335	✓					
20	KE-CFC-177-20	177, East wall, left	10/7/2016	0338	✓					

Received By: [Signature]
Date: 10/14/16 Time: 940 Temp. Received: 20.1 / 20.2
Shipping Tracking #: 2187219
Page 2 of 2
PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:
556 S. Mansfield St.
Ypsilanti, MI 48197
All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address: KenTon CSD- Kenmore East High School

City/State: Tonawanda, NY

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Balz & Randy Bauer

Certification #:

SET #: 2845-H Relinquished by: Jesse Balz

Signature:

Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Reporting Format:			Individual	All	LAB USE
					Metals	Field Parameters	Temp. at time of Collection:			
					200 & Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	Temp at Time of Receipt:
21	KE-IMC-177-21	177, East wall, Right	10/7/2016	0339	✓					
22	KE-IMC-179-22	179, North wall	10/7/2016	0343	✓					
23	KE-CFC-182-23	182, South wall, left	10/7/2016	0345	✓					
24	KE-CFC-182-24	182, South wall, Right	10/7/2016	0345	✓					
25	KE-DWC-182-25	182, North wall, East	10/7/2016	0348	✓					
26	KE-BFC-182-26	182, East wall, North	10/7/2016	0349	✓					
27	KE-WC-172a-27	172a, West wall	10/7/2016	0357	✓					
28	KE-HWC-172a-28	172a, East wall, left	10/7/2016	0359	✓					
29	KE-HWC-172a-29	172a, East wall, Middle	10/7/2016	0359	✓					
30	KE-HWC-172a-30	172a, East wall, Right	10/7/2016	0359	✓					

Received By: Y
Date: 10/14/16 Time: 940
Temp. Received: 20.1/20.2
Shipping Tracking #: 21-8/21-9
Page 3 of 3
PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:
556 S. Mansfield St.
Ypsilanti, MI 48197
All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Analysis By:

National Testing Laboratories, Ltd.

Quality Water Analysis

~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #:

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address:

Ken Ton CSD- Kenmore East High School

City/State: Tonawanda, NY

Zip: 14150

Age of Property: Well Tag # (if Applicable):

Collected by: Jesse Balz & Randy Bauer

Certification #:

SET #: 2845-H

Relinquished by: Jesse Balz

Signature:

Date: 10 / 7 / 2016

TURNAROUND TIMES: 4 - 5 Days Every effort will be made to meet specified turnaround time. However due to increased water sampling across the nation, turnaround times will vary.

Reporting Format:

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					200.8 Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
31	KE-BFC-172b-31	172b, West wall	10/7/2016	0401	✓					Temp at Time of Receipt:
32	KE-DWJ-172c-32	172c, South wall	10/7/2016	0402	✓					
33	KE-WC-172-33	172, East wall, South	10/7/2016	0405	✓					
34	KE-HWC-172-34	172, East wall, left	10/7/2016	0406	✓					
35	KE-HWC-172-35	172, East wall, left middle	10/7/2016	0406	✓					
36	KE-HWC-172-36	172, East wall, Right	10/7/2016	0406	✓					
37	KE-BFC-172e-37	172e, West wall	10/7/2016	0409	✓					
38	KE-WC-154-38	154, East wall, South	10/7/2016	0418	✓					
39	KE-HWC-154-39	154, East wall, left	10/7/2016	0420	✓					
40	KE-HWC-154-40	154, East wall, middle	10/7/2016	0420	✓					

Received By:

Date: 10/14/16 Time: 940

Temp. Received: 20.1/20.7

Shipping Tracking #:

218/21.9

Page 4 of

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #: 200000000

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address: KenTon CSD- Kenmore East High School

City/State: Tonawanda, NY

(Required)

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Batz & Randy Bauer

Certification #:

SET #: 2845-H

Relinquished by: Jesse Batz

Signature:

Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Reporting Format:			Individual	All	LAB USE
					Metals	Field Parameters	Temp. at time of Collection			
					200 g Lead	Copper	Other	Field pH at time of Collection	Temp. at time of Collection	Temp at Time of Receipt
41	KE-154-HWC-41	154, East wall, Right	10/7/2016	0420	✓					
42	KE-154e-DWC-42	154e, North wall	10/7/2016	0422	✓					
43	KE-154f-BWC-43	154f, West wall	10/7/2016	0422	✓					
44	KE-154b-WC-44	154b, South, East	10/7/2016	0426	✓					
45	KE-154b-HWC-45	154b, South, Left	10/7/2016	0428	✓					
46	KE-154b-HWC-46	154b, South, Middle	10/7/2016	0428	✓					
47	KE-154b-HWC-47	154b, South, Right	10/7/2016	0428	✓					
48	KE-WC-NWC-48	North West Corridor, North wall	10/7/2016	0431	✓					
49	KE-WC-NWC-49	North West Corridor, South wall	10/7/2016	0433	✓					
50	KE-CFL-157-50	157, South wall, Left	10/7/2016	0435	✓					

Received By: Y940

Date: 10/14/16 Time: 20:11:20.7

Temp. Received: 20.1

Shipping Tracking #: 218/219

Page 5 of 5

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead / Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #:

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address:

KenTon CSD- Kenmore East High School

City/State: Tonawanda, NY

Zip: 14150

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Balz & Randy Bauer

Certification #:

SET #: 2845-H Relinquished by: Jesse Balz

Signature:

Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					200 & Lead	Copper	Other	Field pH at time of Collection	Temp. at time of Collection	
S1	KE-CFC-157-51	Rm 157, South wall Right	10/7/2016	0435	☒	☐	☐	☐	☐	Temp at Time of Receipt:
S2	KE-CFC-151-52	151, South wall, left	10/7/2016	0440	☒	☐	☐	☐	☐	
S3	KE-CFC-151-53	151, South wall, Right	10/7/2016	0440	☒	☐	☐	☐	☐	
S4	KE-CFC-149-54	149, South wall	10/7/2016	0443	☒	☐	☐	☐	☐	
S5	KE-CFC-143a-55	143a, East wall	10/7/2016	0449	☒	☐	☐	☐	☐	
S6	KE-WC-MEC-56	Northeast Corridor, West wall	10/7/2016	0452	☒	☐	☐	☐	☐	
S7	KE-WC-SPR-57	Subpump Room, Right, South wall	10/7/2016	0455	☒	☐	☐	☐	☐	
S8	KE-CFC-REC-58	Rec Room, Basement, South wall	10/7/2016	0457	☒	☐	☐	☐	☐	
S9	KE-DFC-136e-59	136e, East wall, left	10/7/2016	0500	☒	☐	☐	☐	☐	
S10	KE-DFC-136e-60	136e, East wall, Right	10/7/2016	0500	☒	☐	☐	☐	☐	

Received By:

Date: 10/14/16 Time: 9:40 Temp. Received: 20.1/20.2

Shipping Tracking #:

Page 6 of 21.7

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #: 333333333

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address: (Required)

City/State: Tonawanda, NY

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Balz & Randy Bauer

Certification #:

SET #: 2845-H

Relinquished by: Jesse Balz

Signature:

Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					200 B Lead	Copper	Other	Field pH at time of Collection	Temp. at time of Collection	
6 ¹	KE-BFL-136f-61	136f, East wall, left	10/7/2016	0502	☒	☐	☐	☐	☐	Temp at Time of Receipt:
6 ²	KE-BFL-136f-62	136f, East wall, Right	10/7/2016	0502	☒	☐	☐	☐	☐	
6 ³	KE-BFL-163-63	163a, North wall	10/7/2016	0507	☒	☐	☐	☐	☐	
6 ⁴	KE-CFL-163-64	163, Sink, West wall, left	10/7/2016	0511	☒	☐	☐	☐	☐	
6 ⁵	KE-CFL-163-65	163, Sprayer, West wall, Right	10/7/2016	0511	☒	☐	☐	☐	☐	
6 ⁶	KE-BFL-166-66	166a, East Wall, for left	10/7/2016	0517	☒	☐	☐	☐	☐	
6 ⁷	KE-BFL-166a-67	166a, East wall, and from left	10/7/2016	0517	☒	☐	☐	☐	☐	
6 ⁸	KE-BFL-166a-68	166a, East wall, 3rd from left	10/7/2016	0517	☒	☐	☐	☐	☐	
6 ⁹	KE-BFL-166a-69	166a, East wall, 4th from left	10/7/2016	0517	☒	☐	☐	☐	☐	
7 ⁰	KE-BFL-166a-70	166a, East wall, 5th from left	10/7/2016	0517	☒	☐	☐	☐	☐	

Received By:

Date: 10/14/16 Time: 0940 Temp. Received: 20.1 / 20.7

Shipping Tracking #: 2187219

Page 7 of 7

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead / Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907

ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Analysis By:

National Testing

Laboratories, Ltd.

Quality Water Analysis

~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #:

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address:

City/State: Tonawanda, NY

Zip: 14150

(Required)

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Balz & Randy Bauer

Certification #:

SET #: 2845-H

Relinquished by: Jesse Balz

Signature:

Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					200.8 Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	
71	KE-BFC-161a-71	161a, East wall Far Right	10/7/2016	0517	☒	☐	☐	☐	☐	Temp at Time of Receipt:
72	KE-BFC-161b-72	161b, West wall, far left	10/7/2016	0521	☒	☐	☐	☐	☐	
73	KE-BFC-161b-73	161b, West wall, far left 3rd from left	10/7/2016	0521	☒	☐	☐	☐	☐	
74	KE-BFC-161b-74	161b, West wall, 3rd from left	10/7/2016	0521	☒	☐	☐	☐	☐	
75	KE-BFC-161b-75	161b, West wall, 4th from left	10/7/2016	0521	☒	☐	☐	☐	☐	
76	KE-BFC-161b-76	161b, West wall, 5th from left	10/7/2016	0521	☒	☐	☐	☐	☐	
77	KE-BFC-161b-77	161b, West wall, Far Right	10/7/2016	0521	☒	☐	☐	☐	☐	
78	KE-WC-SCC-78	South, Center Corridor, North wall	10/7/2016	0524	☒	☐	☐	☐	☐	
79	KE-WC-SCC-79	South, Center Corridor, North wall, filler Bottle	10/7/2016	0524	☒	☐	☐	☐	☐	
80	KE-BFC-161a-80	161a, North wall	10/7/2016	0527	☒	☐	☐	☐	☐	

Received By:

Date: 10/14/16 Time: 9:40 Temp. Received: 20.1/20.2

Shipping Tracking #:

21-8/21.9

Page 8 of 8

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)
Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #: 204500033

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address: Ken Ton CSD- Kenmore East High School

City/State: Tonawanda, NY

(Required)

Zip: 14150

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Batz & Randy Bauer

Certification #:

SET #: 2845-H

Relinquished by: Jesse Batz

Signature:

Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE
					200 g Lead	Copper	Other	Field pH at time of Collection	Temp. at time of Collection	
7 ¹	KE-CFC-126-81	121a, West wall	10/7/2016	0530	☒	☒	☒	☒	☒	
8 ²	KE-BFC-126-82	121b, East wall	10/7/2016	0530	☒	☒	☒	☒	☒	
8 ³	KE-CFC-115-83	115, West wall	10/7/2016	0537	☒	☒	☒	☒	☒	
8 ⁴	KE-BFC-115-84	115a, North wall	10/7/2016	0539	☒	☒	☒	☒	☒	
8 ⁵	KE-WC-SEC-85	South East Corridor, Northern wall	10/7/2016	0541	☒	☒	☒	☒	☒	
8 ⁶	KE-CFC-110-86	110, South wall	10/7/2016	0544	☒	☒	☒	☒	☒	
8 ⁷	KE-CFC-108a-87	108a, South wall	10/7/2016	0545	☒	☒	☒	☒	☒	
8 ⁸	KE-CFC-108-88	108, South wall (RM104)	10/7/2016	0546	☒	☒	☒	☒	☒	
8 ⁹	KE-WC-SEC-89	South East Corridor, South wall	10/7/2016	0547	☒	☒	☒	☒	☒	
9 ⁰	KE-CFC-103-90	103, North wall	10/7/2016	0548	☒	☒	☒	☒	☒	

Received By:

NO SAMPLE 90

Date: 10/14/16

Time: 4:40

Temp. Received: 20.1

20.2

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

Shipping Tracking #:

21.8/21.9

All Samples Except for Lead / Metals Must Be Shipped On Ice Via Overnight Shipping

Page 9 of 9

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com

Analysis By:
National Testing Laboratories, Ltd.
Quality Water Analysis

~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #: ~~20050000~~

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address:

KenTon CSD- Kenmore East High School

City/State: Tonawanda, NY

Zip: 14150

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Baltz & Randy Bauer

Certification #:

SET #: 2845-H

Relinquished by: Jesse Baltz

Signature: *[Signature]*

Date: 10 / 7 / 2016

TURNAROUND TIMES: 4 - 5 Days Every effort will be made to meet specified turnaround time. However due to increased water sampling across the nation, turnaround times will vary.

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters	LAB USE
					2008 Lead	Copper	Other		
1	KE-CFL-101-91	101, North wall	10/7/2016	0552	☒	☐	☐	☒	Temp at Time of Receipt:
2	KE-BFL-102a-92	102a, North wall	10/7/2016	0555	☒	☐	☐	☐	Temp. at time of Collection:
3	KE-BFL-102b-93	102b, North wall	10/7/2016	0557	☒	☐	☐	☐	
4	KE-CFL-100-94	100, West wall, south	10/7/2016	0601	☒	☐	☐	☐	
5	KE-BFL-200-95	200, West wall	10/7/2016	0608	☒	☐	☐	☐	
6	KE-BFL-200a-96	200a, East wall	10/7/2016	0609	☒	☐	☐	☐	
7	KE-WC-SEC-97	Southeast corner, West wall	10/7/2016	0611	☒	☐	☐	☐	
8	KE-WC-SEC-98	Southeast corner, West wall	10/7/2016	0612	☒	☐	☐	☐	
9	KE-CFL-219-99	219, West wall	10/7/2016	0616	☒	☐	☐	☐	
10	KE-CFL-224-100	224, North wall	10/7/2016	0619	☒	☐	☐	☐	

Received By: *[Signature]*

Date: 10 / 14 / 16 Time: 0440 Temp. Received: 20.1 / 20.7

Shipping Tracking #:

218 / 21.9

Page 10 of

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead / Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)
Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



Analysis By: **National Testing Laboratories, Ltd.**
Quality Water Analysis
~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies

Account #: **200000000**

Address: 350 Elmwood Ave.

City/State/Zip: Buffalo, NY 14222

Phone: 716-332-3134

Email: labresults@siennaet.com

Fax: 716-332-3136

Project Name / Collection Address:

KenTon CSD- Kenmore East High School

City/State: Tonawanda, NY

Zip: 14150

Age of Property: Well Tag # (If Applicable):

Collected by: Jesse Balz & Randy Bauer

Certification #:

SET #: 2845-H

Relinquished by: Jesse Balz

Signature: *[Signature]*

Date: 10 / 7 / 2016

TURNAROUND TIMES: 4 - 5 Days Every effort will be made to meet specified turnaround time. However due to increased water sampling across the nation, turnaround times will vary.

TURNAROUND TIMES: 4 – 5 Days				Every effort will be made to meet specified turnaround time. However due to increased water sampling across the nation, turnaround times will vary.				Reporting Format:		Individual		All	
No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Metals			Field Parameters		LAB USE			
					200 & Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:				
10 ¹	KE-DW-234-101	234, Eastwall	10/7/2016	0621	☒	☐	☐	☐	☐	Temp at Time of Receipt:			
10 ²	KE-WC-223-102	223, Eastwall	10/7/2016	0625	☒	☐	☐	☐	☐				
10 ³	KE-BFL-222-103	222a, Southwall, left	10/7/2016	0627	☒	☐	☐	☐	☐				
10 ⁴	KE-BFL-222-104	222a, Southwall, middle	10/7/2016	0627	☒	☐	☐	☐	☐				
10 ⁵	KE-BFL-222-105	222a, Southwall, Right	10/7/2016	0627	☒	☐	☐	☐	☐				
10 ⁶	KE-BFL-222-106	222b, Southwall, left	10/7/2016	0628	☒	☐	☐	☐	☐				
10 ⁷	KE-BFL-222-107	222b, Southwall, Right	10/7/2016	0628	☒	☐	☐	☐	☐				
10 ⁸	KE-CFL-235-108	235, Westwall	10/7/2016	0630	☒	☐	☐	☐	☐				
10 ⁹	KE-CFL-241-109	241, Southwall, left	10/7/2016	0634	☒	☐	☐	☐	☐				
10 ¹⁰	KE-CFL-241-110	241, Southwall, Right	10/7/2016	0634	☒	☐	☐	☐	☐				

Received By: *[Signature]*

Date: 10 / 14 / 16 Time: 9:40 Temp. Received: 20.1 / 20.7

Shipping Tracking #: 218 / 21.9

Page 11 of 11

PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:

556 S. Mansfield St.

Ypsilanti, MI 48197

All Samples Except for Lead / Metals Must Be Shipped On Ice Via Overnight Shipping

NTL Lab ID Number



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)

Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



~ For Lab Use Only ~

Company Name: Sienna Environmental Technologies Account # ~~XXXXXXXXXX~~
Address: 350 Elmwood Ave. City/State/Zip: Buffalo, NY 14222
Phone: 716-332-3134 Email: labresults@siennaet.com Fax: 716-332-3136
Project Name / Collection Address: Ken Ton CSD- Kenmore East High School City/State: Tonawanda, NY Zip: 14150
Age of Property: Well Tag # (If Applicable): Collected by: Jesse Balz & Randy Bauer Certification #:
SET #: 2845-H Relinquished by: Jesse Balz Signature: Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Reporting Format:			Individual	LAB USE	
					Metals	Field Parameters				
					200 g Lead	Copper	Other	Field pH at time of Collection:	Temp. at time of Collection:	Temp at Time of Receipt:
111	KE-CFC-243-111	243, Southwall, left	10/7/2016	0637	✓					
112	KE-CFC-243-112	243, Southwall, right	10/7/2016	0637	✓					
113	KE-WC-NWC-113	Northwest Corridor, Southwall	10/7/2016	0639	✓					
114	KE-CFC-251-114	251, Southwall, left	10/7/2016	0644	✓					
115	KE-CFC-251-115	251, Southwall, right	10/7/2016	0644	✓					
116	KE-CFC-251-116	251, West wall, left	10/7/2016	0644	✓					
117	KE-CFC-251-117	251, West wall, right	10/7/2016	0644	✓					
118	KE-CFC-251a-118	251a, East wall	10/7/2016	0646	✓					
119	KE-WC-NWC-119	NWC, Northwest Corridor, Northwall	10/7/2016	0647	✓					
120	KE-CFC-253-120	253, Southwall left	10/7/2016	0650	✓					

Received By:
Date: 10/14/16 Time: 946 Temp. Received: 20.1/20.2
Shipping Tracking #: 21.8/21.9
Page 12 of 14
PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:
556 S. Mansfield St.
Ypsilanti, MI 48197
All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping



ENVIRONMENTAL HAZARDS SERVICES, LLC

Lead in Water Chain-of-Custody Form

(For Multi-Sample Projects)
Richmond, VA - Phone: (800) 347-4010 FAX: (804) 275-4907
ONLINE CLIENT PORTAL AVAILABLE FOR ANALYSIS RESULTS AT: www.leadlab.com



Company Name: Sienna Environmental Technologies Account #: 2000000000
Address: 350 Elmwood Ave. City/State/Zip: Buffalo, NY 14222
Phone: 716-332-3134 Email: labresults@siennaet.com Fax: 716-332-3136
Project Name / Collection Address: KenTon CSD- Kenmore East High School City/State: Tonawanda, NY Zip: 14150
Age of Property: _____ Well Tag # (If Applicable): _____ Collected by: Jesse Balz & Randy Bauer Certification #: _____
SET #: 2845-H Relinquished by: Jesse Balz Signature: _____ Date: 10 / 7 / 2016

No.	Client Sample ID	Collection Location (Ex: Kitchen Sink)	Collection Date	Collection Time	Reporting Format:			Individual	LAB USE
					Metals	Field Parameters			
					Copper	Other	Field pH at time of Collection	Temp. at time of Collection	Temp. at Time of Receipt
12 ¹	KE-CF-253-121	253, Southwest 15 land	10/7/2016	0650	☒				
12 ²	KE-CF-253-122	253, Southwall, Right	10/7/2016	0650	☒				
12 ³	KE-CF-253-123	253, Eastwall, Right	10/7/2016	0650	☒				
12 ⁴	KE-CF-253-124	253, Eastwall, Left	10/7/2016	0650	☒				
12 ⁵	KE-CF-255-125	255, Eastwall, Left	10/7/2016	0651	☒				
12 ⁶	KE-CF-255-126	255, Eastwall, Right (Spray)	10/7/2016	0651	☒				
12 ⁷	KE-CF-257-127	257, Southwall	10/7/2016	0655	☒				
12 ⁸	KE-CF-257a-128	257a, Westwall, Left	10/7/2016	0656	☒				
12 ⁹	KE-CF-257a-129	257a, Westwall, Right	10/7/2016	0656	☒				
13 ⁰	KE-WC-546-130	Southwest Corridor, Northwall	10/7/2016	0658	☒				

Received By: _____
Date: 10/14/16 Time: 2:40 Temp. Received: 20.1/20.2
Shipping Tracking #: 21.8/21.9
Page 13 of _____
PLEASE SEND WATER KIT SAMPLES TO THE FOLLOWING ADDRESS:
556 S. Mansfield St.
Ypsilanti, MI 48197
All Samples Except for Lead /Metals Must Be Shipped On Ice Via Overnight Shipping

Login Sample Receipt Checklist

Client: Sienna Environmental Technologies LLC

Job Number: 680-130863-1

SDG Number: SET 2845H

Login Number: 130863

List Number: 1

Creator: Flanagan, Naomi V

List Source: TestAmerica Savannah

Question	Answer	Comment
Radioactivity wasn't checked or is $\leq$ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	False	Thermal preservation not required.
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

ANALYTICAL REPORT

TestAmerica Laboratories, Inc.

TestAmerica Buffalo

10 Hazelwood Drive

Amherst, NY 14228-2298

Tel: (716)691-2600

TestAmerica Job ID: 480-108183-1

TestAmerica Sample Delivery Group: SET2845H

Client Project/Site: Kenmore Tonawanda CSD - East High School


For:

Sienna Environmental Technologies LLC

350 Elmwood Avenue

Buffalo, New York 14222

Attn: Suzanne Kelley



Authorized for release by:

11/25/2016 10:16:14 AM

Melissa Deyo, Project Manager I

(716)504-9874

melissa.deyo@testamericainc.com

LINKS

Review your project
results through

TotalAccess

Have a Question?



Visit us at:

www.testamericainc.com

The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

Table of Contents

Cover Page	1
Table of Contents	2
Definitions/Glossary	3
Case Narrative	4
Detection Summary	5
Client Sample Results	19
QC Sample Results	39
QC Association Summary	46
Lab Chronicle	55
Certification Summary	79
Method Summary	80
Sample Summary	81
Chain of Custody	84
Receipt Checklists	98



Definitions/Glossary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Qualifiers

Metals

Qualifier	Qualifier Description
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Case Narrative

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Job ID: 480-108183-1

Laboratory: TestAmerica Buffalo

Narrative

Job Narrative 480-108183-1

Receipt

The samples were received on 10/21/2016 10:30 AM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 16.0° C.

Receipt Exceptions

The following samples for metals were received unpreserved and were preserved upon receipt to the laboratory: KE-BFC-261B-131 (480-108183-1), KE-BFC-261B-132 (480-108183-2), KE-BFC-261B-133 (480-108183-3), KE-BFC-261B-134 (480-108183-4), KE-BFC-261B-135 (480-108183-5), KE-BFC-261B-136 (480-108183-6), KE-BFC-261A-137 (480-108183-7), KE-BFC-261A-138 (480-108183-8), KE-BFC-261A-139 (480-108183-9), KE-BFC-261A-140 (480-108183-10), KE-BFC-261A-141 (480-108183-11), KE-BFC-261A-142 (480-108183-12), KE-WC-SEC-143 (480-108183-13), KE-CSC-311-144 (480-108183-14), KE-WC-SEC-145 (480-108183-15), KE-BFC-MSB-146 (480-108183-16), KE-BFC-MSB-147 (480-108183-17), KE-CFC-369-148 (480-108183-18), KE-CSC-JC-149 (480-108183-19), KE-WC-CCM-150 (480-108183-20), KE-BFC-361-151 (480-108183-21), KE-BFC-361-152 (480-108183-22), KE-BFC-361-153 (480-108183-23), KE-BFC-361-154 (480-108183-24), KE-BFC-361-155 (480-108183-25), KE-BFC-361-156 (480-108183-26), KE-BFC-359-157 (480-108183-27), KE-BFC-359-158 (480-108183-28), KE-BFC-359-159 (480-108183-29), KE-BFC-359-160 (480-108183-30), KE-BFC-359-161 (480-108183-31), KE-BFC-359-162 (480-108183-32), KE-CFC-323-163 (480-108183-33), KE-CFC-323-164 (480-108183-34), KE-CFC-323-165 (480-108183-35), KE-CFC-323-166 (480-108183-36), KE-CFC-323-167 (480-108183-37), KE-CFC-323-168 (480-108183-38), KE-CFC-323-169 (480-108183-39), KE-CFC-323-170 (480-108183-40), KE-CFC-325-171 (480-108183-41), KE-CFC-325-172 (480-108183-42), KE-CFC-325-173 (480-108183-43), KE-CFC-325-174 (480-108183-44), KE-CFC-325-175 (480-108183-45), KE-CFC-325-176 (480-108183-46), KE-CFC-325-177 (480-108183-47), KE-CFC-325-178 (480-108183-48), KE-CFC-327-179 (480-108183-49), KE-CFC-327-180 (480-108183-50), KE-CFC-327-181 (480-108183-51), KE-CFC-327-182 (480-108183-52), KE-CFC-327-183 (480-108183-53), KE-CFC-327-184 (480-108183-54), KE-CFC-327-185 (480-108183-55), KE-CFC-327-186 (480-108183-56), KE-BFC-WSB-187 (480-108183-57), KE-BFC-WSB-188 (480-108183-58), KE-BFC-WSB-189 (480-108183-59), KE-BFC-MSB-190 (480-108183-60), KE-BFC-MSB-191 (480-108183-61), KE-WC-CCE-192 (480-108183-62), KE-CSH-JC-193 (480-108183-63), KE-CFC-324-194 (480-108183-64), KE-CFC-333-195 (480-108183-65), KE-CFC-333-196 (480-108183-66), KE-CFC-333-197 (480-108183-67), KE-CFC-333-198 (480-108183-68), KE-CFC-333-199 (480-108183-69), KE-CFC-333-200 (480-108183-70), KE-CFC-333-201 (480-108183-71), KE-CFC-335-202 (480-108183-72), KE-CFC-335-203 (480-108183-73), KE-CFC-335-204 (480-108183-74), KE-CFC-335-205 (480-108183-75), KE-CFC-335-206 (480-108183-76), KE-CFC-335-207 (480-108183-77), KE-CFC-335-208 (480-108183-78), KE-CFC-335-209 (480-108183-79), KE-CFC-337-210 (480-108183-80), KE-CFC-337-211 (480-108183-81), KE-CFC-337-212 (480-108183-82), KE-CFC-337-213 (480-108183-83), KE-CFC-337-214 (480-108183-84), KE-CFC-337-215 (480-108183-85), KE-CFC-337-216 (480-108183-86), KE-CFC-337-217 (480-108183-87), KE-CFC-337-218 (480-108183-88), KE-CFC-337-219 (480-108183-89), KE-CFC-337-220 (480-108183-90), KE-CFC-337-221 (480-108183-91), KE-CFC-337-222 (480-108183-92), KE-CFC-337-223 (480-108183-93), KE-CFC-337-224 (480-108183-94), KE-CFC-337-225 (480-108183-95), KE-CFC-338-226 (480-108183-96), KE-CFC-341-227 (480-108183-97), KE-CFC-34-228 (480-108183-98), KE-CFC-343-229 (480-108183-99), KE-CFC-343-230 (480-108183-100), KE-CFC-343-231 (480-108183-101), KE-CFC-343-232 (480-108183-102), KE-CFC-343-233 (480-108183-103), KE-CFC-343-234 (480-108183-104), KE-CFC-343-236 (480-108183-105), KE-WC-NC-237 (480-108183-106), KE-CFC-349-239 (480-108183-107), KE-CFC-349-240 (480-108183-108), KE-CFC-349-241 (480-108183-109), KE-CFC-349-242 (480-108183-110), KE-CFC-349-243 (480-108183-111), KE-CFC-349-244 (480-108183-112), KE-CFC-349-245 (480-108183-113), KE-CFC-349-246 (480-108183-114), KE-CFC-351-247 (480-108183-115), KE-CFC-351-248 (480-108183-116), KE-CFC-351-249 (480-108183-117), KE-CFC-351-250 (480-108183-118), KE-CFC-351-251 (480-108183-119), KE-CFC-351-252 (480-108183-120), KE-CFC-351-253 (480-108183-121), KE-CFC-351-254 (480-108183-122), KE-CFC-353-255 (480-108183-123), KE-CFC-355-257 (480-108183-124), KE-CFC-355-258 (480-108183-125), KE-CFC-355-259 (480-108183-126), KE-CFC-355-260 (480-108183-127), KE-CFC-355-261 (480-108183-128), KE-CFC-355-262 (480-108183-129), KE-CFC-355-263 (480-108183-130), KE-CFC-355-264 (480-108183-131), KE-WC-NC-265 (480-108183-132), KE-CFC-359-266 (480-108183-133), KE-CFC-357-267 (480-108183-134), KE-CFC-357-268 (480-108183-135), KE-CFC-357-269 (480-108183-136), KE-CFC-357-270 (480-108183-137), KE-CFC-357-271 (480-108183-138), KE-CFC-357-272 (480-108183-139) and KE-CFC-357-273 (480-108183-140). Regulatory documents require a 24-hour waiting period from the time of the addition of the acid preservative to the time of digestion. Preserved in SC using HNO3 lot # 139780 on 10/21/16 @ 1740.

Metals

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-261B-131

Lab Sample ID: 480-108183-1

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261B-132

Lab Sample ID: 480-108183-2

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261B-133

Lab Sample ID: 480-108183-3

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261B-134

Lab Sample ID: 480-108183-4

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261B-135

Lab Sample ID: 480-108183-5

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261B-136

Lab Sample ID: 480-108183-6

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261A-137

Lab Sample ID: 480-108183-7

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261A-138

Lab Sample ID: 480-108183-8

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261A-139

Lab Sample ID: 480-108183-9

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261A-140

Lab Sample ID: 480-108183-10

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261A-141

Lab Sample ID: 480-108183-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-261A-141 (Continued)

Lab Sample ID: 480-108183-11

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.99	J	1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-261A-142

Lab Sample ID: 480-108183-12

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.95	J	1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-WC-SEC-143

Lab Sample ID: 480-108183-13

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CSC-311-144

Lab Sample ID: 480-108183-14

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	37.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-WC-SEC-145

Lab Sample ID: 480-108183-15

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.63	J	1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-MSB-146

Lab Sample ID: 480-108183-16

No Detections.

Client Sample ID: KE-BFC-MSB-147

Lab Sample ID: 480-108183-17

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-369-148

Lab Sample ID: 480-108183-18

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CSC-JC-149

Lab Sample ID: 480-108183-19

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-WC-CCM-150

Lab Sample ID: 480-108183-20

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.46	J	1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-361-151

Lab Sample ID: 480-108183-21

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.4		1.0	0.17	ug/L	1		200.8	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-361-152

Lab Sample ID: 480-108183-22

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-361-153

Lab Sample ID: 480-108183-23

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-361-154

Lab Sample ID: 480-108183-24

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-361-155

Lab Sample ID: 480-108183-25

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-361-156

Lab Sample ID: 480-108183-26

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-359-157

Lab Sample ID: 480-108183-27

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-359-158

Lab Sample ID: 480-108183-28

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-359-159

Lab Sample ID: 480-108183-29

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-359-160

Lab Sample ID: 480-108183-30

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-359-161

Lab Sample ID: 480-108183-31

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-359-162

Lab Sample ID: 480-108183-32

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-359-162 (Continued)

Lab Sample ID: 480-108183-32

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-163

Lab Sample ID: 480-108183-33

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	41.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-164

Lab Sample ID: 480-108183-34

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	35.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-165

Lab Sample ID: 480-108183-35

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	25.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-166

Lab Sample ID: 480-108183-36

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	15.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-167

Lab Sample ID: 480-108183-37

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-168

Lab Sample ID: 480-108183-38

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-169

Lab Sample ID: 480-108183-39

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-323-170

Lab Sample ID: 480-108183-40

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-171

Lab Sample ID: 480-108183-41

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-172

Lab Sample ID: 480-108183-42

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-325-172 (Continued)

Lab Sample ID: 480-108183-42

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-173

Lab Sample ID: 480-108183-43

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-174

Lab Sample ID: 480-108183-44

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-175

Lab Sample ID: 480-108183-45

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-176

Lab Sample ID: 480-108183-46

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-177

Lab Sample ID: 480-108183-47

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-325-178

Lab Sample ID: 480-108183-48

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-179

Lab Sample ID: 480-108183-49

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.80	J	1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-180

Lab Sample ID: 480-108183-50

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-181

Lab Sample ID: 480-108183-51

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-182

Lab Sample ID: 480-108183-52

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-327-182 (Continued)

Lab Sample ID: 480-108183-52

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-183

Lab Sample ID: 480-108183-53

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-184

Lab Sample ID: 480-108183-54

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-185

Lab Sample ID: 480-108183-55

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-327-186

Lab Sample ID: 480-108183-56

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-WSB-187

Lab Sample ID: 480-108183-57

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	13.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-WSB-188

Lab Sample ID: 480-108183-58

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-WSB-189

Lab Sample ID: 480-108183-59

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	14.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-MSB-190

Lab Sample ID: 480-108183-60

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	16.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-BFC-MSB-191

Lab Sample ID: 480-108183-61

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-WC-CCE-192

Lab Sample ID: 480-108183-62

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-WC-CCE-192 (Continued)

Lab Sample ID: 480-108183-62

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.53	J	1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CSH-JC-193

Lab Sample ID: 480-108183-63

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	23.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-324-194

Lab Sample ID: 480-108183-64

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-333-195

Lab Sample ID: 480-108183-65

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	3.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-333-196

Lab Sample ID: 480-108183-66

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-333-197

Lab Sample ID: 480-108183-67

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-333-198

Lab Sample ID: 480-108183-68

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-333-199

Lab Sample ID: 480-108183-69

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-333-200

Lab Sample ID: 480-108183-70

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-333-201

Lab Sample ID: 480-108183-71

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-202

Lab Sample ID: 480-108183-72

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-335-202 (Continued)

Lab Sample ID: 480-108183-72

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-203

Lab Sample ID: 480-108183-73

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	33.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-204

Lab Sample ID: 480-108183-74

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-205

Lab Sample ID: 480-108183-75

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	14.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-206

Lab Sample ID: 480-108183-76

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-207

Lab Sample ID: 480-108183-77

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	12.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-208

Lab Sample ID: 480-108183-78

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-335-209

Lab Sample ID: 480-108183-79

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-210

Lab Sample ID: 480-108183-80

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-211

Lab Sample ID: 480-108183-81

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	14.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-212

Lab Sample ID: 480-108183-82

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-337-212 (Continued)

Lab Sample ID: 480-108183-82

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	10.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-213

Lab Sample ID: 480-108183-83

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	32.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-214

Lab Sample ID: 480-108183-84

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	12.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-215

Lab Sample ID: 480-108183-85

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	14.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-216

Lab Sample ID: 480-108183-86

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-217

Lab Sample ID: 480-108183-87

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	14.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-218

Lab Sample ID: 480-108183-88

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-219

Lab Sample ID: 480-108183-89

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-220

Lab Sample ID: 480-108183-90

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	36.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-221

Lab Sample ID: 480-108183-91

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-222

Lab Sample ID: 480-108183-92

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-337-222 (Continued)

Lab Sample ID: 480-108183-92

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-223

Lab Sample ID: 480-108183-93

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-224

Lab Sample ID: 480-108183-94

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-337-225

Lab Sample ID: 480-108183-95

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-338-226

Lab Sample ID: 480-108183-96

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	1.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-341-227

Lab Sample ID: 480-108183-97

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-34-228

Lab Sample ID: 480-108183-98

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-343-229

Lab Sample ID: 480-108183-99

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	15.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-343-230

Lab Sample ID: 480-108183-100

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-343-231

Lab Sample ID: 480-108183-101

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-343-232

Lab Sample ID: 480-108183-102

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-343-232 (Continued)

Lab Sample ID: 480-108183-102

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-343-233

Lab Sample ID: 480-108183-103

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-343-234

Lab Sample ID: 480-108183-104

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-343-236

Lab Sample ID: 480-108183-105

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-WC-NC-237

Lab Sample ID: 480-108183-106

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	0.80	J	1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-239

Lab Sample ID: 480-108183-107

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	5.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-240

Lab Sample ID: 480-108183-108

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	4.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-241

Lab Sample ID: 480-108183-109

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-242

Lab Sample ID: 480-108183-110

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-243

Lab Sample ID: 480-108183-111

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-244

Lab Sample ID: 480-108183-112

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-349-244 (Continued)

Lab Sample ID: 480-108183-112

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	35.8		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-245

Lab Sample ID: 480-108183-113

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	51.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-349-246

Lab Sample ID: 480-108183-114

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	31.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-247

Lab Sample ID: 480-108183-115

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-248

Lab Sample ID: 480-108183-116

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	29.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-249

Lab Sample ID: 480-108183-117

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	26.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-250

Lab Sample ID: 480-108183-118

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	28.2		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-251

Lab Sample ID: 480-108183-119

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	62.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-252

Lab Sample ID: 480-108183-120

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	53.3		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-253

Lab Sample ID: 480-108183-121

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	52.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-351-254

Lab Sample ID: 480-108183-122

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-351-254 (Continued)

Lab Sample ID: 480-108183-122

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-353-255

Lab Sample ID: 480-108183-123

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-257

Lab Sample ID: 480-108183-124

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	23.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-258

Lab Sample ID: 480-108183-125

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	17.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-259

Lab Sample ID: 480-108183-126

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.6		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-260

Lab Sample ID: 480-108183-127

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	8.0		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-261

Lab Sample ID: 480-108183-128

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-262

Lab Sample ID: 480-108183-129

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-263

Lab Sample ID: 480-108183-130

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-355-264

Lab Sample ID: 480-108183-131

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	22.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-WC-NC-265

Lab Sample ID: 480-108183-132

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead									

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Detection Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-WC-NC-265 (Continued)

Lab Sample ID: 480-108183-132

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	2.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-359-266

Lab Sample ID: 480-108183-133

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-357-267

Lab Sample ID: 480-108183-134

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	27.5		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-357-268

Lab Sample ID: 480-108183-135

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.7		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-357-269

Lab Sample ID: 480-108183-136

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	6.9		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-357-270

Lab Sample ID: 480-108183-137

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	9.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-357-271

Lab Sample ID: 480-108183-138

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	7.1		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-357-272

Lab Sample ID: 480-108183-139

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	11.4		1.0	0.17	ug/L	1		200.8	Total/NA

Client Sample ID: KE-CFC-357-273

Lab Sample ID: 480-108183-140

Analyte	Result	Qualifier	RL	MDL	Unit	Dil Fac	D	Method	Prep Type
Lead	18.8		1.0	0.17	ug/L	1		200.8	Total/NA

This Detection Summary does not include radiochemical test results.

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-261B-131

Lab Sample ID: 480-108183-1

Date Collected: 10/21/16 04:04

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.7		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:18	1

Client Sample ID: KE-BFC-261B-132

Lab Sample ID: 480-108183-2

Date Collected: 10/21/16 04:06

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.8		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:36	1

Client Sample ID: KE-BFC-261B-133

Lab Sample ID: 480-108183-3

Date Collected: 10/21/16 04:07

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.4		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:38	1

Client Sample ID: KE-BFC-261B-134

Lab Sample ID: 480-108183-4

Date Collected: 10/21/16 04:08

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.5		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:41	1

Client Sample ID: KE-BFC-261B-135

Lab Sample ID: 480-108183-5

Date Collected: 10/21/16 04:09

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.4		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:44	1

Client Sample ID: KE-BFC-261B-136

Lab Sample ID: 480-108183-6

Date Collected: 10/21/16 04:09

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.8		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:47	1

Client Sample ID: KE-BFC-261A-137

Lab Sample ID: 480-108183-7

Date Collected: 10/21/16 04:10

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.6		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:49	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-261A-138

Date Collected: 10/21/16 04:11

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-8

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.8		1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 09:52	1

Client Sample ID: KE-BFC-261A-139

Date Collected: 10/21/16 04:12

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-9

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.9		1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 09:55	1

Client Sample ID: KE-BFC-261A-140

Date Collected: 10/21/16 04:12

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-10

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.1		1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 10:04	1

Client Sample ID: KE-BFC-261A-141

Date Collected: 10/21/16 04:13

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-11

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.99	J	1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 10:07	1

Client Sample ID: KE-BFC-261A-142

Date Collected: 10/21/16 04:13

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-12

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.95	J	1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 10:10	1

Client Sample ID: KE-WC-SEC-143

Date Collected: 10/21/16 04:20

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-13

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.6		1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 10:12	1

Client Sample ID: KE-CSC-311-144

Date Collected: 10/21/16 04:24

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-14

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	37.7		1.0	0.17	ug/L	—	11/21/16 13:40	11/21/16 19:37	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-WC-SEC-145

Lab Sample ID: 480-108183-15

Date Collected: 10/21/16 04:25

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.63	J	1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 10:20	1

Client Sample ID: KE-BFC-MSB-146

Lab Sample ID: 480-108183-16

Date Collected: 10/21/16 04:29

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L	—	11/16/16 18:55	11/17/16 10:23	1

Client Sample ID: KE-BFC-MSB-147

Lab Sample ID: 480-108183-17

Date Collected: 10/21/16 04:30

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.7		1.0	0.17	ug/L	—	11/18/16 18:00	11/19/16 03:20	1

Client Sample ID: KE-CFC-369-148

Lab Sample ID: 480-108183-18

Date Collected: 10/21/16 04:32

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.1		1.0	0.17	ug/L	—	11/18/16 18:00	11/19/16 03:31	1

Client Sample ID: KE-CSC-JC-149

Lab Sample ID: 480-108183-19

Date Collected: 10/21/16 04:36

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.8		1.0	0.17	ug/L	—	11/18/16 18:00	11/19/16 03:34	1

Client Sample ID: KE-WC-CCM-150

Lab Sample ID: 480-108183-20

Date Collected: 10/21/16 04:37

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.46	J	1.0	0.17	ug/L	—	11/18/16 18:00	11/19/16 03:37	1

Client Sample ID: KE-BFC-361-151

Lab Sample ID: 480-108183-21

Date Collected: 10/21/16 04:38

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.4		1.0	0.17	ug/L	—	11/18/16 18:00	11/19/16 03:39	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-361-152

Lab Sample ID: 480-108183-22

Date Collected: 10/21/16 04:39

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.9		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 03:49	1

Client Sample ID: KE-BFC-361-153

Lab Sample ID: 480-108183-23

Date Collected: 10/21/16 04:39

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.8		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 03:51	1

Client Sample ID: KE-BFC-361-154

Lab Sample ID: 480-108183-24

Date Collected: 10/21/16 04:40

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.7		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 03:54	1

Client Sample ID: KE-BFC-361-155

Lab Sample ID: 480-108183-25

Date Collected: 10/21/16 04:40

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.8		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 03:57	1

Client Sample ID: KE-BFC-361-156

Lab Sample ID: 480-108183-26

Date Collected: 10/21/16 04:41

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.9		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 04:00	1

Client Sample ID: KE-BFC-359-157

Lab Sample ID: 480-108183-27

Date Collected: 10/21/16 04:42

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.7		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 04:02	1

Client Sample ID: KE-BFC-359-158

Lab Sample ID: 480-108183-28

Date Collected: 10/21/16 04:42

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.8		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 04:05	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-359-159

Lab Sample ID: 480-108183-29

Date Collected: 10/21/16 04:43

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.8		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 04:08	1

Client Sample ID: KE-BFC-359-160

Lab Sample ID: 480-108183-30

Date Collected: 10/21/16 04:43

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.7		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 04:11	1

Client Sample ID: KE-BFC-359-161

Lab Sample ID: 480-108183-31

Date Collected: 10/21/16 04:44

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.0		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 04:14	1

Client Sample ID: KE-BFC-359-162

Lab Sample ID: 480-108183-32

Date Collected: 10/21/16 04:45

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.2		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 04:23	1

Client Sample ID: KE-CFC-323-163

Lab Sample ID: 480-108183-33

Date Collected: 10/21/16 04:53

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	41.3		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 04:39	1

Client Sample ID: KE-CFC-323-164

Lab Sample ID: 480-108183-34

Date Collected: 10/21/16 04:53

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	35.0		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 04:50	1

Client Sample ID: KE-CFC-323-165

Lab Sample ID: 480-108183-35

Date Collected: 10/21/16 04:54

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	25.9		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 04:59	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-323-166

Date Collected: 10/21/16 04:54

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-36

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	15.4		1.0	0.17	ug/L	—	11/18/16 18:20	11/19/16 05:02	1

Client Sample ID: KE-CFC-323-167

Date Collected: 10/21/16 04:55

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-37

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.9		1.0	0.17	ug/L	—	11/18/16 18:20	11/19/16 05:05	1

Client Sample ID: KE-CFC-323-168

Date Collected: 10/21/16 04:55

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-38

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.7		1.0	0.17	ug/L	—	11/18/16 18:20	11/19/16 05:07	1

Client Sample ID: KE-CFC-323-169

Date Collected: 10/21/16 04:56

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-39

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.3		1.0	0.17	ug/L	—	11/18/16 18:20	11/19/16 05:10	1

Client Sample ID: KE-CFC-323-170

Date Collected: 10/21/16 04:56

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-40

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.2		1.0	0.17	ug/L	—	11/18/16 18:20	11/19/16 05:13	1

Client Sample ID: KE-CFC-325-171

Date Collected: 10/21/16 05:05

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-41

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.1		1.0	0.17	ug/L	—	11/18/16 18:20	11/19/16 05:16	1

Client Sample ID: KE-CFC-325-172

Date Collected: 10/21/16 05:05

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-42

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.9		1.0	0.17	ug/L	—	11/18/16 18:20	11/19/16 05:18	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-325-173

Lab Sample ID: 480-108183-43

Date Collected: 10/21/16 05:06

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.0		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 05:21	1

Client Sample ID: KE-CFC-325-174

Lab Sample ID: 480-108183-44

Date Collected: 10/21/16 05:06

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.4		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 05:24	1

Client Sample ID: KE-CFC-325-175

Lab Sample ID: 480-108183-45

Date Collected: 10/21/16 05:07

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.3		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 05:33	1

Client Sample ID: KE-CFC-325-176

Lab Sample ID: 480-108183-46

Date Collected: 10/21/16 05:07

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.8		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 05:36	1

Client Sample ID: KE-CFC-325-177

Lab Sample ID: 480-108183-47

Date Collected: 10/21/16 05:09

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.3		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 05:39	1

Client Sample ID: KE-CFC-325-178

Lab Sample ID: 480-108183-48

Date Collected: 10/21/16 05:09

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.1		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 05:42	1

Client Sample ID: KE-CFC-327-179

Lab Sample ID: 480-108183-49

Date Collected: 10/21/16 05:14

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.80	J	1.0	0.17	ug/L		11/18/16 18:40	11/19/16 05:57	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-327-180

Lab Sample ID: 480-108183-50

Date Collected: 10/21/16 05:14

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.8		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:15	1

Client Sample ID: KE-CFC-327-181

Lab Sample ID: 480-108183-51

Date Collected: 10/21/16 05:15

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.4		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:18	1

Client Sample ID: KE-CFC-327-182

Lab Sample ID: 480-108183-52

Date Collected: 10/21/16 05:15

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.7		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:21	1

Client Sample ID: KE-CFC-327-183

Lab Sample ID: 480-108183-53

Date Collected: 10/21/16 05:16

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.1		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:23	1

Client Sample ID: KE-CFC-327-184

Lab Sample ID: 480-108183-54

Date Collected: 10/21/16 05:16

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.9		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:26	1

Client Sample ID: KE-CFC-327-185

Lab Sample ID: 480-108183-55

Date Collected: 10/21/16 05:17

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.6		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:29	1

Client Sample ID: KE-CFC-327-186

Lab Sample ID: 480-108183-56

Date Collected: 10/21/16 05:17

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.0		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:32	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-WSB-187

Date Collected: 10/21/16 05:21

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-57

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	13.5		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:34	1

Client Sample ID: KE-BFC-WSB-188

Date Collected: 10/21/16 05:21

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-58

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.1		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:44	1

Client Sample ID: KE-BFC-WSB-189

Date Collected: 10/21/16 05:21

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-59

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	14.2		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:47	1

Client Sample ID: KE-BFC-MSB-190

Date Collected: 10/21/16 05:24

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-60

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	16.8		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:49	1

Client Sample ID: KE-BFC-MSB-191

Date Collected: 10/21/16 05:24

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-61

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.2		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:52	1

Client Sample ID: KE-WC-CCE-192

Date Collected: 10/21/16 05:25

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-62

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.53	J	1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:55	1

Client Sample ID: KE-CSH-JC-193

Date Collected: 10/21/16 05:26

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-63

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	23.2		1.0	0.17	ug/L	—	11/18/16 18:40	11/19/16 06:58	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-324-194

Lab Sample ID: 480-108183-64

Date Collected: 10/21/16 05:32

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.2		1.0	0.17	ug/L		11/18/16 18:40	11/19/16 07:00	1

Client Sample ID: KE-CFC-333-195

Lab Sample ID: 480-108183-65

Date Collected: 10/21/16 05:35

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.5		1.0	0.17	ug/L		11/18/16 19:00	11/19/16 07:24	1

Client Sample ID: KE-CFC-333-196

Lab Sample ID: 480-108183-66

Date Collected: 10/21/16 05:35

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.6		1.0	0.17	ug/L		11/18/16 19:00	11/19/16 07:35	1

Client Sample ID: KE-CFC-333-197

Lab Sample ID: 480-108183-67

Date Collected: 10/21/16 05:36

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.3		1.0	0.17	ug/L		11/18/16 19:00	11/19/16 07:37	1

Client Sample ID: KE-CFC-333-198

Lab Sample ID: 480-108183-68

Date Collected: 10/21/16 05:36

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.0		1.0	0.17	ug/L		11/18/16 19:00	11/19/16 07:40	1

Client Sample ID: KE-CFC-333-199

Lab Sample ID: 480-108183-69

Date Collected: 10/21/16 05:37

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.6		1.0	0.17	ug/L		11/18/16 19:00	11/19/16 07:43	1

Client Sample ID: KE-CFC-333-200

Lab Sample ID: 480-108183-70

Date Collected: 10/21/16 05:37

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.0		1.0	0.17	ug/L		11/18/16 19:00	11/19/16 07:53	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-333-201

Date Collected: 10/21/16 05:38

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-71

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.7		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 07:55	1

Client Sample ID: KE-CFC-335-202

Date Collected: 10/21/16 05:43

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-72

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.2		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 07:58	1

Client Sample ID: KE-CFC-335-203

Date Collected: 10/21/16 05:43

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-73

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	33.7		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:00	1

Client Sample ID: KE-CFC-335-204

Date Collected: 10/21/16 05:44

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-74

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.0		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:03	1

Client Sample ID: KE-CFC-335-205

Date Collected: 10/21/16 05:44

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-75

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	14.2		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:06	1

Client Sample ID: KE-CFC-335-206

Date Collected: 10/21/16 05:45

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-76

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.3		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:08	1

Client Sample ID: KE-CFC-335-207

Date Collected: 10/21/16 05:45

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-77

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	12.8		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:11	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-335-208

Date Collected: 10/21/16 05:46

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-78

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.5		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:14	1

Client Sample ID: KE-CFC-335-209

Date Collected: 10/21/16 05:46

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-79

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.5		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:16	1

Client Sample ID: KE-CFC-337-210

Date Collected: 10/21/16 05:55

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-80

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.3		1.0	0.17	ug/L	—	11/18/16 19:00	11/19/16 08:25	1

Client Sample ID: KE-CFC-337-211

Date Collected: 10/21/16 05:55

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-81

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	14.1		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 08:41	1

Client Sample ID: KE-CFC-337-212

Date Collected: 10/21/16 05:56

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-82

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	10.7		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 08:51	1

Client Sample ID: KE-CFC-337-213

Date Collected: 10/21/16 05:56

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-83

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	32.5		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:00	1

Client Sample ID: KE-CFC-337-214

Date Collected: 10/21/16 05:57

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-84

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	12.4		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:03	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-337-215

Lab Sample ID: 480-108183-85

Date Collected: 10/21/16 05:57

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	14.0		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:06	1

Client Sample ID: KE-CFC-337-216

Lab Sample ID: 480-108183-86

Date Collected: 10/21/16 05:58

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.6		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:08	1

Client Sample ID: KE-CFC-337-217

Lab Sample ID: 480-108183-87

Date Collected: 10/21/16 05:58

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	14.3		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:11	1

Client Sample ID: KE-CFC-337-218

Lab Sample ID: 480-108183-88

Date Collected: 10/21/16 05:59

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.7		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:14	1

Client Sample ID: KE-CFC-337-219

Lab Sample ID: 480-108183-89

Date Collected: 10/21/16 05:59

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.7		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:16	1

Client Sample ID: KE-CFC-337-220

Lab Sample ID: 480-108183-90

Date Collected: 10/21/16 06:00

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	36.1		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:19	1

Client Sample ID: KE-CFC-337-221

Lab Sample ID: 480-108183-91

Date Collected: 10/21/16 06:00

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.4		1.0	0.17	ug/L	—	11/18/16 19:20	11/19/16 09:22	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-337-222

Lab Sample ID: 480-108183-92

Date Collected: 10/21/16 06:01

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.4		1.0	0.17	ug/L		11/18/16 19:20	11/19/16 09:24	1

Client Sample ID: KE-CFC-337-223

Lab Sample ID: 480-108183-93

Date Collected: 10/21/16 06:01

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.9		1.0	0.17	ug/L		11/18/16 19:20	11/19/16 09:33	1

Client Sample ID: KE-CFC-337-224

Lab Sample ID: 480-108183-94

Date Collected: 10/21/16 06:02

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.1		1.0	0.17	ug/L		11/18/16 19:20	11/19/16 09:36	1

Client Sample ID: KE-CFC-337-225

Lab Sample ID: 480-108183-95

Date Collected: 10/21/16 06:02

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.9		1.0	0.17	ug/L		11/18/16 19:20	11/19/16 09:39	1

Client Sample ID: KE-CFC-338-226

Lab Sample ID: 480-108183-96

Date Collected: 10/21/16 06:04

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	1.4		1.0	0.17	ug/L		11/18/16 19:20	11/19/16 09:41	1

Client Sample ID: KE-CFC-341-227

Lab Sample ID: 480-108183-97

Date Collected: 10/21/16 06:06

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.3		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 09:57	1

Client Sample ID: KE-CFC-34-228

Lab Sample ID: 480-108183-98

Date Collected: 10/21/16 06:06

Matrix: Water

Date Received: 10/21/16 10:30

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.7		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:13	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-343-229

Date Collected: 10/21/16 06:09

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-99

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	15.7		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:16	1

Client Sample ID: KE-CFC-343-230

Date Collected: 10/21/16 06:09

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-100

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.0		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:19	1

Client Sample ID: KE-CFC-343-231

Date Collected: 10/21/16 06:10

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-101

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.5		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:21	1

Client Sample ID: KE-CFC-343-232

Date Collected: 10/21/16 06:10

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-102

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.5		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:24	1

Client Sample ID: KE-CFC-343-233

Date Collected: 10/21/16 06:11

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-103

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.3		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:27	1

Client Sample ID: KE-CFC-343-234

Date Collected: 10/21/16 06:11

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-104

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.7		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:29	1

Client Sample ID: KE-CFC-343-236

Date Collected: 10/21/16 06:12

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-105

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.6		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 10:32	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-WC-NC-237

Date Collected: 10/21/16 06:14

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-106

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	0.80	J	1.0	0.17	ug/L	—	11/18/16 19:40	11/19/16 10:41	1

Client Sample ID: KE-CFC-349-239

Date Collected: 10/21/16 06:20

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-107

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	5.1		1.0	0.17	ug/L	—	11/18/16 19:40	11/19/16 10:44	1

Client Sample ID: KE-CFC-349-240

Date Collected: 10/21/16 06:20

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-108

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	4.5		1.0	0.17	ug/L	—	11/18/16 19:40	11/19/16 10:46	1

Client Sample ID: KE-CFC-349-241

Date Collected: 10/21/16 06:21

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-109

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.1		1.0	0.17	ug/L	—	11/18/16 19:40	11/19/16 10:49	1

Client Sample ID: KE-CFC-349-242

Date Collected: 10/21/16 06:21

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-110

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.3		1.0	0.17	ug/L	—	11/18/16 19:40	11/19/16 10:52	1

Client Sample ID: KE-CFC-349-243

Date Collected: 10/21/16 06:22

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-111

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.7		1.0	0.17	ug/L	—	11/18/16 19:40	11/19/16 10:54	1

Client Sample ID: KE-CFC-349-244

Date Collected: 10/21/16 06:22

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-112

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	35.8		1.0	0.17	ug/L	—	11/18/16 19:40	11/19/16 10:57	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-349-245

Date Collected: 10/21/16 06:23

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-113

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	51.0		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 14:02	1

Client Sample ID: KE-CFC-349-246

Date Collected: 10/21/16 06:23

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-114

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	31.9		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 02:59	1

Client Sample ID: KE-CFC-351-247

Date Collected: 10/21/16 06:29

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-115

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.5		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:01	1

Client Sample ID: KE-CFC-351-248

Date Collected: 10/21/16 06:29

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-116

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	29.6		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:04	1

Client Sample ID: KE-CFC-351-249

Date Collected: 10/21/16 06:30

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-117

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	26.5		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:07	1

Client Sample ID: KE-CFC-351-250

Date Collected: 10/21/16 06:30

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-118

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	28.2		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:16	1

Client Sample ID: KE-CFC-351-251

Date Collected: 10/21/16 06:31

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-119

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	62.1		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:19	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-351-252

Date Collected: 10/21/16 06:31

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-120

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	53.3		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:22	1

Client Sample ID: KE-CFC-351-253

Date Collected: 10/21/16 06:32

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-121

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	52.6		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:25	1

Client Sample ID: KE-CFC-351-254

Date Collected: 10/21/16 06:32

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-122

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.4		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:27	1

Client Sample ID: KE-CFC-353-255

Date Collected: 10/21/16 06:36

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-123

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.9		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:30	1

Client Sample ID: KE-CFC-355-257

Date Collected: 10/21/16 06:40

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-124

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	23.5		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:33	1

Client Sample ID: KE-CFC-355-258

Date Collected: 10/21/16 06:40

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-125

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	17.0		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:36	1

Client Sample ID: KE-CFC-355-259

Date Collected: 10/21/16 06:41

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-126

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.6		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:38	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-355-260

Date Collected: 10/21/16 06:41

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-127

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.0		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:41	1

Client Sample ID: KE-CFC-355-261

Date Collected: 10/21/16 06:42

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-128

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.4		1.0	0.17	ug/L	—	11/21/16 16:45	11/22/16 03:50	1

Client Sample ID: KE-CFC-355-262

Date Collected: 10/21/16 06:42

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-129

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.5		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:06	1

Client Sample ID: KE-CFC-355-263

Date Collected: 10/21/16 06:43

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-130

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.1		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:17	1

Client Sample ID: KE-CFC-355-264

Date Collected: 10/21/16 06:43

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-131

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	22.7		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:27	1

Client Sample ID: KE-WC-NC-265

Date Collected: 10/21/16 06:45

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-132

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	2.9		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:29	1

Client Sample ID: KE-CFC-359-266

Date Collected: 10/21/16 06:47

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-133

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.7		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:32	1

TestAmerica Buffalo

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-357-267

Date Collected: 10/21/16 06:48

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-134

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	27.5		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:35	1

Client Sample ID: KE-CFC-357-268

Date Collected: 10/21/16 06:49

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-135

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.7		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:38	1

Client Sample ID: KE-CFC-357-269

Date Collected: 10/21/16 06:49

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-136

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	6.9		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:40	1

Client Sample ID: KE-CFC-357-270

Date Collected: 10/21/16 06:49

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-137

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	9.1		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:43	1

Client Sample ID: KE-CFC-357-271

Date Collected: 10/21/16 06:50

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-138

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	7.1		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:46	1

Client Sample ID: KE-CFC-357-272

Date Collected: 10/21/16 06:50

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-139

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	11.4		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:49	1

Client Sample ID: KE-CFC-357-273

Date Collected: 10/21/16 06:51

Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-140

Matrix: Water

Method: 200.8 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	18.8		1.0	0.17	ug/L	—	11/21/16 17:00	11/22/16 04:51	1

TestAmerica Buffalo

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Method: 200.8 - Metals (ICP/MS)

Lab Sample ID: MB 480-329945/1-A
Matrix: Water
Analysis Batch: 332228

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 329945

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/16/16 18:55	11/17/16 09:12	1

Lab Sample ID: LCS 480-329945/2-A
Matrix: Water
Analysis Batch: 332228

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 329945

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	21.41		ug/L		107	85 - 115

Lab Sample ID: 480-108183-1 MS
Matrix: Water
Analysis Batch: 332228

Client Sample ID: KE-BFC-261B-131
Prep Type: Total/NA
Prep Batch: 329945

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	1.7		20.0	23.14		ug/L		107	70 - 130

Lab Sample ID: 480-108183-1 MSD
Matrix: Water
Analysis Batch: 332228

Client Sample ID: KE-BFC-261B-131
Prep Type: Total/NA
Prep Batch: 329945

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	1.7		20.0	23.49		ug/L		109	70 - 130	2	20

Lab Sample ID: 480-108183-16 MS
Matrix: Water
Analysis Batch: 332228

Client Sample ID: KE-BFC-MSB-146
Prep Type: Total/NA
Prep Batch: 329945

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	ND		20.0	21.72		ug/L		109	70 - 130

Lab Sample ID: 480-108183-16 MSD
Matrix: Water
Analysis Batch: 332228

Client Sample ID: KE-BFC-MSB-146
Prep Type: Total/NA
Prep Batch: 329945

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	ND		20.0	21.86		ug/L		109	70 - 130	1	20

Lab Sample ID: MB 480-331315/1-A
Matrix: Water
Analysis Batch: 332647

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 331315

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/18/16 18:00	11/19/16 03:15	1

Lab Sample ID: LCS 480-331315/2-A
Matrix: Water
Analysis Batch: 332647

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 331315

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	20.35		ug/L		102	85 - 115

TestAmerica Buffalo

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Lab Sample ID: 480-108183-17 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-BFC-MSB-147

Prep Type: Total/NA

Prep Batch: 331315

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	2.7		20.0	23.80		ug/L		106	70 - 130

Lab Sample ID: 480-108183-17 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-BFC-MSB-147

Prep Type: Total/NA

Prep Batch: 331315

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	2.7		20.0	23.42		ug/L		104	70 - 130	2	20

Lab Sample ID: 480-108183-32 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-BFC-359-162

Prep Type: Total/NA

Prep Batch: 331315

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	4.2		20.0	24.94		ug/L		104	70 - 130

Lab Sample ID: 480-108183-32 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-BFC-359-162

Prep Type: Total/NA

Prep Batch: 331315

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	4.2		20.0	25.12		ug/L		105	70 - 130	1	20

Lab Sample ID: MB 480-331316/1-A

Matrix: Water

Analysis Batch: 332647

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 331316

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/18/16 18:20	11/19/16 04:33	1

Lab Sample ID: LCS 480-331316/2-A

Matrix: Water

Analysis Batch: 332647

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 331316

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	20.97		ug/L		105	85 - 115

Lab Sample ID: 480-108183-33 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-323-163

Prep Type: Total/NA

Prep Batch: 331316

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	41.3		20.0	62.82		ug/L		108	70 - 130

Lab Sample ID: 480-108183-33 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-323-163

Prep Type: Total/NA

Prep Batch: 331316

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	41.3		20.0	63.20		ug/L		109	70 - 130	1	20

TestAmerica Buffalo

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Method: 200.8 - Metals (ICP/MS) (Continued)

Lab Sample ID: 480-108183-48 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-325-178

Prep Type: Total/NA

Prep Batch: 331316

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	2.1		20.0	22.92		ug/L		104	70 - 130

Lab Sample ID: 480-108183-48 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-325-178

Prep Type: Total/NA

Prep Batch: 331316

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	2.1		20.0	23.21		ug/L		105	70 - 130	1	20

Lab Sample ID: MB 480-331317/1-A

Matrix: Water

Analysis Batch: 332647

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 331317

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/18/16 18:40	11/19/16 05:52	1

Lab Sample ID: LCS 480-331317/2-A

Matrix: Water

Analysis Batch: 332647

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 331317

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	20.70		ug/L		103	85 - 115

Lab Sample ID: 480-108183-49 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-327-179

Prep Type: Total/NA

Prep Batch: 331317

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	0.80	J	20.0	22.07		ug/L		106	70 - 130

Lab Sample ID: 480-108183-49 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-327-179

Prep Type: Total/NA

Prep Batch: 331317

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	0.80	J	20.0	22.07		ug/L		106	70 - 130	0	20

Lab Sample ID: 480-108183-64 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-324-194

Prep Type: Total/NA

Prep Batch: 331317

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	6.2		20.0	27.04		ug/L		104	70 - 130

Lab Sample ID: 480-108183-64 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-324-194

Prep Type: Total/NA

Prep Batch: 331317

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	6.2		20.0	27.00		ug/L		104	70 - 130	0	20

TestAmerica Buffalo

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Lab Sample ID: MB 480-331318/1-A
Matrix: Water
Analysis Batch: 332647

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 331318

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/18/16 19:00	11/19/16 07:18	1

Lab Sample ID: LCS 480-331318/2-A
Matrix: Water
Analysis Batch: 332647

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 331318

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	20.86		ug/L		104	85 - 115

Lab Sample ID: 480-108183-65 MS
Matrix: Water
Analysis Batch: 332647

Client Sample ID: KE-CFC-333-195
Prep Type: Total/NA
Prep Batch: 331318

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	3.5		20.0	24.71		ug/L		106	70 - 130

Lab Sample ID: 480-108183-65 MSD
Matrix: Water
Analysis Batch: 332647

Client Sample ID: KE-CFC-333-195
Prep Type: Total/NA
Prep Batch: 331318

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	3.5		20.0	24.52		ug/L		105	70 - 130	1	20

Lab Sample ID: 480-108183-80 MS
Matrix: Water
Analysis Batch: 332647

Client Sample ID: KE-CFC-337-210
Prep Type: Total/NA
Prep Batch: 331318

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	6.3		20.0	27.31		ug/L		105	70 - 130

Lab Sample ID: 480-108183-80 MSD
Matrix: Water
Analysis Batch: 332647

Client Sample ID: KE-CFC-337-210
Prep Type: Total/NA
Prep Batch: 331318

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	6.3		20.0	27.60		ug/L		107	70 - 130	1	20

Lab Sample ID: MB 480-331319/1-A
Matrix: Water
Analysis Batch: 332647

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 331319

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/18/16 19:20	11/19/16 08:35	1

Lab Sample ID: LCS 480-331319/2-A
Matrix: Water
Analysis Batch: 332647

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 331319

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	21.35		ug/L		107	85 - 115

TestAmerica Buffalo

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Method: 200.8 - Metals (ICP/MS) (Continued)

Lab Sample ID: 480-108183-81 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-337-211

Prep Type: Total/NA

Prep Batch: 331319

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	14.1		20.0	35.40		ug/L		107	70 - 130

Lab Sample ID: 480-108183-81 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-337-211

Prep Type: Total/NA

Prep Batch: 331319

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	14.1		20.0	35.47		ug/L		107	70 - 130	0	20

Lab Sample ID: 480-108183-96 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-338-226

Prep Type: Total/NA

Prep Batch: 331319

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	1.4		20.0	22.62		ug/L		106	70 - 130

Lab Sample ID: 480-108183-96 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-338-226

Prep Type: Total/NA

Prep Batch: 331319

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	1.4		20.0	23.05		ug/L		108	70 - 130	2	20

Lab Sample ID: MB 480-331320/1-A

Matrix: Water

Analysis Batch: 332647

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 331320

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/18/16 19:40	11/19/16 09:51	1

Lab Sample ID: LCS 480-331320/2-A

Matrix: Water

Analysis Batch: 332647

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 331320

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	21.27		ug/L		106	85 - 115

Lab Sample ID: 480-108183-97 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-341-227

Prep Type: Total/NA

Prep Batch: 331320

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	8.3		20.0	29.78		ug/L		107	70 - 130

Lab Sample ID: 480-108183-97 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-341-227

Prep Type: Total/NA

Prep Batch: 331320

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	8.3		20.0	29.51		ug/L		106	70 - 130	1	20

TestAmerica Buffalo

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Lab Sample ID: 480-108183-112 MS

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-349-244

Prep Type: Total/NA

Prep Batch: 331320

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	35.8		20.0	57.57		ug/L		109	70 - 130

Lab Sample ID: 480-108183-112 MSD

Matrix: Water

Analysis Batch: 332647

Client Sample ID: KE-CFC-349-244

Prep Type: Total/NA

Prep Batch: 331320

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	35.8		20.0	56.95		ug/L		106	70 - 130	1	20

Lab Sample ID: MB 480-331321/1-A

Matrix: Water

Analysis Batch: 333089

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 331321

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/21/16 16:45	11/22/16 02:42	1

Lab Sample ID: LCS 480-331321/2-A

Matrix: Water

Analysis Batch: 333089

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 331321

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	21.36		ug/L		107	85 - 115

Lab Sample ID: 480-108183-113 MS

Matrix: Water

Analysis Batch: 333306

Client Sample ID: KE-CFC-349-245

Prep Type: Total/NA

Prep Batch: 331321

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	51.0		20.0	71.32		ug/L		102	70 - 130

Lab Sample ID: 480-108183-113 MSD

Matrix: Water

Analysis Batch: 333306

Client Sample ID: KE-CFC-349-245

Prep Type: Total/NA

Prep Batch: 331321

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	51.0		20.0	73.74		ug/L		114	70 - 130	3	20

Lab Sample ID: 480-108183-128 MS

Matrix: Water

Analysis Batch: 333089

Client Sample ID: KE-CFC-355-261

Prep Type: Total/NA

Prep Batch: 331321

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	9.4		20.0	30.79		ug/L		107	70 - 130

Lab Sample ID: 480-108183-128 MSD

Matrix: Water

Analysis Batch: 333089

Client Sample ID: KE-CFC-355-261

Prep Type: Total/NA

Prep Batch: 331321

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	Limit
Lead	9.4		20.0	30.75		ug/L		107	70 - 130	0	20

TestAmerica Buffalo

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Method: 200.8 - Metals (ICP/MS) (Continued)

Lab Sample ID: MB 480-331322/1-A
Matrix: Water
Analysis Batch: 333089

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 331322

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/21/16 17:00	11/22/16 04:01	1

Lab Sample ID: LCS 480-331322/2-A
Matrix: Water
Analysis Batch: 333089

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 331322

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	21.37		ug/L		107	85 - 115

Lab Sample ID: 480-108183-129 MS
Matrix: Water
Analysis Batch: 333089

Client Sample ID: KE-CFC-355-262
Prep Type: Total/NA
Prep Batch: 331322

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	9.5		20.0	30.17		ug/L		104	70 - 130

Lab Sample ID: 480-108183-129 MSD
Matrix: Water
Analysis Batch: 333089

Client Sample ID: KE-CFC-355-262
Prep Type: Total/NA
Prep Batch: 331322

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec. Limits	RPD	RPD Limit
Lead	9.5		20.0	30.62		ug/L		106	70 - 130	1	20

Lab Sample ID: MB 480-332852/1-A
Matrix: Water
Analysis Batch: 333084

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 332852

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		1.0	0.17	ug/L		11/21/16 13:40	11/21/16 18:17	1

Lab Sample ID: LCS 480-332852/2-A
Matrix: Water
Analysis Batch: 333084

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 332852

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	20.0	19.59		ug/L		98	85 - 115

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals

Prep Batch: 329945

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-1	KE-BFC-261B-131	Total/NA	Water	200 Series	
480-108183-2	KE-BFC-261B-132	Total/NA	Water	200 Series	
480-108183-3	KE-BFC-261B-133	Total/NA	Water	200 Series	
480-108183-4	KE-BFC-261B-134	Total/NA	Water	200 Series	
480-108183-5	KE-BFC-261B-135	Total/NA	Water	200 Series	
480-108183-6	KE-BFC-261B-136	Total/NA	Water	200 Series	
480-108183-7	KE-BFC-261A-137	Total/NA	Water	200 Series	
480-108183-8	KE-BFC-261A-138	Total/NA	Water	200 Series	
480-108183-9	KE-BFC-261A-139	Total/NA	Water	200 Series	
480-108183-10	KE-BFC-261A-140	Total/NA	Water	200 Series	
480-108183-11	KE-BFC-261A-141	Total/NA	Water	200 Series	
480-108183-12	KE-BFC-261A-142	Total/NA	Water	200 Series	
480-108183-13	KE-WC-SEC-143	Total/NA	Water	200 Series	
480-108183-15	KE-WC-SEC-145	Total/NA	Water	200 Series	
480-108183-16	KE-BFC-MSB-146	Total/NA	Water	200 Series	
MB 480-329945/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-329945/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-1 MS	KE-BFC-261B-131	Total/NA	Water	200 Series	
480-108183-1 MSD	KE-BFC-261B-131	Total/NA	Water	200 Series	
480-108183-16 MS	KE-BFC-MSB-146	Total/NA	Water	200 Series	
480-108183-16 MSD	KE-BFC-MSB-146	Total/NA	Water	200 Series	

Prep Batch: 331315

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-17	KE-BFC-MSB-147	Total/NA	Water	200 Series	
480-108183-18	KE-CFC-369-148	Total/NA	Water	200 Series	
480-108183-19	KE-CSC-JC-149	Total/NA	Water	200 Series	
480-108183-20	KE-WC-CCM-150	Total/NA	Water	200 Series	
480-108183-21	KE-BFC-361-151	Total/NA	Water	200 Series	
480-108183-22	KE-BFC-361-152	Total/NA	Water	200 Series	
480-108183-23	KE-BFC-361-153	Total/NA	Water	200 Series	
480-108183-24	KE-BFC-361-154	Total/NA	Water	200 Series	
480-108183-25	KE-BFC-361-155	Total/NA	Water	200 Series	
480-108183-26	KE-BFC-361-156	Total/NA	Water	200 Series	
480-108183-27	KE-BFC-359-157	Total/NA	Water	200 Series	
480-108183-28	KE-BFC-359-158	Total/NA	Water	200 Series	
480-108183-29	KE-BFC-359-159	Total/NA	Water	200 Series	
480-108183-30	KE-BFC-359-160	Total/NA	Water	200 Series	
480-108183-31	KE-BFC-359-161	Total/NA	Water	200 Series	
480-108183-32	KE-BFC-359-162	Total/NA	Water	200 Series	
MB 480-331315/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331315/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-17 MS	KE-BFC-MSB-147	Total/NA	Water	200 Series	
480-108183-17 MSD	KE-BFC-MSB-147	Total/NA	Water	200 Series	
480-108183-32 MS	KE-BFC-359-162	Total/NA	Water	200 Series	
480-108183-32 MSD	KE-BFC-359-162	Total/NA	Water	200 Series	

Prep Batch: 331316

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-33	KE-CFC-323-163	Total/NA	Water	200 Series	
480-108183-34	KE-CFC-323-164	Total/NA	Water	200 Series	

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Prep Batch: 331316 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-35	KE-CFC-323-165	Total/NA	Water	200 Series	
480-108183-36	KE-CFC-323-166	Total/NA	Water	200 Series	
480-108183-37	KE-CFC-323-167	Total/NA	Water	200 Series	
480-108183-38	KE-CFC-323-168	Total/NA	Water	200 Series	
480-108183-39	KE-CFC-323-169	Total/NA	Water	200 Series	
480-108183-40	KE-CFC-323-170	Total/NA	Water	200 Series	
480-108183-41	KE-CFC-325-171	Total/NA	Water	200 Series	
480-108183-42	KE-CFC-325-172	Total/NA	Water	200 Series	
480-108183-43	KE-CFC-325-173	Total/NA	Water	200 Series	
480-108183-44	KE-CFC-325-174	Total/NA	Water	200 Series	
480-108183-45	KE-CFC-325-175	Total/NA	Water	200 Series	
480-108183-46	KE-CFC-325-176	Total/NA	Water	200 Series	
480-108183-47	KE-CFC-325-177	Total/NA	Water	200 Series	
480-108183-48	KE-CFC-325-178	Total/NA	Water	200 Series	
MB 480-331316/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331316/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-33 MS	KE-CFC-323-163	Total/NA	Water	200 Series	
480-108183-33 MSD	KE-CFC-323-163	Total/NA	Water	200 Series	
480-108183-48 MS	KE-CFC-325-178	Total/NA	Water	200 Series	
480-108183-48 MSD	KE-CFC-325-178	Total/NA	Water	200 Series	

Prep Batch: 331317

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-49	KE-CFC-327-179	Total/NA	Water	200 Series	
480-108183-50	KE-CFC-327-180	Total/NA	Water	200 Series	
480-108183-51	KE-CFC-327-181	Total/NA	Water	200 Series	
480-108183-52	KE-CFC-327-182	Total/NA	Water	200 Series	
480-108183-53	KE-CFC-327-183	Total/NA	Water	200 Series	
480-108183-54	KE-CFC-327-184	Total/NA	Water	200 Series	
480-108183-55	KE-CFC-327-185	Total/NA	Water	200 Series	
480-108183-56	KE-CFC-327-186	Total/NA	Water	200 Series	
480-108183-57	KE-BFC-WSB-187	Total/NA	Water	200 Series	
480-108183-58	KE-BFC-WSB-188	Total/NA	Water	200 Series	
480-108183-59	KE-BFC-WSB-189	Total/NA	Water	200 Series	
480-108183-60	KE-BFC-MSB-190	Total/NA	Water	200 Series	
480-108183-61	KE-BFC-MSB-191	Total/NA	Water	200 Series	
480-108183-62	KE-WC-CCE-192	Total/NA	Water	200 Series	
480-108183-63	KE-CSH-JC-193	Total/NA	Water	200 Series	
480-108183-64	KE-CFC-324-194	Total/NA	Water	200 Series	
MB 480-331317/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331317/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-49 MS	KE-CFC-327-179	Total/NA	Water	200 Series	
480-108183-49 MSD	KE-CFC-327-179	Total/NA	Water	200 Series	
480-108183-64 MS	KE-CFC-324-194	Total/NA	Water	200 Series	
480-108183-64 MSD	KE-CFC-324-194	Total/NA	Water	200 Series	

Prep Batch: 331318

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-65	KE-CFC-333-195	Total/NA	Water	200 Series	
480-108183-66	KE-CFC-333-196	Total/NA	Water	200 Series	
480-108183-67	KE-CFC-333-197	Total/NA	Water	200 Series	

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Prep Batch: 331318 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-68	KE-CFC-333-198	Total/NA	Water	200 Series	
480-108183-69	KE-CFC-333-199	Total/NA	Water	200 Series	
480-108183-70	KE-CFC-333-200	Total/NA	Water	200 Series	
480-108183-71	KE-CFC-333-201	Total/NA	Water	200 Series	
480-108183-72	KE-CFC-335-202	Total/NA	Water	200 Series	
480-108183-73	KE-CFC-335-203	Total/NA	Water	200 Series	
480-108183-74	KE-CFC-335-204	Total/NA	Water	200 Series	
480-108183-75	KE-CFC-335-205	Total/NA	Water	200 Series	
480-108183-76	KE-CFC-335-206	Total/NA	Water	200 Series	
480-108183-77	KE-CFC-335-207	Total/NA	Water	200 Series	
480-108183-78	KE-CFC-335-208	Total/NA	Water	200 Series	
480-108183-79	KE-CFC-335-209	Total/NA	Water	200 Series	
480-108183-80	KE-CFC-337-210	Total/NA	Water	200 Series	
MB 480-331318/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331318/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-65 MS	KE-CFC-333-195	Total/NA	Water	200 Series	
480-108183-65 MSD	KE-CFC-333-195	Total/NA	Water	200 Series	
480-108183-80 MS	KE-CFC-337-210	Total/NA	Water	200 Series	
480-108183-80 MSD	KE-CFC-337-210	Total/NA	Water	200 Series	

Prep Batch: 331319

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-81	KE-CFC-337-211	Total/NA	Water	200 Series	
480-108183-82	KE-CFC-337-212	Total/NA	Water	200 Series	
480-108183-83	KE-CFC-337-213	Total/NA	Water	200 Series	
480-108183-84	KE-CFC-337-214	Total/NA	Water	200 Series	
480-108183-85	KE-CFC-337-215	Total/NA	Water	200 Series	
480-108183-86	KE-CFC-337-216	Total/NA	Water	200 Series	
480-108183-87	KE-CFC-337-217	Total/NA	Water	200 Series	
480-108183-88	KE-CFC-337-218	Total/NA	Water	200 Series	
480-108183-89	KE-CFC-337-219	Total/NA	Water	200 Series	
480-108183-90	KE-CFC-337-220	Total/NA	Water	200 Series	
480-108183-91	KE-CFC-337-221	Total/NA	Water	200 Series	
480-108183-92	KE-CFC-337-222	Total/NA	Water	200 Series	
480-108183-93	KE-CFC-337-223	Total/NA	Water	200 Series	
480-108183-94	KE-CFC-337-224	Total/NA	Water	200 Series	
480-108183-95	KE-CFC-337-225	Total/NA	Water	200 Series	
480-108183-96	KE-CFC-338-226	Total/NA	Water	200 Series	
MB 480-331319/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331319/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-81 MS	KE-CFC-337-211	Total/NA	Water	200 Series	
480-108183-81 MSD	KE-CFC-337-211	Total/NA	Water	200 Series	
480-108183-96 MS	KE-CFC-338-226	Total/NA	Water	200 Series	
480-108183-96 MSD	KE-CFC-338-226	Total/NA	Water	200 Series	

Prep Batch: 331320

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-97	KE-CFC-341-227	Total/NA	Water	200 Series	
480-108183-98	KE-CFC-34-228	Total/NA	Water	200 Series	
480-108183-99	KE-CFC-343-229	Total/NA	Water	200 Series	
480-108183-100	KE-CFC-343-230	Total/NA	Water	200 Series	

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Prep Batch: 331320 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-101	KE-CFC-343-231	Total/NA	Water	200 Series	
480-108183-102	KE-CFC-343-232	Total/NA	Water	200 Series	
480-108183-103	KE-CFC-343-233	Total/NA	Water	200 Series	
480-108183-104	KE-CFC-343-234	Total/NA	Water	200 Series	
480-108183-105	KE-CFC-343-236	Total/NA	Water	200 Series	
480-108183-106	KE-WC-NC-237	Total/NA	Water	200 Series	
480-108183-107	KE-CFC-349-239	Total/NA	Water	200 Series	
480-108183-108	KE-CFC-349-240	Total/NA	Water	200 Series	
480-108183-109	KE-CFC-349-241	Total/NA	Water	200 Series	
480-108183-110	KE-CFC-349-242	Total/NA	Water	200 Series	
480-108183-111	KE-CFC-349-243	Total/NA	Water	200 Series	
480-108183-112	KE-CFC-349-244	Total/NA	Water	200 Series	
MB 480-331320/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331320/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-97 MS	KE-CFC-341-227	Total/NA	Water	200 Series	
480-108183-97 MSD	KE-CFC-341-227	Total/NA	Water	200 Series	
480-108183-112 MS	KE-CFC-349-244	Total/NA	Water	200 Series	
480-108183-112 MSD	KE-CFC-349-244	Total/NA	Water	200 Series	

Prep Batch: 331321

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-113	KE-CFC-349-245	Total/NA	Water	200 Series	
480-108183-114	KE-CFC-349-246	Total/NA	Water	200 Series	
480-108183-115	KE-CFC-351-247	Total/NA	Water	200 Series	
480-108183-116	KE-CFC-351-248	Total/NA	Water	200 Series	
480-108183-117	KE-CFC-351-249	Total/NA	Water	200 Series	
480-108183-118	KE-CFC-351-250	Total/NA	Water	200 Series	
480-108183-119	KE-CFC-351-251	Total/NA	Water	200 Series	
480-108183-120	KE-CFC-351-252	Total/NA	Water	200 Series	
480-108183-121	KE-CFC-351-253	Total/NA	Water	200 Series	
480-108183-122	KE-CFC-351-254	Total/NA	Water	200 Series	
480-108183-123	KE-CFC-353-255	Total/NA	Water	200 Series	
480-108183-124	KE-CFC-355-257	Total/NA	Water	200 Series	
480-108183-125	KE-CFC-355-258	Total/NA	Water	200 Series	
480-108183-126	KE-CFC-355-259	Total/NA	Water	200 Series	
480-108183-127	KE-CFC-355-260	Total/NA	Water	200 Series	
480-108183-128	KE-CFC-355-261	Total/NA	Water	200 Series	
MB 480-331321/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331321/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-113 MS	KE-CFC-349-245	Total/NA	Water	200 Series	
480-108183-113 MSD	KE-CFC-349-245	Total/NA	Water	200 Series	
480-108183-128 MS	KE-CFC-355-261	Total/NA	Water	200 Series	
480-108183-128 MSD	KE-CFC-355-261	Total/NA	Water	200 Series	

Prep Batch: 331322

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-129	KE-CFC-355-262	Total/NA	Water	200 Series	
480-108183-130	KE-CFC-355-263	Total/NA	Water	200 Series	
480-108183-131	KE-CFC-355-264	Total/NA	Water	200 Series	
480-108183-132	KE-WC-NC-265	Total/NA	Water	200 Series	
480-108183-133	KE-CFC-359-266	Total/NA	Water	200 Series	

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Prep Batch: 331322 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-134	KE-CFC-357-267	Total/NA	Water	200 Series	
480-108183-135	KE-CFC-357-268	Total/NA	Water	200 Series	
480-108183-136	KE-CFC-357-269	Total/NA	Water	200 Series	
480-108183-137	KE-CFC-357-270	Total/NA	Water	200 Series	
480-108183-138	KE-CFC-357-271	Total/NA	Water	200 Series	
480-108183-139	KE-CFC-357-272	Total/NA	Water	200 Series	
480-108183-140	KE-CFC-357-273	Total/NA	Water	200 Series	
MB 480-331322/1-A	Method Blank	Total/NA	Water	200 Series	
LCS 480-331322/2-A	Lab Control Sample	Total/NA	Water	200 Series	
480-108183-129 MS	KE-CFC-355-262	Total/NA	Water	200 Series	
480-108183-129 MSD	KE-CFC-355-262	Total/NA	Water	200 Series	

Analysis Batch: 332228

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-1	KE-BFC-261B-131	Total/NA	Water	200.8	329945
480-108183-2	KE-BFC-261B-132	Total/NA	Water	200.8	329945
480-108183-3	KE-BFC-261B-133	Total/NA	Water	200.8	329945
480-108183-4	KE-BFC-261B-134	Total/NA	Water	200.8	329945
480-108183-5	KE-BFC-261B-135	Total/NA	Water	200.8	329945
480-108183-6	KE-BFC-261B-136	Total/NA	Water	200.8	329945
480-108183-7	KE-BFC-261A-137	Total/NA	Water	200.8	329945
480-108183-8	KE-BFC-261A-138	Total/NA	Water	200.8	329945
480-108183-9	KE-BFC-261A-139	Total/NA	Water	200.8	329945
480-108183-10	KE-BFC-261A-140	Total/NA	Water	200.8	329945
480-108183-11	KE-BFC-261A-141	Total/NA	Water	200.8	329945
480-108183-12	KE-BFC-261A-142	Total/NA	Water	200.8	329945
480-108183-13	KE-WC-SEC-143	Total/NA	Water	200.8	329945
480-108183-15	KE-WC-SEC-145	Total/NA	Water	200.8	329945
480-108183-16	KE-BFC-MSB-146	Total/NA	Water	200.8	329945
MB 480-329945/1-A	Method Blank	Total/NA	Water	200.8	329945
LCS 480-329945/2-A	Lab Control Sample	Total/NA	Water	200.8	329945
480-108183-1 MS	KE-BFC-261B-131	Total/NA	Water	200.8	329945
480-108183-1 MSD	KE-BFC-261B-131	Total/NA	Water	200.8	329945
480-108183-16 MS	KE-BFC-MSB-146	Total/NA	Water	200.8	329945
480-108183-16 MSD	KE-BFC-MSB-146	Total/NA	Water	200.8	329945

Analysis Batch: 332647

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-17	KE-BFC-MSB-147	Total/NA	Water	200.8	331315
480-108183-18	KE-CFC-369-148	Total/NA	Water	200.8	331315
480-108183-19	KE-CSC-JC-149	Total/NA	Water	200.8	331315
480-108183-20	KE-WC-CCM-150	Total/NA	Water	200.8	331315
480-108183-21	KE-BFC-361-151	Total/NA	Water	200.8	331315
480-108183-22	KE-BFC-361-152	Total/NA	Water	200.8	331315
480-108183-23	KE-BFC-361-153	Total/NA	Water	200.8	331315
480-108183-24	KE-BFC-361-154	Total/NA	Water	200.8	331315
480-108183-25	KE-BFC-361-155	Total/NA	Water	200.8	331315
480-108183-26	KE-BFC-361-156	Total/NA	Water	200.8	331315
480-108183-27	KE-BFC-359-157	Total/NA	Water	200.8	331315
480-108183-28	KE-BFC-359-158	Total/NA	Water	200.8	331315
480-108183-29	KE-BFC-359-159	Total/NA	Water	200.8	331315

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Analysis Batch: 332647 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-30	KE-BFC-359-160	Total/NA	Water	200.8	331315
480-108183-31	KE-BFC-359-161	Total/NA	Water	200.8	331315
480-108183-32	KE-BFC-359-162	Total/NA	Water	200.8	331315
480-108183-33	KE-CFC-323-163	Total/NA	Water	200.8	331316
480-108183-34	KE-CFC-323-164	Total/NA	Water	200.8	331316
480-108183-35	KE-CFC-323-165	Total/NA	Water	200.8	331316
480-108183-36	KE-CFC-323-166	Total/NA	Water	200.8	331316
480-108183-37	KE-CFC-323-167	Total/NA	Water	200.8	331316
480-108183-38	KE-CFC-323-168	Total/NA	Water	200.8	331316
480-108183-39	KE-CFC-323-169	Total/NA	Water	200.8	331316
480-108183-40	KE-CFC-323-170	Total/NA	Water	200.8	331316
480-108183-41	KE-CFC-325-171	Total/NA	Water	200.8	331316
480-108183-42	KE-CFC-325-172	Total/NA	Water	200.8	331316
480-108183-43	KE-CFC-325-173	Total/NA	Water	200.8	331316
480-108183-44	KE-CFC-325-174	Total/NA	Water	200.8	331316
480-108183-45	KE-CFC-325-175	Total/NA	Water	200.8	331316
480-108183-46	KE-CFC-325-176	Total/NA	Water	200.8	331316
480-108183-47	KE-CFC-325-177	Total/NA	Water	200.8	331316
480-108183-48	KE-CFC-325-178	Total/NA	Water	200.8	331316
480-108183-49	KE-CFC-327-179	Total/NA	Water	200.8	331317
480-108183-50	KE-CFC-327-180	Total/NA	Water	200.8	331317
480-108183-51	KE-CFC-327-181	Total/NA	Water	200.8	331317
480-108183-52	KE-CFC-327-182	Total/NA	Water	200.8	331317
480-108183-53	KE-CFC-327-183	Total/NA	Water	200.8	331317
480-108183-54	KE-CFC-327-184	Total/NA	Water	200.8	331317
480-108183-55	KE-CFC-327-185	Total/NA	Water	200.8	331317
480-108183-56	KE-CFC-327-186	Total/NA	Water	200.8	331317
480-108183-57	KE-BFC-WSB-187	Total/NA	Water	200.8	331317
480-108183-58	KE-BFC-WSB-188	Total/NA	Water	200.8	331317
480-108183-59	KE-BFC-WSB-189	Total/NA	Water	200.8	331317
480-108183-60	KE-BFC-MSB-190	Total/NA	Water	200.8	331317
480-108183-61	KE-BFC-MSB-191	Total/NA	Water	200.8	331317
480-108183-62	KE-WC-CCE-192	Total/NA	Water	200.8	331317
480-108183-63	KE-CSH-JC-193	Total/NA	Water	200.8	331317
480-108183-64	KE-CFC-324-194	Total/NA	Water	200.8	331317
480-108183-65	KE-CFC-333-195	Total/NA	Water	200.8	331318
480-108183-66	KE-CFC-333-196	Total/NA	Water	200.8	331318
480-108183-67	KE-CFC-333-197	Total/NA	Water	200.8	331318
480-108183-68	KE-CFC-333-198	Total/NA	Water	200.8	331318
480-108183-69	KE-CFC-333-199	Total/NA	Water	200.8	331318
480-108183-70	KE-CFC-333-200	Total/NA	Water	200.8	331318
480-108183-71	KE-CFC-333-201	Total/NA	Water	200.8	331318
480-108183-72	KE-CFC-335-202	Total/NA	Water	200.8	331318
480-108183-73	KE-CFC-335-203	Total/NA	Water	200.8	331318
480-108183-74	KE-CFC-335-204	Total/NA	Water	200.8	331318
480-108183-75	KE-CFC-335-205	Total/NA	Water	200.8	331318
480-108183-76	KE-CFC-335-206	Total/NA	Water	200.8	331318
480-108183-77	KE-CFC-335-207	Total/NA	Water	200.8	331318
480-108183-78	KE-CFC-335-208	Total/NA	Water	200.8	331318
480-108183-79	KE-CFC-335-209	Total/NA	Water	200.8	331318
480-108183-80	KE-CFC-337-210	Total/NA	Water	200.8	331318

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Analysis Batch: 332647 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-81	KE-CFC-337-211	Total/NA	Water	200.8	331319
480-108183-82	KE-CFC-337-212	Total/NA	Water	200.8	331319
480-108183-83	KE-CFC-337-213	Total/NA	Water	200.8	331319
480-108183-84	KE-CFC-337-214	Total/NA	Water	200.8	331319
480-108183-85	KE-CFC-337-215	Total/NA	Water	200.8	331319
480-108183-86	KE-CFC-337-216	Total/NA	Water	200.8	331319
480-108183-87	KE-CFC-337-217	Total/NA	Water	200.8	331319
480-108183-88	KE-CFC-337-218	Total/NA	Water	200.8	331319
480-108183-89	KE-CFC-337-219	Total/NA	Water	200.8	331319
480-108183-90	KE-CFC-337-220	Total/NA	Water	200.8	331319
480-108183-91	KE-CFC-337-221	Total/NA	Water	200.8	331319
480-108183-92	KE-CFC-337-222	Total/NA	Water	200.8	331319
480-108183-93	KE-CFC-337-223	Total/NA	Water	200.8	331319
480-108183-94	KE-CFC-337-224	Total/NA	Water	200.8	331319
480-108183-95	KE-CFC-337-225	Total/NA	Water	200.8	331319
480-108183-96	KE-CFC-338-226	Total/NA	Water	200.8	331319
480-108183-97	KE-CFC-341-227	Total/NA	Water	200.8	331320
480-108183-98	KE-CFC-34-228	Total/NA	Water	200.8	331320
480-108183-99	KE-CFC-343-229	Total/NA	Water	200.8	331320
480-108183-100	KE-CFC-343-230	Total/NA	Water	200.8	331320
480-108183-101	KE-CFC-343-231	Total/NA	Water	200.8	331320
480-108183-102	KE-CFC-343-232	Total/NA	Water	200.8	331320
480-108183-103	KE-CFC-343-233	Total/NA	Water	200.8	331320
480-108183-104	KE-CFC-343-234	Total/NA	Water	200.8	331320
480-108183-105	KE-CFC-343-236	Total/NA	Water	200.8	331320
480-108183-106	KE-WC-NC-237	Total/NA	Water	200.8	331320
480-108183-107	KE-CFC-349-239	Total/NA	Water	200.8	331320
480-108183-108	KE-CFC-349-240	Total/NA	Water	200.8	331320
480-108183-109	KE-CFC-349-241	Total/NA	Water	200.8	331320
480-108183-110	KE-CFC-349-242	Total/NA	Water	200.8	331320
480-108183-111	KE-CFC-349-243	Total/NA	Water	200.8	331320
480-108183-112	KE-CFC-349-244	Total/NA	Water	200.8	331320
MB 480-331315/1-A	Method Blank	Total/NA	Water	200.8	331315
MB 480-331316/1-A	Method Blank	Total/NA	Water	200.8	331316
MB 480-331317/1-A	Method Blank	Total/NA	Water	200.8	331317
MB 480-331318/1-A	Method Blank	Total/NA	Water	200.8	331318
MB 480-331319/1-A	Method Blank	Total/NA	Water	200.8	331319
MB 480-331320/1-A	Method Blank	Total/NA	Water	200.8	331320
LCS 480-331315/2-A	Lab Control Sample	Total/NA	Water	200.8	331315
LCS 480-331316/2-A	Lab Control Sample	Total/NA	Water	200.8	331316
LCS 480-331317/2-A	Lab Control Sample	Total/NA	Water	200.8	331317
LCS 480-331318/2-A	Lab Control Sample	Total/NA	Water	200.8	331318
LCS 480-331319/2-A	Lab Control Sample	Total/NA	Water	200.8	331319
LCS 480-331320/2-A	Lab Control Sample	Total/NA	Water	200.8	331320
480-108183-17 MS	KE-BFC-MSB-147	Total/NA	Water	200.8	331315
480-108183-17 MSD	KE-BFC-MSB-147	Total/NA	Water	200.8	331315
480-108183-32 MS	KE-BFC-359-162	Total/NA	Water	200.8	331315
480-108183-32 MSD	KE-BFC-359-162	Total/NA	Water	200.8	331315
480-108183-33 MS	KE-CFC-323-163	Total/NA	Water	200.8	331316
480-108183-33 MSD	KE-CFC-323-163	Total/NA	Water	200.8	331316
480-108183-48 MS	KE-CFC-325-178	Total/NA	Water	200.8	331316

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Analysis Batch: 332647 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-48 MSD	KE-CFC-325-178	Total/NA	Water	200.8	331316
480-108183-49 MS	KE-CFC-327-179	Total/NA	Water	200.8	331317
480-108183-49 MSD	KE-CFC-327-179	Total/NA	Water	200.8	331317
480-108183-64 MS	KE-CFC-324-194	Total/NA	Water	200.8	331317
480-108183-64 MSD	KE-CFC-324-194	Total/NA	Water	200.8	331317
480-108183-65 MS	KE-CFC-333-195	Total/NA	Water	200.8	331318
480-108183-65 MSD	KE-CFC-333-195	Total/NA	Water	200.8	331318
480-108183-80 MS	KE-CFC-337-210	Total/NA	Water	200.8	331318
480-108183-80 MSD	KE-CFC-337-210	Total/NA	Water	200.8	331318
480-108183-81 MS	KE-CFC-337-211	Total/NA	Water	200.8	331319
480-108183-81 MSD	KE-CFC-337-211	Total/NA	Water	200.8	331319
480-108183-96 MS	KE-CFC-338-226	Total/NA	Water	200.8	331319
480-108183-96 MSD	KE-CFC-338-226	Total/NA	Water	200.8	331319
480-108183-97 MS	KE-CFC-341-227	Total/NA	Water	200.8	331320
480-108183-97 MSD	KE-CFC-341-227	Total/NA	Water	200.8	331320
480-108183-112 MS	KE-CFC-349-244	Total/NA	Water	200.8	331320
480-108183-112 MSD	KE-CFC-349-244	Total/NA	Water	200.8	331320

Prep Batch: 332852

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-14	KE-CSC-311-144	Total/NA	Water	200.8	
MB 480-332852/1-A	Method Blank	Total/NA	Water	200.8	
LCS 480-332852/2-A	Lab Control Sample	Total/NA	Water	200.8	

Analysis Batch: 333084

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-14	KE-CSC-311-144	Total/NA	Water	200.8	332852
MB 480-332852/1-A	Method Blank	Total/NA	Water	200.8	332852
LCS 480-332852/2-A	Lab Control Sample	Total/NA	Water	200.8	332852

Analysis Batch: 333089

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-114	KE-CFC-349-246	Total/NA	Water	200.8	331321
480-108183-115	KE-CFC-351-247	Total/NA	Water	200.8	331321
480-108183-116	KE-CFC-351-248	Total/NA	Water	200.8	331321
480-108183-117	KE-CFC-351-249	Total/NA	Water	200.8	331321
480-108183-118	KE-CFC-351-250	Total/NA	Water	200.8	331321
480-108183-119	KE-CFC-351-251	Total/NA	Water	200.8	331321
480-108183-120	KE-CFC-351-252	Total/NA	Water	200.8	331321
480-108183-121	KE-CFC-351-253	Total/NA	Water	200.8	331321
480-108183-122	KE-CFC-351-254	Total/NA	Water	200.8	331321
480-108183-123	KE-CFC-353-255	Total/NA	Water	200.8	331321
480-108183-124	KE-CFC-355-257	Total/NA	Water	200.8	331321
480-108183-125	KE-CFC-355-258	Total/NA	Water	200.8	331321
480-108183-126	KE-CFC-355-259	Total/NA	Water	200.8	331321
480-108183-127	KE-CFC-355-260	Total/NA	Water	200.8	331321
480-108183-128	KE-CFC-355-261	Total/NA	Water	200.8	331321
480-108183-129	KE-CFC-355-262	Total/NA	Water	200.8	331322
480-108183-130	KE-CFC-355-263	Total/NA	Water	200.8	331322
480-108183-131	KE-CFC-355-264	Total/NA	Water	200.8	331322
480-108183-132	KE-WC-NC-265	Total/NA	Water	200.8	331322

TestAmerica Buffalo

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Metals (Continued)

Analysis Batch: 333089 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-133	KE-CFC-359-266	Total/NA	Water	200.8	331322
480-108183-134	KE-CFC-357-267	Total/NA	Water	200.8	331322
480-108183-135	KE-CFC-357-268	Total/NA	Water	200.8	331322
480-108183-136	KE-CFC-357-269	Total/NA	Water	200.8	331322
480-108183-137	KE-CFC-357-270	Total/NA	Water	200.8	331322
480-108183-138	KE-CFC-357-271	Total/NA	Water	200.8	331322
480-108183-139	KE-CFC-357-272	Total/NA	Water	200.8	331322
480-108183-140	KE-CFC-357-273	Total/NA	Water	200.8	331322
MB 480-331321/1-A	Method Blank	Total/NA	Water	200.8	331321
MB 480-331322/1-A	Method Blank	Total/NA	Water	200.8	331322
LCS 480-331321/2-A	Lab Control Sample	Total/NA	Water	200.8	331321
LCS 480-331322/2-A	Lab Control Sample	Total/NA	Water	200.8	331322
480-108183-128 MS	KE-CFC-355-261	Total/NA	Water	200.8	331321
480-108183-128 MSD	KE-CFC-355-261	Total/NA	Water	200.8	331321
480-108183-129 MS	KE-CFC-355-262	Total/NA	Water	200.8	331322
480-108183-129 MSD	KE-CFC-355-262	Total/NA	Water	200.8	331322

Analysis Batch: 333306

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
480-108183-113	KE-CFC-349-245	Total/NA	Water	200.8	331321
480-108183-113 MS	KE-CFC-349-245	Total/NA	Water	200.8	331321
480-108183-113 MSD	KE-CFC-349-245	Total/NA	Water	200.8	331321

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-261B-131

Lab Sample ID: 480-108183-1

Date Collected: 10/21/16 04:04

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:18	MTM2	TAL BUF

Client Sample ID: KE-BFC-261B-132

Lab Sample ID: 480-108183-2

Date Collected: 10/21/16 04:06

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:36	MTM2	TAL BUF

Client Sample ID: KE-BFC-261B-133

Lab Sample ID: 480-108183-3

Date Collected: 10/21/16 04:07

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:38	MTM2	TAL BUF

Client Sample ID: KE-BFC-261B-134

Lab Sample ID: 480-108183-4

Date Collected: 10/21/16 04:08

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:41	MTM2	TAL BUF

Client Sample ID: KE-BFC-261B-135

Lab Sample ID: 480-108183-5

Date Collected: 10/21/16 04:09

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:44	MTM2	TAL BUF

Client Sample ID: KE-BFC-261B-136

Lab Sample ID: 480-108183-6

Date Collected: 10/21/16 04:09

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:47	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-261A-137

Lab Sample ID: 480-108183-7

Date Collected: 10/21/16 04:10

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:49	MTM2	TAL BUF

Client Sample ID: KE-BFC-261A-138

Lab Sample ID: 480-108183-8

Date Collected: 10/21/16 04:11

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:52	MTM2	TAL BUF

Client Sample ID: KE-BFC-261A-139

Lab Sample ID: 480-108183-9

Date Collected: 10/21/16 04:12

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 09:55	MTM2	TAL BUF

Client Sample ID: KE-BFC-261A-140

Lab Sample ID: 480-108183-10

Date Collected: 10/21/16 04:12

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 10:04	MTM2	TAL BUF

Client Sample ID: KE-BFC-261A-141

Lab Sample ID: 480-108183-11

Date Collected: 10/21/16 04:13

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 10:07	MTM2	TAL BUF

Client Sample ID: KE-BFC-261A-142

Lab Sample ID: 480-108183-12

Date Collected: 10/21/16 04:13

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 10:10	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-WC-SEC-143

Lab Sample ID: 480-108183-13

Date Collected: 10/21/16 04:20

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 10:12	MTM2	TAL BUF

Client Sample ID: KE-CSC-311-144

Lab Sample ID: 480-108183-14

Date Collected: 10/21/16 04:24

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200.8			332852	11/21/16 13:40	MVZ	TAL BUF
Total/NA	Analysis	200.8		1	333084	11/21/16 19:37	MTM2	TAL BUF

Client Sample ID: KE-WC-SEC-145

Lab Sample ID: 480-108183-15

Date Collected: 10/21/16 04:25

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 10:20	MTM2	TAL BUF

Client Sample ID: KE-BFC-MSB-146

Lab Sample ID: 480-108183-16

Date Collected: 10/21/16 04:29

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			329945	11/16/16 18:55	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332228	11/17/16 10:23	MTM2	TAL BUF

Client Sample ID: KE-BFC-MSB-147

Lab Sample ID: 480-108183-17

Date Collected: 10/21/16 04:30

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:20	MTM2	TAL BUF

Client Sample ID: KE-CFC-369-148

Lab Sample ID: 480-108183-18

Date Collected: 10/21/16 04:32

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:31	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CSC-JC-149

Lab Sample ID: 480-108183-19

Date Collected: 10/21/16 04:36

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:34	MTM2	TAL BUF

Client Sample ID: KE-WC-CCM-150

Lab Sample ID: 480-108183-20

Date Collected: 10/21/16 04:37

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:37	MTM2	TAL BUF

Client Sample ID: KE-BFC-361-151

Lab Sample ID: 480-108183-21

Date Collected: 10/21/16 04:38

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:39	MTM2	TAL BUF

Client Sample ID: KE-BFC-361-152

Lab Sample ID: 480-108183-22

Date Collected: 10/21/16 04:39

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:49	MTM2	TAL BUF

Client Sample ID: KE-BFC-361-153

Lab Sample ID: 480-108183-23

Date Collected: 10/21/16 04:39

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:51	MTM2	TAL BUF

Client Sample ID: KE-BFC-361-154

Lab Sample ID: 480-108183-24

Date Collected: 10/21/16 04:40

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:54	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-361-155

Lab Sample ID: 480-108183-25

Date Collected: 10/21/16 04:40

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 03:57	MTM2	TAL BUF

Client Sample ID: KE-BFC-361-156

Lab Sample ID: 480-108183-26

Date Collected: 10/21/16 04:41

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:00	MTM2	TAL BUF

Client Sample ID: KE-BFC-359-157

Lab Sample ID: 480-108183-27

Date Collected: 10/21/16 04:42

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:02	MTM2	TAL BUF

Client Sample ID: KE-BFC-359-158

Lab Sample ID: 480-108183-28

Date Collected: 10/21/16 04:42

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:05	MTM2	TAL BUF

Client Sample ID: KE-BFC-359-159

Lab Sample ID: 480-108183-29

Date Collected: 10/21/16 04:43

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:08	MTM2	TAL BUF

Client Sample ID: KE-BFC-359-160

Lab Sample ID: 480-108183-30

Date Collected: 10/21/16 04:43

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:11	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-359-161

Lab Sample ID: 480-108183-31

Date Collected: 10/21/16 04:44

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:14	MTM2	TAL BUF

Client Sample ID: KE-BFC-359-162

Lab Sample ID: 480-108183-32

Date Collected: 10/21/16 04:45

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331315	11/18/16 18:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:23	MTM2	TAL BUF

Client Sample ID: KE-CFC-323-163

Lab Sample ID: 480-108183-33

Date Collected: 10/21/16 04:53

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:39	MTM2	TAL BUF

Client Sample ID: KE-CFC-323-164

Lab Sample ID: 480-108183-34

Date Collected: 10/21/16 04:53

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:50	MTM2	TAL BUF

Client Sample ID: KE-CFC-323-165

Lab Sample ID: 480-108183-35

Date Collected: 10/21/16 04:54

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 04:59	MTM2	TAL BUF

Client Sample ID: KE-CFC-323-166

Lab Sample ID: 480-108183-36

Date Collected: 10/21/16 04:54

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:02	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-323-167

Lab Sample ID: 480-108183-37

Date Collected: 10/21/16 04:55

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:05	MTM2	TAL BUF

Client Sample ID: KE-CFC-323-168

Lab Sample ID: 480-108183-38

Date Collected: 10/21/16 04:55

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:07	MTM2	TAL BUF

Client Sample ID: KE-CFC-323-169

Lab Sample ID: 480-108183-39

Date Collected: 10/21/16 04:56

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:10	MTM2	TAL BUF

Client Sample ID: KE-CFC-323-170

Lab Sample ID: 480-108183-40

Date Collected: 10/21/16 04:56

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:13	MTM2	TAL BUF

Client Sample ID: KE-CFC-325-171

Lab Sample ID: 480-108183-41

Date Collected: 10/21/16 05:05

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:16	MTM2	TAL BUF

Client Sample ID: KE-CFC-325-172

Lab Sample ID: 480-108183-42

Date Collected: 10/21/16 05:05

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:18	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-325-173

Lab Sample ID: 480-108183-43

Date Collected: 10/21/16 05:06

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:21	MTM2	TAL BUF

Client Sample ID: KE-CFC-325-174

Lab Sample ID: 480-108183-44

Date Collected: 10/21/16 05:06

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:24	MTM2	TAL BUF

Client Sample ID: KE-CFC-325-175

Lab Sample ID: 480-108183-45

Date Collected: 10/21/16 05:07

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:33	MTM2	TAL BUF

Client Sample ID: KE-CFC-325-176

Lab Sample ID: 480-108183-46

Date Collected: 10/21/16 05:07

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:36	MTM2	TAL BUF

Client Sample ID: KE-CFC-325-177

Lab Sample ID: 480-108183-47

Date Collected: 10/21/16 05:09

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:39	MTM2	TAL BUF

Client Sample ID: KE-CFC-325-178

Lab Sample ID: 480-108183-48

Date Collected: 10/21/16 05:09

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331316	11/18/16 18:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:42	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-327-179

Lab Sample ID: 480-108183-49

Date Collected: 10/21/16 05:14

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 05:57	MTM2	TAL BUF

Client Sample ID: KE-CFC-327-180

Lab Sample ID: 480-108183-50

Date Collected: 10/21/16 05:14

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:15	MTM2	TAL BUF

Client Sample ID: KE-CFC-327-181

Lab Sample ID: 480-108183-51

Date Collected: 10/21/16 05:15

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:18	MTM2	TAL BUF

Client Sample ID: KE-CFC-327-182

Lab Sample ID: 480-108183-52

Date Collected: 10/21/16 05:15

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:21	MTM2	TAL BUF

Client Sample ID: KE-CFC-327-183

Lab Sample ID: 480-108183-53

Date Collected: 10/21/16 05:16

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:23	MTM2	TAL BUF

Client Sample ID: KE-CFC-327-184

Lab Sample ID: 480-108183-54

Date Collected: 10/21/16 05:16

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:26	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-327-185

Lab Sample ID: 480-108183-55

Date Collected: 10/21/16 05:17

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:29	MTM2	TAL BUF

Client Sample ID: KE-CFC-327-186

Lab Sample ID: 480-108183-56

Date Collected: 10/21/16 05:17

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:32	MTM2	TAL BUF

Client Sample ID: KE-BFC-WSB-187

Lab Sample ID: 480-108183-57

Date Collected: 10/21/16 05:21

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:34	MTM2	TAL BUF

Client Sample ID: KE-BFC-WSB-188

Lab Sample ID: 480-108183-58

Date Collected: 10/21/16 05:21

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:44	MTM2	TAL BUF

Client Sample ID: KE-BFC-WSB-189

Lab Sample ID: 480-108183-59

Date Collected: 10/21/16 05:21

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:47	MTM2	TAL BUF

Client Sample ID: KE-BFC-MSB-190

Lab Sample ID: 480-108183-60

Date Collected: 10/21/16 05:24

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:49	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-BFC-MSB-191

Lab Sample ID: 480-108183-61

Date Collected: 10/21/16 05:24

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:52	MTM2	TAL BUF

Client Sample ID: KE-WC-CCE-192

Lab Sample ID: 480-108183-62

Date Collected: 10/21/16 05:25

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:55	MTM2	TAL BUF

Client Sample ID: KE-CSH-JC-193

Lab Sample ID: 480-108183-63

Date Collected: 10/21/16 05:26

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 06:58	MTM2	TAL BUF

Client Sample ID: KE-CFC-324-194

Lab Sample ID: 480-108183-64

Date Collected: 10/21/16 05:32

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331317	11/18/16 18:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:00	MTM2	TAL BUF

Client Sample ID: KE-CFC-333-195

Lab Sample ID: 480-108183-65

Date Collected: 10/21/16 05:35

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:24	MTM2	TAL BUF

Client Sample ID: KE-CFC-333-196

Lab Sample ID: 480-108183-66

Date Collected: 10/21/16 05:35

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:35	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-333-197

Lab Sample ID: 480-108183-67

Date Collected: 10/21/16 05:36

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:37	MTM2	TAL BUF

Client Sample ID: KE-CFC-333-198

Lab Sample ID: 480-108183-68

Date Collected: 10/21/16 05:36

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:40	MTM2	TAL BUF

Client Sample ID: KE-CFC-333-199

Lab Sample ID: 480-108183-69

Date Collected: 10/21/16 05:37

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:43	MTM2	TAL BUF

Client Sample ID: KE-CFC-333-200

Lab Sample ID: 480-108183-70

Date Collected: 10/21/16 05:37

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:53	MTM2	TAL BUF

Client Sample ID: KE-CFC-333-201

Lab Sample ID: 480-108183-71

Date Collected: 10/21/16 05:38

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:55	MTM2	TAL BUF

Client Sample ID: KE-CFC-335-202

Lab Sample ID: 480-108183-72

Date Collected: 10/21/16 05:43

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 07:58	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-335-203

Lab Sample ID: 480-108183-73

Date Collected: 10/21/16 05:43

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:00	MTM2	TAL BUF

Client Sample ID: KE-CFC-335-204

Lab Sample ID: 480-108183-74

Date Collected: 10/21/16 05:44

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:03	MTM2	TAL BUF

Client Sample ID: KE-CFC-335-205

Lab Sample ID: 480-108183-75

Date Collected: 10/21/16 05:44

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:06	MTM2	TAL BUF

Client Sample ID: KE-CFC-335-206

Lab Sample ID: 480-108183-76

Date Collected: 10/21/16 05:45

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:08	MTM2	TAL BUF

Client Sample ID: KE-CFC-335-207

Lab Sample ID: 480-108183-77

Date Collected: 10/21/16 05:45

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:11	MTM2	TAL BUF

Client Sample ID: KE-CFC-335-208

Lab Sample ID: 480-108183-78

Date Collected: 10/21/16 05:46

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:14	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-335-209

Lab Sample ID: 480-108183-79

Date Collected: 10/21/16 05:46

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:16	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-210

Lab Sample ID: 480-108183-80

Date Collected: 10/21/16 05:55

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331318	11/18/16 19:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:25	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-211

Lab Sample ID: 480-108183-81

Date Collected: 10/21/16 05:55

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:41	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-212

Lab Sample ID: 480-108183-82

Date Collected: 10/21/16 05:56

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 08:51	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-213

Lab Sample ID: 480-108183-83

Date Collected: 10/21/16 05:56

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:00	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-214

Lab Sample ID: 480-108183-84

Date Collected: 10/21/16 05:57

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:03	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-337-215

Lab Sample ID: 480-108183-85

Date Collected: 10/21/16 05:57

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:06	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-216

Lab Sample ID: 480-108183-86

Date Collected: 10/21/16 05:58

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:08	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-217

Lab Sample ID: 480-108183-87

Date Collected: 10/21/16 05:58

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:11	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-218

Lab Sample ID: 480-108183-88

Date Collected: 10/21/16 05:59

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:14	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-219

Lab Sample ID: 480-108183-89

Date Collected: 10/21/16 05:59

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:16	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-220

Lab Sample ID: 480-108183-90

Date Collected: 10/21/16 06:00

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:19	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-337-221

Lab Sample ID: 480-108183-91

Date Collected: 10/21/16 06:00

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:22	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-222

Lab Sample ID: 480-108183-92

Date Collected: 10/21/16 06:01

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:24	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-223

Lab Sample ID: 480-108183-93

Date Collected: 10/21/16 06:01

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:33	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-224

Lab Sample ID: 480-108183-94

Date Collected: 10/21/16 06:02

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:36	MTM2	TAL BUF

Client Sample ID: KE-CFC-337-225

Lab Sample ID: 480-108183-95

Date Collected: 10/21/16 06:02

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:39	MTM2	TAL BUF

Client Sample ID: KE-CFC-338-226

Lab Sample ID: 480-108183-96

Date Collected: 10/21/16 06:04

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331319	11/18/16 19:20	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:41	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-341-227

Lab Sample ID: 480-108183-97

Date Collected: 10/21/16 06:06

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 09:57	MTM2	TAL BUF

Client Sample ID: KE-CFC-34-228

Lab Sample ID: 480-108183-98

Date Collected: 10/21/16 06:06

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:13	MTM2	TAL BUF

Client Sample ID: KE-CFC-343-229

Lab Sample ID: 480-108183-99

Date Collected: 10/21/16 06:09

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:16	MTM2	TAL BUF

Client Sample ID: KE-CFC-343-230

Lab Sample ID: 480-108183-100

Date Collected: 10/21/16 06:09

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:19	MTM2	TAL BUF

Client Sample ID: KE-CFC-343-231

Lab Sample ID: 480-108183-101

Date Collected: 10/21/16 06:10

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:21	MTM2	TAL BUF

Client Sample ID: KE-CFC-343-232

Lab Sample ID: 480-108183-102

Date Collected: 10/21/16 06:10

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:24	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-343-233

Lab Sample ID: 480-108183-103

Date Collected: 10/21/16 06:11

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:27	MTM2	TAL BUF

Client Sample ID: KE-CFC-343-234

Lab Sample ID: 480-108183-104

Date Collected: 10/21/16 06:11

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:29	MTM2	TAL BUF

Client Sample ID: KE-CFC-343-236

Lab Sample ID: 480-108183-105

Date Collected: 10/21/16 06:12

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:32	MTM2	TAL BUF

Client Sample ID: KE-WC-NC-237

Lab Sample ID: 480-108183-106

Date Collected: 10/21/16 06:14

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:41	MTM2	TAL BUF

Client Sample ID: KE-CFC-349-239

Lab Sample ID: 480-108183-107

Date Collected: 10/21/16 06:20

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:44	MTM2	TAL BUF

Client Sample ID: KE-CFC-349-240

Lab Sample ID: 480-108183-108

Date Collected: 10/21/16 06:20

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:46	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-349-241

Lab Sample ID: 480-108183-109

Date Collected: 10/21/16 06:21

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:49	MTM2	TAL BUF

Client Sample ID: KE-CFC-349-242

Lab Sample ID: 480-108183-110

Date Collected: 10/21/16 06:21

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:52	MTM2	TAL BUF

Client Sample ID: KE-CFC-349-243

Lab Sample ID: 480-108183-111

Date Collected: 10/21/16 06:22

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:54	MTM2	TAL BUF

Client Sample ID: KE-CFC-349-244

Lab Sample ID: 480-108183-112

Date Collected: 10/21/16 06:22

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331320	11/18/16 19:40	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	332647	11/19/16 10:57	MTM2	TAL BUF

Client Sample ID: KE-CFC-349-245

Lab Sample ID: 480-108183-113

Date Collected: 10/21/16 06:23

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 14:02	MTM2	TAL BUF

Client Sample ID: KE-CFC-349-246

Lab Sample ID: 480-108183-114

Date Collected: 10/21/16 06:23

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 02:59	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-351-247

Lab Sample ID: 480-108183-115

Date Collected: 10/21/16 06:29

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:01	MTM2	TAL BUF

Client Sample ID: KE-CFC-351-248

Lab Sample ID: 480-108183-116

Date Collected: 10/21/16 06:29

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:04	MTM2	TAL BUF

Client Sample ID: KE-CFC-351-249

Lab Sample ID: 480-108183-117

Date Collected: 10/21/16 06:30

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:07	MTM2	TAL BUF

Client Sample ID: KE-CFC-351-250

Lab Sample ID: 480-108183-118

Date Collected: 10/21/16 06:30

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:16	MTM2	TAL BUF

Client Sample ID: KE-CFC-351-251

Lab Sample ID: 480-108183-119

Date Collected: 10/21/16 06:31

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:19	MTM2	TAL BUF

Client Sample ID: KE-CFC-351-252

Lab Sample ID: 480-108183-120

Date Collected: 10/21/16 06:31

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:22	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-351-253

Lab Sample ID: 480-108183-121

Date Collected: 10/21/16 06:32

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:25	MTM2	TAL BUF

Client Sample ID: KE-CFC-351-254

Lab Sample ID: 480-108183-122

Date Collected: 10/21/16 06:32

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:27	MTM2	TAL BUF

Client Sample ID: KE-CFC-353-255

Lab Sample ID: 480-108183-123

Date Collected: 10/21/16 06:36

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:30	MTM2	TAL BUF

Client Sample ID: KE-CFC-355-257

Lab Sample ID: 480-108183-124

Date Collected: 10/21/16 06:40

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:33	MTM2	TAL BUF

Client Sample ID: KE-CFC-355-258

Lab Sample ID: 480-108183-125

Date Collected: 10/21/16 06:40

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:36	MTM2	TAL BUF

Client Sample ID: KE-CFC-355-259

Lab Sample ID: 480-108183-126

Date Collected: 10/21/16 06:41

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:38	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-355-260

Lab Sample ID: 480-108183-127

Date Collected: 10/21/16 06:41

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:41	MTM2	TAL BUF

Client Sample ID: KE-CFC-355-261

Lab Sample ID: 480-108183-128

Date Collected: 10/21/16 06:42

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331321	11/21/16 16:45	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 03:50	MTM2	TAL BUF

Client Sample ID: KE-CFC-355-262

Lab Sample ID: 480-108183-129

Date Collected: 10/21/16 06:42

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:06	MTM2	TAL BUF

Client Sample ID: KE-CFC-355-263

Lab Sample ID: 480-108183-130

Date Collected: 10/21/16 06:43

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:17	MTM2	TAL BUF

Client Sample ID: KE-CFC-355-264

Lab Sample ID: 480-108183-131

Date Collected: 10/21/16 06:43

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:27	MTM2	TAL BUF

Client Sample ID: KE-WC-NC-265

Lab Sample ID: 480-108183-132

Date Collected: 10/21/16 06:45

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:29	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-359-266

Lab Sample ID: 480-108183-133

Date Collected: 10/21/16 06:47

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:32	MTM2	TAL BUF

Client Sample ID: KE-CFC-357-267

Lab Sample ID: 480-108183-134

Date Collected: 10/21/16 06:48

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:35	MTM2	TAL BUF

Client Sample ID: KE-CFC-357-268

Lab Sample ID: 480-108183-135

Date Collected: 10/21/16 06:49

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:38	MTM2	TAL BUF

Client Sample ID: KE-CFC-357-269

Lab Sample ID: 480-108183-136

Date Collected: 10/21/16 06:49

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:40	MTM2	TAL BUF

Client Sample ID: KE-CFC-357-270

Lab Sample ID: 480-108183-137

Date Collected: 10/21/16 06:49

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:43	MTM2	TAL BUF

Client Sample ID: KE-CFC-357-271

Lab Sample ID: 480-108183-138

Date Collected: 10/21/16 06:50

Matrix: Water

Date Received: 10/21/16 10:30

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:46	MTM2	TAL BUF

TestAmerica Buffalo

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Client Sample ID: KE-CFC-357-272
Date Collected: 10/21/16 06:50
Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-139
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:49	MTM2	TAL BUF

Client Sample ID: KE-CFC-357-273
Date Collected: 10/21/16 06:51
Date Received: 10/21/16 10:30

Lab Sample ID: 480-108183-140
Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dilution Factor	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200 Series			331322	11/21/16 17:00	MTM2	TAL BUF
Total/NA	Analysis	200.8		1	333089	11/22/16 04:51	MTM2	TAL BUF

Laboratory References:

TAL BUF = TestAmerica Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Certification Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Laboratory: TestAmerica Buffalo

Unless otherwise noted, all analytes for this laboratory were covered under each certification below.

Authority	Program	EPA Region	Certification ID	Expiration Date
New York	NELAP	2	10026	03-31-17
Analysis Method	Prep Method	Matrix	Analyte	

Method Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Method	Method Description	Protocol	Laboratory
200.8	Metals (ICP/MS)	EPA	TAL BUF

Protocol References:

EPA = US Environmental Protection Agency

Laboratory References:

TAL BUF = TestAmerica Buffalo, 10 Hazelwood Drive, Amherst, NY 14228-2298, TEL (716)691-2600

Sample Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
480-108183-1	KE-BFC-261B-131	Water	10/21/16 04:04	10/21/16 10:30
480-108183-2	KE-BFC-261B-132	Water	10/21/16 04:06	10/21/16 10:30
480-108183-3	KE-BFC-261B-133	Water	10/21/16 04:07	10/21/16 10:30
480-108183-4	KE-BFC-261B-134	Water	10/21/16 04:08	10/21/16 10:30
480-108183-5	KE-BFC-261B-135	Water	10/21/16 04:09	10/21/16 10:30
480-108183-6	KE-BFC-261B-136	Water	10/21/16 04:09	10/21/16 10:30
480-108183-7	KE-BFC-261A-137	Water	10/21/16 04:10	10/21/16 10:30
480-108183-8	KE-BFC-261A-138	Water	10/21/16 04:11	10/21/16 10:30
480-108183-9	KE-BFC-261A-139	Water	10/21/16 04:12	10/21/16 10:30
480-108183-10	KE-BFC-261A-140	Water	10/21/16 04:12	10/21/16 10:30
480-108183-11	KE-BFC-261A-141	Water	10/21/16 04:13	10/21/16 10:30
480-108183-12	KE-BFC-261A-142	Water	10/21/16 04:13	10/21/16 10:30
480-108183-13	KE-WC-SEC-143	Water	10/21/16 04:20	10/21/16 10:30
480-108183-14	KE-CSC-311-144	Water	10/21/16 04:24	10/21/16 10:30
480-108183-15	KE-WC-SEC-145	Water	10/21/16 04:25	10/21/16 10:30
480-108183-16	KE-BFC-MSB-146	Water	10/21/16 04:29	10/21/16 10:30
480-108183-17	KE-BFC-MSB-147	Water	10/21/16 04:30	10/21/16 10:30
480-108183-18	KE-CFC-369-148	Water	10/21/16 04:32	10/21/16 10:30
480-108183-19	KE-CSC-JC-149	Water	10/21/16 04:36	10/21/16 10:30
480-108183-20	KE-WC-CCM-150	Water	10/21/16 04:37	10/21/16 10:30
480-108183-21	KE-BFC-361-151	Water	10/21/16 04:38	10/21/16 10:30
480-108183-22	KE-BFC-361-152	Water	10/21/16 04:39	10/21/16 10:30
480-108183-23	KE-BFC-361-153	Water	10/21/16 04:39	10/21/16 10:30
480-108183-24	KE-BFC-361-154	Water	10/21/16 04:40	10/21/16 10:30
480-108183-25	KE-BFC-361-155	Water	10/21/16 04:40	10/21/16 10:30
480-108183-26	KE-BFC-361-156	Water	10/21/16 04:41	10/21/16 10:30
480-108183-27	KE-BFC-359-157	Water	10/21/16 04:42	10/21/16 10:30
480-108183-28	KE-BFC-359-158	Water	10/21/16 04:42	10/21/16 10:30
480-108183-29	KE-BFC-359-159	Water	10/21/16 04:43	10/21/16 10:30
480-108183-30	KE-BFC-359-160	Water	10/21/16 04:43	10/21/16 10:30
480-108183-31	KE-BFC-359-161	Water	10/21/16 04:44	10/21/16 10:30
480-108183-32	KE-BFC-359-162	Water	10/21/16 04:45	10/21/16 10:30
480-108183-33	KE-CFC-323-163	Water	10/21/16 04:53	10/21/16 10:30
480-108183-34	KE-CFC-323-164	Water	10/21/16 04:53	10/21/16 10:30
480-108183-35	KE-CFC-323-165	Water	10/21/16 04:54	10/21/16 10:30
480-108183-36	KE-CFC-323-166	Water	10/21/16 04:54	10/21/16 10:30
480-108183-37	KE-CFC-323-167	Water	10/21/16 04:55	10/21/16 10:30
480-108183-38	KE-CFC-323-168	Water	10/21/16 04:55	10/21/16 10:30
480-108183-39	KE-CFC-323-169	Water	10/21/16 04:56	10/21/16 10:30
480-108183-40	KE-CFC-323-170	Water	10/21/16 04:56	10/21/16 10:30
480-108183-41	KE-CFC-325-171	Water	10/21/16 05:05	10/21/16 10:30
480-108183-42	KE-CFC-325-172	Water	10/21/16 05:05	10/21/16 10:30
480-108183-43	KE-CFC-325-173	Water	10/21/16 05:06	10/21/16 10:30
480-108183-44	KE-CFC-325-174	Water	10/21/16 05:06	10/21/16 10:30
480-108183-45	KE-CFC-325-175	Water	10/21/16 05:07	10/21/16 10:30
480-108183-46	KE-CFC-325-176	Water	10/21/16 05:07	10/21/16 10:30
480-108183-47	KE-CFC-325-177	Water	10/21/16 05:09	10/21/16 10:30
480-108183-48	KE-CFC-325-178	Water	10/21/16 05:09	10/21/16 10:30
480-108183-49	KE-CFC-327-179	Water	10/21/16 05:14	10/21/16 10:30
480-108183-50	KE-CFC-327-180	Water	10/21/16 05:14	10/21/16 10:30
480-108183-51	KE-CFC-327-181	Water	10/21/16 05:15	10/21/16 10:30
480-108183-52	KE-CFC-327-182	Water	10/21/16 05:15	10/21/16 10:30
480-108183-53	KE-CFC-327-183	Water	10/21/16 05:16	10/21/16 10:30

TestAmerica Buffalo

Sample Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
480-108183-54	KE-CFC-327-184	Water	10/21/16 05:16	10/21/16 10:30
480-108183-55	KE-CFC-327-185	Water	10/21/16 05:17	10/21/16 10:30
480-108183-56	KE-CFC-327-186	Water	10/21/16 05:17	10/21/16 10:30
480-108183-57	KE-BFC-WSB-187	Water	10/21/16 05:21	10/21/16 10:30
480-108183-58	KE-BFC-WSB-188	Water	10/21/16 05:21	10/21/16 10:30
480-108183-59	KE-BFC-WSB-189	Water	10/21/16 05:21	10/21/16 10:30
480-108183-60	KE-BFC-MSB-190	Water	10/21/16 05:24	10/21/16 10:30
480-108183-61	KE-BFC-MSB-191	Water	10/21/16 05:24	10/21/16 10:30
480-108183-62	KE-WC-CCE-192	Water	10/21/16 05:25	10/21/16 10:30
480-108183-63	KE-CSH-JC-193	Water	10/21/16 05:26	10/21/16 10:30
480-108183-64	KE-CFC-324-194	Water	10/21/16 05:32	10/21/16 10:30
480-108183-65	KE-CFC-333-195	Water	10/21/16 05:35	10/21/16 10:30
480-108183-66	KE-CFC-333-196	Water	10/21/16 05:35	10/21/16 10:30
480-108183-67	KE-CFC-333-197	Water	10/21/16 05:36	10/21/16 10:30
480-108183-68	KE-CFC-333-198	Water	10/21/16 05:36	10/21/16 10:30
480-108183-69	KE-CFC-333-199	Water	10/21/16 05:37	10/21/16 10:30
480-108183-70	KE-CFC-333-200	Water	10/21/16 05:37	10/21/16 10:30
480-108183-71	KE-CFC-333-201	Water	10/21/16 05:38	10/21/16 10:30
480-108183-72	KE-CFC-335-202	Water	10/21/16 05:43	10/21/16 10:30
480-108183-73	KE-CFC-335-203	Water	10/21/16 05:43	10/21/16 10:30
480-108183-74	KE-CFC-335-204	Water	10/21/16 05:44	10/21/16 10:30
480-108183-75	KE-CFC-335-205	Water	10/21/16 05:44	10/21/16 10:30
480-108183-76	KE-CFC-335-206	Water	10/21/16 05:45	10/21/16 10:30
480-108183-77	KE-CFC-335-207	Water	10/21/16 05:45	10/21/16 10:30
480-108183-78	KE-CFC-335-208	Water	10/21/16 05:46	10/21/16 10:30
480-108183-79	KE-CFC-335-209	Water	10/21/16 05:46	10/21/16 10:30
480-108183-80	KE-CFC-337-210	Water	10/21/16 05:55	10/21/16 10:30
480-108183-81	KE-CFC-337-211	Water	10/21/16 05:55	10/21/16 10:30
480-108183-82	KE-CFC-337-212	Water	10/21/16 05:56	10/21/16 10:30
480-108183-83	KE-CFC-337-213	Water	10/21/16 05:56	10/21/16 10:30
480-108183-84	KE-CFC-337-214	Water	10/21/16 05:57	10/21/16 10:30
480-108183-85	KE-CFC-337-215	Water	10/21/16 05:57	10/21/16 10:30
480-108183-86	KE-CFC-337-216	Water	10/21/16 05:58	10/21/16 10:30
480-108183-87	KE-CFC-337-217	Water	10/21/16 05:58	10/21/16 10:30
480-108183-88	KE-CFC-337-218	Water	10/21/16 05:59	10/21/16 10:30
480-108183-89	KE-CFC-337-219	Water	10/21/16 05:59	10/21/16 10:30
480-108183-90	KE-CFC-337-220	Water	10/21/16 06:00	10/21/16 10:30
480-108183-91	KE-CFC-337-221	Water	10/21/16 06:00	10/21/16 10:30
480-108183-92	KE-CFC-337-222	Water	10/21/16 06:01	10/21/16 10:30
480-108183-93	KE-CFC-337-223	Water	10/21/16 06:01	10/21/16 10:30
480-108183-94	KE-CFC-337-224	Water	10/21/16 06:02	10/21/16 10:30
480-108183-95	KE-CFC-337-225	Water	10/21/16 06:02	10/21/16 10:30
480-108183-96	KE-CFC-338-226	Water	10/21/16 06:04	10/21/16 10:30
480-108183-97	KE-CFC-341-227	Water	10/21/16 06:06	10/21/16 10:30
480-108183-98	KE-CFC-34-228	Water	10/21/16 06:06	10/21/16 10:30
480-108183-99	KE-CFC-343-229	Water	10/21/16 06:09	10/21/16 10:30
480-108183-100	KE-CFC-343-230	Water	10/21/16 06:09	10/21/16 10:30
480-108183-101	KE-CFC-343-231	Water	10/21/16 06:10	10/21/16 10:30
480-108183-102	KE-CFC-343-232	Water	10/21/16 06:10	10/21/16 10:30
480-108183-103	KE-CFC-343-233	Water	10/21/16 06:11	10/21/16 10:30
480-108183-104	KE-CFC-343-234	Water	10/21/16 06:11	10/21/16 10:30
480-108183-105	KE-CFC-343-236	Water	10/21/16 06:12	10/21/16 10:30
480-108183-106	KE-WC-NC-237	Water	10/21/16 06:14	10/21/16 10:30

TestAmerica Buffalo

Sample Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 480-108183-1
SDG: SET2845H

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
480-108183-107	KE-CFC-349-239	Water	10/21/16 06:20	10/21/16 10:30
480-108183-108	KE-CFC-349-240	Water	10/21/16 06:20	10/21/16 10:30
480-108183-109	KE-CFC-349-241	Water	10/21/16 06:21	10/21/16 10:30
480-108183-110	KE-CFC-349-242	Water	10/21/16 06:21	10/21/16 10:30
480-108183-111	KE-CFC-349-243	Water	10/21/16 06:22	10/21/16 10:30
480-108183-112	KE-CFC-349-244	Water	10/21/16 06:22	10/21/16 10:30
480-108183-113	KE-CFC-349-245	Water	10/21/16 06:23	10/21/16 10:30
480-108183-114	KE-CFC-349-246	Water	10/21/16 06:23	10/21/16 10:30
480-108183-115	KE-CFC-351-247	Water	10/21/16 06:29	10/21/16 10:30
480-108183-116	KE-CFC-351-248	Water	10/21/16 06:29	10/21/16 10:30
480-108183-117	KE-CFC-351-249	Water	10/21/16 06:30	10/21/16 10:30
480-108183-118	KE-CFC-351-250	Water	10/21/16 06:30	10/21/16 10:30
480-108183-119	KE-CFC-351-251	Water	10/21/16 06:31	10/21/16 10:30
480-108183-120	KE-CFC-351-252	Water	10/21/16 06:31	10/21/16 10:30
480-108183-121	KE-CFC-351-253	Water	10/21/16 06:32	10/21/16 10:30
480-108183-122	KE-CFC-351-254	Water	10/21/16 06:32	10/21/16 10:30
480-108183-123	KE-CFC-353-255	Water	10/21/16 06:36	10/21/16 10:30
480-108183-124	KE-CFC-355-257	Water	10/21/16 06:40	10/21/16 10:30
480-108183-125	KE-CFC-355-258	Water	10/21/16 06:40	10/21/16 10:30
480-108183-126	KE-CFC-355-259	Water	10/21/16 06:41	10/21/16 10:30
480-108183-127	KE-CFC-355-260	Water	10/21/16 06:41	10/21/16 10:30
480-108183-128	KE-CFC-355-261	Water	10/21/16 06:42	10/21/16 10:30
480-108183-129	KE-CFC-355-262	Water	10/21/16 06:42	10/21/16 10:30
480-108183-130	KE-CFC-355-263	Water	10/21/16 06:43	10/21/16 10:30
480-108183-131	KE-CFC-355-264	Water	10/21/16 06:43	10/21/16 10:30
480-108183-132	KE-WC-NC-265	Water	10/21/16 06:45	10/21/16 10:30
480-108183-133	KE-CFC-359-266	Water	10/21/16 06:47	10/21/16 10:30
480-108183-134	KE-CFC-357-267	Water	10/21/16 06:48	10/21/16 10:30
480-108183-135	KE-CFC-357-268	Water	10/21/16 06:49	10/21/16 10:30
480-108183-136	KE-CFC-357-269	Water	10/21/16 06:49	10/21/16 10:30
480-108183-137	KE-CFC-357-270	Water	10/21/16 06:49	10/21/16 10:30
480-108183-138	KE-CFC-357-271	Water	10/21/16 06:50	10/21/16 10:30
480-108183-139	KE-CFC-357-272	Water	10/21/16 06:50	10/21/16 10:30
480-108183-140	KE-CFC-357-273	Water	10/21/16 06:51	10/21/16 10:30

Chain of Custody Record

Client Information Client Contact: Joe Pastore Phone: 716-332-3134 x305 E-Mail: melissa.devo@testamericainc.com		Lab PM: Devo, Melissa L. E-Mail: melissa.devo@testamericainc.com		Carrier Tracking No(s):		COC No:													
Company: Sienna Environmental Technologies LLC Address: 350 Elmwood Avenue City: Buffalo State, Zip: NY, 14222 Phone: 716-332-3134(Tel) Email: Labresults@siennaet.com Project Name: Lead in Drinking Water Analysis Site: Kenmore Tonawanda CSD - East High School		Due Date Requested: TAT Requested (days): 10 PO #: Purchase Order not required WO #: SET2845H Project #: SET2845H SSOW#:		Analysis Requested		Job #: 2845H													
Sample: Eric Rayner Phone: 716-332-3134 x305 E-Mail: melissa.devo@testamericainc.com		Lab PM: Devo, Melissa L. E-Mail: melissa.devo@testamericainc.com		Carrier Tracking No(s):		COC No:													
Sample Identification KE - KFC - Room - 131 (ex) Start 131 KE - BFC - 261B - 131 KE - BFC - 261B - 132 KE - BFC - 261B - 133 KE - BFC - 261B - 134 KE - BFC - 261B - 135 KE - BFC - 261B - 136 KE - BFC - 261A - 137 KE - BFC - 261A - 138 KE - BFC - 261A - 139 KE - BFC - 261A - 140 KE - BFC - 261A - 141		Sample Date 10-21-16 0404 0406 0407 0408 0409 0409 0410 0411 0412 0413		Sample Time G G G G G G G G G G G		Matrix (W=Water, S=solid, O=oil, BT=Tissue, AA=Air) Water Water Water Water Water Water Water Water Water Water Water		Preservation Code G G G G G G G G G G G		Field Filled Sample (Yes or No) N N N N N N N N N N N		Performance/MSD (Yes or No) N N N N N N N N N N N		Total Number of Containers 1 1 1 1 1 1 1 1 1 1 1 1 1		Special Instructions/Note: 480-108183 COC 200.8 - Lead			
Possible Hazard Identification ☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological														Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) ☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months					
Empty Kit Relinquished by:														Method of Shipment:					
Relinquished by: Enpho				Date/Time: 10-21-16 0700				Received by: [Signature]				Date/Time: 10/21/16 1030				Company: Sienna			
Relinquished by:				Date/Time:				Received by:				Date/Time:				Company:			
Relinquished by:				Date/Time:				Received by:				Date/Time:				Company:			
Custody Seals Intact: Δ Yes Δ No				Custody Seal No.:				Cooler Temperature(s) °C and Other Remarks: 11610 RA				Date/Time: 11/25/2016							

Chain of Custody Record

Client Information		Sampler: <i>Eric Payne</i>		Lab PM: Deyo, Melissa L	Carrier Tracking No(s):		COC No:			
Client Contact: Joe Pastore		Phone: 716-332-3134 x305		E-Mail: melissa.deyo@testamericainc.com			Page: <i>5</i> Job #: <i>2845H</i>			
Company: Sienna Environmental Technologies LLC		Analysis Requested								
Address: 350 Elmwood Avenue		Due Date Requested:								
City: Buffalo		TAT Requested (days): 10								
State, Zip: NY, 14222		PO #: Purchase Order not required								
Phone: 716-332-3134(Tel)		WO #: SET2845H								
Email: Labresults@siennaet.com		Project #: SET2845H								
Project Name: Lead in Drinking Water Analysis		SSOW#:								
Site: Kenmore Tonawanda CSD - East High School										
Sample Identification		Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=wastewater, BT=Tissue, AA=Air)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	200.8 - Lead	Total Number of Containers	Special Instructions/Note:
KE-BFC-261A-142		10-21-16	0413	G	Water					
KE-WC-SEC-143			0420	G	Water					
KE-CSC-311-144			0424	G	Water					
KE-WC-SEC-145			0425	G	Water					
KE-BFC-MSB-146			0429	G	Water					
KE-BFC-WSB-147			0430	G	Water					
KE-CFC-369-148			0432	G	Water					
KE-CFC-365-149			0433	G	Water					
KE-CSC-JC-149			0436	G	Water					
KE-WC-CCM-150			0437	G	Water					
KE-BFC-361-151			0438	G	Water					
Possible Hazard Identification ☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological										
Deliverable Requested: I, II, III, IV, Other (specify)										
Empty Kit Relinquished by:		Date:		Time:		Method of Shipment:				
Relinquished by: <i>E-Pay</i>		Date/Time: 10-21-16 0700		Company		Received by: <i>WJF</i>				
Relinquished by:		Date/Time:		Company		Received by:				
Relinquished by:		Date/Time:		Company		Received by:				
Custody Seals Intact: Δ Yes Δ No		Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:						

Client Information		Company: Sienna Environmental Technologies LLC	
Client Contact: Joe Pastore		Address: 350 Elmwood Avenue	
Phone: 716-332-3134		City: Buffalo	
State: NY		Zip: 14222	
Email: Labresults@siennaet.com		Project Name: Lead in Drinking Water Analysis	
Site: Kenmore Tonawanda CSD - East High School		SSOW#: 	
Due Date Requested: 		TAT Requested (days): 10	
PO #: 		Purchase Order not required	
WO #: SET2845H		Project #: SET2845H	
Sample Identification		Sample Date	
KE-BFC-361-152		10-21-16	
KE-BFC-361-153		0439	
KE-BFC-361-154		0439	
KE-BFC-361-155		0440	
KE-BFC-361-156		0441	
KE-BFC-359-157		0442	
KE-BFC-359-158		0442	
KE-BFC-359-159		0443	
KE-BFC-359-160		0443	
KE-BFC-359-161		0444	
KE-BFC-359-162		0445	
Possible Hazard Identification		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)	
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological		☐ Return To Client ☐ Disposal By Lab ☐ Archive For _____ Months	
Deliverable Requested: I, II, III, IV, Other (specify)		Special Instructions/QC Requirements:	
Empty Kit Relinquished by: Joe Pastore		Date: 10-21-16	
Relinquished by: Joe Pastore		Date/Time: 10-21-16 0700	
Relinquished by:		Date/Time:	
Relinquished by:		Date/Time:	
Custody Seals Intact A Yes A No		Custody Seal No.:	

Chain of Custody Record

Client Information		Sampler: <i>Eric Payner</i>		Lab PM:	Carrier Tracking No(s):	
Client Contact:		Phone: 716-332-3134 x305		Devo, Melissa L		
Joe Pastore		E-Mail: melissa.devo@testamericainc.com				
Company: Sienna Environmental Technologies LLC						
Address:		Due Date Requested:		Analysis Requested		
350 Elmwood Avenue		TAT Requested (days): 10				
City: Buffalo		PO #:				
State, Zip: NY, 14222		Purchase Order not required				
Phone: 716-332-3134(Tel)		WO #:				
Email: Labresults@siennaet.com		Project #:				
Lead in Drinking Water Analysis		SET2845H				
Site: Kenmore Tonawanda CSD - East High School		SSOW#:				
Sample Identification		Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=soil, A=air)	Field Filtered Sample (Yes or No)
KE-CFC-323-163	10-21-16	0453	G	Water		
KE-CFC-323-164		0453	G	Water		
KE-CFC-323-165		0454	G	Water		
KE-CFC-323-166		0454	G	Water		
KE-CFC-323-167		0455	G	Water		
KE-CFC-323-168		0455	G	Water		
KE-CFC-323-169		0456	G	Water		
KE-CFC-323-170		0456	G	Water		
KE-CFC-325-171		0505	G	Water		
KE-CFC-325-172		0505	G	Water		
KE-CFC-325-173		0506	G	Water		
Possible Hazard Identification						
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological						
Deliverable Requested: I, II, III, IV, Other (specify)						
Empty Kit Relinquished by: _____ Date: _____						
Relinquished by: <i>E-19-</i> Date: 10-21-16 0700 Company: <i>Sienna</i>						
Relinquished by: _____ Date: _____ Company: _____						
Relinquished by: _____ Date: _____ Company: _____						
Custody Seals Intact: ☐ Yes ☐ No Custody Seal No.: _____						
Cooler Temperature(s) °C and Other Remarks: _____						

Chain of Custody Record

Client Information Client Contact: Joe Pastore Phone: 716-332-3134 x305		Lab PM: Deyo, Melissa L E-Mail: melissa.deyo@testamericainc.com		Carrier Tracking No(s):		COC No:			
Company: Sienna Environmental Technologies LLC Address: 350 Elmwood Avenue City: Buffalo State, Zip: NY, 14222 Phone: 716-332-3134(Tel) Email: Labresults@siennaet.com Project Name: Lead in Drinking Water Analysis Site: Kenmore Tonawanda CSD - East High School		Due Date Requested: TAT Requested (days): 10 PO #: Purchase Order not required WO #: SET2845H Project #: SET2845H SSOW#:		Analysis Requested		Job #: 2845H			
Sample Identification KE-CFC-325-174 KE-CFC-325-175 KE-CFC-325-176 KE-CFC-325-177 KE-CFC-325-178 KE-CFC-327-179 KE-CFC-327-180 KE-CFC-327-181 KE-CFC-327-182 KE-CFC-327-183 KE-CFC-327-184		Sample Date 10-21-16 0506 0507 0507 0509 0509 0514 0514 0515 0515 0516 0516		Sample Time G G G G G G G G G G G		Matrix (W=water, S=solid, O=waste/oil, BT=Tissue, AA=Air) Water Water Water Water Water Water Water Water Water Water Water		Field Filtered Sample (Yes or No) 200.8 - Lead N N N N N N N N N N N	
Preservation Codes: A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Amchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other:		Total Number of Containers 1		Special Instructions/Note:		Preservation Codes: M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2SO3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4-5 Z - other (specify)			
Possible Hazard Identification ☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological Deliverable Requested: I, II, III, IV, Other (specify)									
Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) ☐ Return To Client ☒ Disposal By Lab ☐ Archive For Months									
Special Instructions/QC Requirements:									
Empty Kit Relinquished by:		Date:		Method of Shipment:		Date/Time:			
Relinquished by: E-179-		Date/Time: 10-21-16 0700		Company: S.E.N.A.		Date/Time: 10/21/16 1030			
Relinquished by:		Date/Time:		Company:		Date/Time:			
Relinquished by:		Date/Time:		Company:		Date/Time:			
Custody Seals Intact: ☐ Yes ☐ No		Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:		Date/Time:			

Client Information			Lab PVI:			Carrier Tracking No(s):			COC No:		
Client Contact: Joe Pastore			Sampler: <i>Eric Payne</i>			Deyo, Melissa L			Page: Page 10 of 20		
Company: Sienna Environmental Technologies LLC			Phone: 716-332-3134 x305			E-Mail: melissa.deyo@testamericalinc.com			Job #: 28454		
Address: 350 Elmwood Avenue			Due Date Requested:			Analysis Requested			Preservation Codes:		
City: Buffalo			TAT Requested (days): 10						A - HCL M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2SO3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4-5 Z - other (specify)		
State, Zip: NY, 14222			PO #:						Other:		
Phone: 716-332-3134(Tel)			Purchase Order not required						Total Number of containers		
Email: Labresults@siennaet.com			WO #:								
Project Name: Lead in Drinking Water Analysis			Project #: SET2845H								
Site: Kenmore Tonawanda CSD - East High School			SSOW#:								
Sample Identification			Sample Date			Sample Time			Sample Type (C=Comp, G=grab)		
Sample ID			Sample Date			Sample Time			Sample Type (C=Comp, G=grab)		
KE-CFC-327-185			10-21-16			0517			G Water		
KE-CFC-327-186			10-21-16			0517			G Water		
KE-BFC-WSB-187			10-21-16			0521			G Water		
KE-BFC-WSB-188			10-21-16			0521			G Water		
KE-BFC-WSB-189			10-21-16			0521			G Water		
KE-BFC-WSB-190			10-21-16			0524			G Water		
KE-BFC-WSB-191			10-21-16			0524			G Water		
KE-WC-CCE-192			10-21-16			0525			G Water		
KE-CS-H-JC-193			10-21-16			0526			G Water		
KE-CFC-324-194			10-21-16			0532			G Water		
KE-CFC-333-195			10-21-16			0535			G Water		
Possible Hazard Identification			Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)			Special Instructions/QC Requirements:			Special Instructions/Note:		
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological			☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months								
Deliverable Requested: I, II, III, IV, Other (specify)			Special Instructions/QC Requirements:								
Empty Kit Relinquished by:			Date:			Method of Shipment:			Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)		
Relinquished by: <i>Ken Pastore</i>			Date/Time: 10-21-16 0700			Received by: <i>WLP</i>			Date/Time: 10/24/16 1030		
Relinquished by:			Date/Time:			Received by:			Date/Time:		
Relinquished by:			Date/Time:			Received by:			Date/Time:		
Custody Seals Intact A Yes A No			Custody Seal No.:			Cooler Temperature(s) °C and Other Remarks:					

Chain of Custody Record

Client Information Client Contact: Joe Pastore Phone: 716-332-3134 x305 E-Mail: melissa.deyo@testamericainc.com		Lab PM: Deyo, Melissa L E-Mail: melissa.deyo@testamericainc.com		Carrier Tracking No(s): Job #: 28454		COC No: Page: 21 of					
Company: Sienna Environmental Technologies LLC Address: 350 Elmwood Avenue City: Buffalo State, Zip: NY, 14222 Phone: 716-332-3134 (Tel) Email: Labresults@siennaet.com Project Name: Lead in Drinking Water Analysis Site: Kenmore Tonawanda CSD - East High School		Analysis Requested Due Date Requested: TAT Requested (days): 10 PO #: Purchase Order not required W/O #: SET2845H Project #: SET2845H SOW#:									
Sample Identification KE-CFC-333-196 KE-CFC-333-197 KE-CFC-333-198 KE-CFC-333-199 KE-CFC-333-200 KE-CFC-333-201 KE-CFC-333-202 KE-CFC-333-203 KE-CFC-333-204 KE-CFC-333-205 KE-CFC-333-206		Sample Date 10-21-16 0535 0536 0536 0537 0537 0538 0543 0543 0544 0544 0545		Sample Time G G G G G G G G G G G		Matrix (W=Water, S=Solid, O=Organic, A=Air) Water Water Water Water Water Water Water Water Water Water Water		Field Filtered Sample (Yes or No) Perform MS/MSD (Yes or No) 200.8 - Lead N N N N N N N N N N N		Total Number of Containers Special Instructions/Note: Preservation Codes: A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Amchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other: M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2SO3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4-5 Z - other (specify)	
Possible Hazard Identification ☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological								Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) ☐ Return To Client ☐ Disposal By Lab ☐ Archive For _____ Months			
Deliverable Requested: I, II, III, IV, Other (specify)								Special Instructions/QC Requirements:			
Empty Kit Relinquished by:		Date:		Time:		Method of Shipment:		Relinquished by:			
Relinquished by:		Date/Time: 10-21-16 0700		Company: Sienna		Received by:		Date/Time: 10/21/16 1030			
Relinquished by:		Date/Time:		Company:		Received by:		Date/Time:			
Relinquished by:		Date/Time:		Company:		Received by:		Date/Time:			
Custody Seals Intact:		Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:		Company:		Company:			
A Yes Δ No		Δ Yes Δ No		Δ Yes Δ No		Δ Yes Δ No		Δ Yes Δ No			

Chain of Custody Record

Client Information Client Contact: Joe Pastore Phone: 716-332-3134 x305		Sampler: <i>Eric Rayner</i> Lab PM: Deyo, Melissa L E-Mail: melissa.deyo@testamericainc.com	Carrier Tracking No(s): Lab No:
Company: Sierra Environmental Technologies LLC Address: 350 Elmwood Avenue City: Buffalo State: NY Zip: 14222 Phone: 716-332-3134 (Tel) Email: Labresults@sierraet.com		Due Date Requested: TAT Requested (days): 10 PO #: Purchase Order not required WO #: SET2845H Project #: SET2845H SSOW#:	Job #: 2845H Preservation Codes: A - HCl B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Anchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other:
Site: Kenmore Tonawanda CSD - East High School		Analysis Requested	
Sample Identification		Field Filled Sample (Yes or No)	Total Number of Containers
Sample Identification KE-CFC-335-207 KE-CFC-335-208 KE-CFC-335-209 KE-CFC-337-210 KE-CFC-337-211 KE-CFC-337-212 KE-CFC-337-213 KE-CFC-337-214 KE-CFC-337-215 KE-CFC-337-216 KE-CFC-337-217	Sample Date 10-21-16 0545 0546 0546 0555 0555 0556 0556 0557 0557 0558 0558	Sample Type (C=Comp, G=grab) G G G G G G G G G G G	Matrix (W=water, S=solid, O=waste/oh, BT=biological, A=air) Water Water Water Water Water Water Water Water Water Water Water
Possible Hazard Identification ☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological Deliverable Requested: I, II, III, IV, Other (specify)		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) ☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months	
Empty Kit Relinquished by: <i>E-J Rayner</i> Relinquished by: <i>E-J Rayner</i> Relinquished by: <i>E-J Rayner</i> Relinquished by: <i>E-J Rayner</i>		Date/Time: 10-21-16 0700 Date/Time: Date/Time: Date/Time:	Date/Time: 10/21/16 1030 Date/Time: Date/Time: Date/Time:
Custody Seals Intact: ☐ Yes ☐ No Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:	

Chain of Custody Record

Client Information			Sampler: <u>Eric Payne</u>		Lab PM: <u>Deyo, Melissa L</u>		Carrier Tracking No(s):		COC No:	
Client Contact: Joe Pastore			Phone: 716-332-3134 x305		E-Mail: melissa.deyo@testamericainc.com				Page: <u>23</u> of <u>30</u>	
Company: Sienna Environmental Technologies LLC							Analysis Requested		Job #: <u>2845 H</u>	
Address: 350 Elmwood Avenue			Due Date Requested:						Preservation Codes: A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Amchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other:	
City: Buffalo			TAT Requested (days): 10						Total Number of Containers	
State, Zip: NY, 14222			PO #:							
Phone: 716-332-3134(Tel)			Purchase Order not required							
Email: labresults@siennaet.com			WO #:							
Project Name: Lead in Drinking Water Analysis			Project #:							
Site: Kenmore Tonawanda CSD - East High School			SSOW#:							
Sample Identification			Sample Date		Sample Time		Sample Type (C=comp, G=grab)		Matrix (Water, Swarf, Oil, Grease, etc.)	
KE - CFC - 337 - 218			10-21-16		0559		G		Water	
KE - CFC - 337 - 219					0559		G		Water	
KE - CFC - 337 - 220					0600		G		Water	
KE - CFC - 337 - 221					0600		G		Water	
KE - CFC - 337 - 222					0601		G		Water	
KE - CFC - 337 - 223					0601		G		Water	
KE - CFC - 337 - 224					0602		G		Water	
KE - CFC - 337 - 225					0602		G		Water	
KE - CFC - 338 - 226					0604		G		Water	
KE - CFC - 341 - 227					0606		G		Water	
KE - CFC - 34 - 228					0606		G		Water	
Possible Hazard Identification										
☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Polson B ☒ Unknown ☐ Radiological										
Deliverable Requested: I, II, III, IV, Other (specify)										
Empty Kit Relinquished by:			Date:		Time:		Method of Shipment			
Relinquished by: <u>E-Pay</u>			Date/Time: 10-21-16 0700		Company: <u>Sienna</u>		Received by: <u>[Signature]</u>		Date/Time: 10/21/16 1030	
Relinquished by:			Date/Time:		Company:		Received by:		Date/Time:	
Relinquished by:			Date/Time:		Company:		Received by:		Date/Time:	
Custody Seals Intact: A Yes A No			Custody Seal No.:				Cooler Temperature(s) °C and Other Remarks:			

Chain of Custody Record

Client Information		Sampler: <u>Eric Rayo</u>		Lab PM: <u>Deyo, Melissa L</u>		Carrier Tracking No(s):		COC No:	
Client Contact: <u>Joe Pastore</u>		Phone: <u>716-332-3134 x305</u>		E-Mail: <u>melissa.deyo@testamericainc.com</u>				Page: <u>24</u> of <u>24</u>	
Company: <u>Sienna Environmental Technologies LLC</u>		Address: <u>350 Elmwood Avenue</u>		City: <u>Buffalo</u>		State, Zip: <u>NY, 14222</u>		Job #: <u>2845H</u>	
Due Date Requested:		TAT Requested (days): <u>10</u>		PO #: <u>Purchase Order not required</u>		WO #: <u>SET2845H</u>		Preservation Codes:	
Email: <u>Labresults@siennaet.com</u>		Project Name: <u>Lead in Drinking Water Analysis</u>		Project #: <u>SET2845H</u>		SSOW#: <u></u>		A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Amchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other:	
Site: <u>Kenmore Tonawanda CSD - East High School</u>		Sample Identification		Sample Date		Sample Time		Sample Type (C=Comp, G=grab)	
		Matrix (W=water, S=solid, O=wastewater, BT=Tissue, A=Air)		Preservation Code		Field Filtered Sample (Yes or No)		Perform MS/MSD (Yes or No)	
		200.8 - Lead		N		N		N	
		KE-CFC-343-229		10-21-16		0609		G	
		KE-CFC-343-230				0609		G	
		KE-CFC-343-231				0610		G	
		KE-CFC-343-232				0610		G	
		KE-CFC-343-233				0611		G	
		KE-CFC-343-234				0611		G	
		KE-CFC-343-235				0612		G	
		KE-CFC-343-236				0612		G	
		KE-CFC-343-237				0614		G	
		KE-CFC-343-238				0615		G	
		KE-CFC-343-239				0620		G	
		Possible Hazard Identification							
		☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological							
		Deliverable Requested: I, II, III, IV, Other (specify)							
		Empty Kit Relinquished by:		Date:		Time:		Method of Shipment:	
		Relinquished by: <u>E-Ray</u>		Date/Time: <u>10-21-16 0700</u>		Company: <u>Sienna</u>		Received by: <u>[Signature]</u>	
		Relinquished by:		Date/Time:		Company:		Received by:	
		Relinquished by:		Date/Time:		Company:		Received by:	
		Custody Seals Intact: <u>Δ Yes Δ No</u>		Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:			

Chain of Custody Record

Client Information		Sampler: <u>Eric Rayns</u>		Lab PM: <u>Deyo, Melissa L</u>		Carrier Tracking No(s):		COC No:	
Client Contact: <u>Joe Pastore</u>		Phone: <u>716-332-3134 x305</u>		E-Mail: <u>melissa.deyo@testamericainc.com</u>				Page: <u>25</u> of <u>28</u>	
Company: <u>Sienna Environmental Technologies LLC</u>		Address: <u>350 Elmwood Avenue</u>		City: <u>Buffalo</u>		State: <u>NY</u>		Zip: <u>14222</u>	
Phone: <u>716-332-3134 (Tel)</u>		PO #: <u>716-332-3134 (Tel)</u>		Purchase Order not required		TAT Requested (days): <u>10</u>		Due Date Requested:	
Email: <u>Labresults@siennaet.com</u>		WO #: <u>SET2845H</u>		Project #: <u>SET2845H</u>		SSOW#:		Site: <u>Kenmore Tonawanda CSD - East High School</u>	
Project Name: <u>Lead in Drinking Water Analysis</u>		Sample Date		Sample Time		Sample Type (C=Comp, G=grab)		Matrix (W=water, S=solid, O=wastefl)	
Field Filtered Sample (Yes or No)		Preservation Code		Field Filtered Sample (Yes or No)		Performance (MSD) (Yes or No)		200.8 - Lead	
Sample Identification		Sample Date		Sample Time		Sample Type (C=Comp, G=grab)		Matrix (W=water, S=solid, O=wastefl)	
KC-CFC-349-240		0-21-16		0020		G		Water	
KC-CFC-349-241				0621		G		Water	
KC-CFC-349-242				0621		G		Water	
KC-CFC-349-243				0622		G		Water	
KC-CFC-349-244				0622		G		Water	
KC-CFC-349-245				0623		G		Water	
KC-CFC-349-246				0623		G		Water	
KC-CFC-351-247				0629		G		Water	
KC-CFC-351-248				0629		G		Water	
KC-CFC-351-249				0630		G		Water	
KC-CFC-351-250				0630		G		Water	
Possible Hazard Identification ☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological									
Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) ☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months									
Special Instructions/QC Requirements:									
Empty Kit Relinquished by:									
Relinquished by: <u>E-249-</u>		Date/Time: <u>10-21-16 0700</u>		Company: <u>Sienna</u>		Date/Time: <u>10/21/16 1030</u>		Company: <u>Sienna</u>	
Relinquished by:		Date/Time:		Company:		Date/Time:		Company:	
Relinquished by:		Date/Time:		Company:		Date/Time:		Company:	
Custody Seals Intact: <u>Δ Yes Δ No</u>		Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:					

Chain of Custody Record

Client Information Client Contact: Joe Pastore Phone: 716-332-3134 x305		Lab PM: Deyo, Melissa L E-Mail: melissa.deyo@testamericainc.com		Carrier Tracking No(s):		COC No.	
Company: Sienna Environmental Technologies LLC Address: 350 Elmwood Avenue City: Buffalo State, Zip: NY, 14222 Phone: 716-332-3134(Tel) Email: Labresults@siennaet.com Project Name: Lead in Drinking Water Analysis Site: Kenmore Tonawanda CSD - East High School		Due Date Requested: TAT Requested (days): 10 PO #: Purchase Order not required WO #: SET2845H Project #: SET2845H SSOW#:		Analysis Requested		Job #: 2845H	
Sample: Eric Raym Phone: 716-332-3134 x305		Lab PM: Deyo, Melissa L E-Mail: melissa.deyo@testamericainc.com		Carrier Tracking No(s):		COC No.	
Sample Identification KC-CFC-351-251 KC-CFC-351-252 KC-CFC-351-253 KC-CFC-351-254 KC-CFC-353-255 KC-CFC-353-256 KC-CFC-355-257 KC-CFC-355-258 KC-CFC-355-259 KC-CFC-355-260 KC-CFC-355-261		Sample Type (C=Comp, G=grab) G G G G G G G G G G		Sample Time 0631 0631 0632 0632 0636 0636 0640 0640 0641 0641 0642		Matrix (W=water, S=solid, O=water, BT=tissue, A=air) Water Water Water Water Water Water Water Water Water Water	
Sample Date 10-21-16		Preservation Code G		Field Filled Sample (Yes or No) N		Total Number of Containers 1	
Special Instructions/Note: inoperable		Special Instructions/Note: inoperable		Special Instructions/Note: inoperable		Special Instructions/Note: inoperable	
Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) ☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months							
Special Instructions/QC Requirements:							
Empty Kit Relinquished by:		Date:		Method of Shipment:		Date/Time:	
Relinquished by:		Date/Time: 10-21-16 0700		Company: Sienna		Date/Time:	
Relinquished by:		Date/Time:		Company:		Date/Time:	
Relinquished by:		Date/Time:		Company:		Date/Time:	
Custody Seals Intact:		Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:		Date/Time:	

TestAmerica Buffalo

10 Hazelwood Drive

Amherst, NY 14228-2298

Phone (716) 691-2600 Fax (716) 691-7991

Chain of Custody Record

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

Client Information Client Contact: Joe Pastore Phone: 716-332-3134 x305 E-Mail: melissa.deyo@testamericainc.com		Lab PM: Deyo, Melissa L E-Mail: melissa.deyo@testamericainc.com		Carrier Tracking No(s): COC No:	
Company: Sienna Environmental Technologies LLC Address: 350 Elmwood Avenue City: Buffalo State, Zip: NY, 14222 Phone: 716-332-3134(Tel) Email: Labresults@siennaet.com Project Name: Lead in Drinking Water Analysis Site: Kenmore Tonawanda CSD - East High School		Analysis Requested Due Date Requested: TAT Requested (days): 10 PO #: Purchase Order not required WO #: SET2845H Project #: SET2845H SSOW#:		Page: 27 Page of Job #: 2845H	
Sample Identification		Field Filled Sample (Yes or No)		Preservation Codes: A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Arniclor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other:	
Sample Identification		Field Filled Sample (Yes or No)		Preservation Codes: M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2S2O3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4-5 Z - other (specify)	
Sample Identification		Field Filled Sample (Yes or No)		Special Instructions/Note:	
KC- CFC-355-262 KC- CFC-355-263 KC- CFC-355-264 KC- WC- NC-265 KC- CFC-359-266 KC- CFC-357-267 KC- CFC-357-268 KC- CFC-357-269 KC- CFC-357-270 KC- CFC-357-271 KC- CFC-357-272		10-21-16 0642 0643 0643 0645 0647 0648 0649 0649 0650 0650		N N N N N N N N N N N	
Possible Hazard Identification ☐ Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) ☐ Return To Client ☒ Disposal By Lab ☐ Archive For _____ Months		Special Instructions/QC Requirements:	
Empty Kit Relinquished by:		Date:		Method of Shipment:	
Relinquished by: E-149-		Date/Time: 10-21-16 0700		Date/Time: 10/21/16 1030	
Relinquished by:		Date/Time:		Date/Time:	
Relinquished by:		Date/Time:		Date/Time:	
Custody Seals Intact: ☐ Yes ☐ No		Custody Seal No.:		Cooler Temperature(s) °C and Other Remarks:	

11/25/2016

Login Sample Receipt Checklist

Client: Sienna Environmental Technologies LLC

Job Number: 480-108183-1

SDG Number: SET2845H

Login Number: 108183

List Number: 1

Creator: Janish, Carl M

List Source: TestAmerica Buffalo

Question	Answer	Comment
Radioactivity either was not measured or, if measured, is at or below background	True	
The cooler's custody seal, if present, is intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the sample IDs on the containers and the COC.	True	
Samples are received within Holding Time (Excluding tests with immediate HTs)..	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
VOA sample vials do not have headspace or bubble is <6mm (1/4") in diameter.	True	
If necessary, staff have been informed of any short hold time or quick TAT needs	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Sampling Company provided.	True	SIENNA
Samples received within 48 hours of sampling.	True	
Samples requiring field filtration have been filtered in the field.	N/A	
Chlorine Residual checked.	N/A	

TestAmerica

THE LEADER IN ENVIRONMENTAL TESTING

ANALYTICAL REPORT

TestAmerica Laboratories, Inc.

TestAmerica Savannah

5102 LaRoche Avenue

Savannah, GA 31404

Tel: (912)354-7858

TestAmerica Job ID: 680-131408-1

TestAmerica Sample Delivery Group: SET2845H

Client Project/Site: Kenmore Tonawanda CSD - East High
School

Revision: 1


For:

Sienna Environmental Technologies LLC

350 Elmwood Avenue

Buffalo, New York 14222

Attn: Suzanne Kelley



Authorized for release by:

11/9/2016 2:07:27 PM

Melissa Deyo, Project Manager I

(716)504-9874

melissa.deyo@testamericainc.com

LINKS

Review your project
results through

TotalAccess

Have a Question?



Visit us at:

www.testamericainc.com

The test results in this report meet all 2003 NELAC and 2009 TNI requirements for accredited parameters, exceptions are noted in this report. This report may not be reproduced except in full, and with written approval from the laboratory. For questions please contact the Project Manager at the e-mail address or telephone number listed on this page.

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

1

2

3

4

5

6

7

8

9

10

11

12

Definitions/Glossary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
α	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CNF	Contains no Free Liquid
DER	Duplicate error ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision level concentration
MDA	Minimum detectable activity
EDL	Estimated Detection Limit
MDC	Minimum detectable concentration
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
NC	Not Calculated
ND	Not detected at the reporting limit (or MDL or EDL if shown)
PQL	Practical Quantitation Limit
QC	Quality Control
RER	Relative error ratio
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)

Sample Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
680-131408-1	KE-EXW-DW-274	Water	10/25/16 05:16	10/27/16 09:09
680-131408-2	KE-EXN-HBC-275	Water	10/25/16 05:22	10/27/16 09:09
680-131408-3	KE-EXN-HBC-276	Water	10/25/16 05:25	10/27/16 09:09
680-131408-4	KE-EXN-HBC-277	Water	10/25/16 05:28	10/27/16 09:09
680-131408-5	KE-EXN-HBC-278	Water	10/25/16 05:31	10/27/16 09:09
680-131408-6	KE-EXE-HBC-279	Water	10/25/16 05:35	10/27/16 09:09
680-131408-7	KE-EXS-HBC-280	Water	10/25/16 05:41	10/27/16 09:09
680-131408-8	KE-EXS-HBC-281	Water	10/25/16 05:44	10/27/16 09:09
680-131408-9	KE-Garage-HBC-282	Water	10/25/16 05:50	10/27/16 09:09
680-131408-10	KE-Garage-HBC-283	Water	10/25/16 05:51	10/27/16 09:09

Case Narrative

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Job ID: 680-131408-1

Laboratory: TestAmerica Savannah

Narrative

Job Narrative 680-131408-1

Revision I

This report was revised in order to correct some sample IDs.

Receipt

The samples were received on 10/27/2016 9:09 AM; the samples arrived in good condition, properly preserved and, where required, on ice. The temperature of the cooler at receipt was 16.5° C.

Metals

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Client Sample ID: KE-EXW-DW-274

Date Collected: 10/25/16 05:16

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-1

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	15.5		0.30	0.060	ug/L		10/30/16 13:01	10/31/16 13:17	1

Client Sample ID: KE-EXN-HBC-275

Date Collected: 10/25/16 05:22

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-2

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	33.6		0.30	0.060	ug/L		10/30/16 13:01	10/31/16 13:25	1

Client Sample ID: KE-EXN-HBC-276

Date Collected: 10/25/16 05:25

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-3

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	21.2		0.30	0.060	ug/L		10/30/16 13:01	10/31/16 13:33	1

Client Sample ID: KE-EXN-HBC-277

Date Collected: 10/25/16 05:28

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-4

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	348		0.30	0.060	ug/L		10/30/16 13:01	10/31/16 13:20	1

Client Sample ID: KE-EXN-HBC-278

Date Collected: 10/25/16 05:31

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-5

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	8.1		0.30	0.060	ug/L		10/30/16 13:01	10/31/16 23:01	1

Client Sample ID: KE-EXE-HBC-279

Date Collected: 10/25/16 05:35

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-6

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	92.8		0.30	0.060	ug/L		11/01/16 10:51	11/02/16 02:57	1

Client Sample ID: KE-EXS-HBC-280

Date Collected: 10/25/16 05:41

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-7

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	369		0.30	0.060	ug/L		11/07/16 15:05	11/08/16 11:57	1

TestAmerica Savannah

Client Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Client Sample ID: KE-EXS-HBC-281

Date Collected: 10/25/16 05:44

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-8

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	152		0.30	0.060	ug/L	—	10/30/16 13:01	10/31/16 14:02	1

Client Sample ID: KE-Garage-HBC-282

Date Collected: 10/25/16 05:50

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-9

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	3.4		0.30	0.060	ug/L	—	10/30/16 13:01	10/31/16 13:36	1

Client Sample ID: KE-Garage-HBC-283

Date Collected: 10/25/16 05:51

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-10

Matrix: Water

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	84.5		0.30	0.060	ug/L	—	10/30/16 13:01	10/31/16 23:09	1

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Method: 200.8-1994 R5.4 - Metals (ICP/MS)

Lab Sample ID: MB 680-455471/1-A
Matrix: Water
Analysis Batch: 455679

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 455471

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		10/30/16 13:01	10/31/16 12:35	1

Lab Sample ID: LCS 680-455471/2-A
Matrix: Water
Analysis Batch: 455679

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 455471

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	50.0	49.19		ug/L		98	85 - 115

Lab Sample ID: MB 680-455479/1-A
Matrix: Water
Analysis Batch: 455679

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 455479

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		10/30/16 13:01	10/31/16 22:16	1

Lab Sample ID: LCS 680-455479/2-A
Matrix: Water
Analysis Batch: 455679

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 455479

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	50.0	47.61		ug/L		95	85 - 115

Lab Sample ID: MB 680-455722/1-A
Matrix: Water
Analysis Batch: 455913

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 455722

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		11/01/16 10:51	11/02/16 01:20	1

Lab Sample ID: LCS 680-455722/2-A
Matrix: Water
Analysis Batch: 455913

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 455722

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	200	198.4		ug/L		99	85 - 115

Lab Sample ID: MB 680-456675/1-A
Matrix: Water
Analysis Batch: 457038

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 456675

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Lead	ND		0.30	0.060	ug/L		11/07/16 15:05	11/08/16 11:19	1

Lab Sample ID: LCS 680-456675/2-A
Matrix: Water
Analysis Batch: 457038

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 456675

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec. Limits
Lead	200	196.9		ug/L		98	85 - 115

TestAmerica Savannah

QC Sample Results

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

1

2

3

4

5

6

7

8

9

10

11

12

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Metals

Prep Batch: 455471

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-131408-1	KE-EXW-DW-274	Total/NA	Water	200	
680-131408-2	KE-EXN-HBC-275	Total/NA	Water	200	
680-131408-3	KE-EXN-HBC-276	Total/NA	Water	200	
680-131408-4	KE-EXN-HBC-277	Total/NA	Water	200	
680-131408-8	KE-EXS-HBC-281	Total/NA	Water	200	
680-131408-9	KE-Garage-HBC-282	Total/NA	Water	200	
MB 680-455471/1-A	Method Blank	Total/NA	Water	200	
LCS 680-455471/2-A	Lab Control Sample	Total/NA	Water	200	

Prep Batch: 455479

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-131408-5	KE-EXN-HBC-278	Total/NA	Water	200	
680-131408-10	KE-Garage-HBC-283	Total/NA	Water	200	
MB 680-455479/1-A	Method Blank	Total/NA	Water	200	
LCS 680-455479/2-A	Lab Control Sample	Total/NA	Water	200	

Analysis Batch: 455679

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-131408-1	KE-EXW-DW-274	Total/NA	Water	200.8-1994 R5.4	455471
680-131408-2	KE-EXN-HBC-275	Total/NA	Water	200.8-1994 R5.4	455471
680-131408-3	KE-EXN-HBC-276	Total/NA	Water	200.8-1994 R5.4	455471
680-131408-4	KE-EXN-HBC-277	Total/NA	Water	200.8-1994 R5.4	455471
680-131408-5	KE-EXN-HBC-278	Total/NA	Water	200.8-1994 R5.4	455479
680-131408-8	KE-EXS-HBC-281	Total/NA	Water	200.8-1994 R5.4	455471
680-131408-9	KE-Garage-HBC-282	Total/NA	Water	200.8-1994 R5.4	455471
680-131408-10	KE-Garage-HBC-283	Total/NA	Water	200.8-1994 R5.4	455479
MB 680-455471/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	455471
MB 680-455479/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	455479
LCS 680-455471/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	455471
LCS 680-455479/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	455479

Prep Batch: 455722

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-131408-6	KE-EXE-HBC-279	Total/NA	Water	200	
MB 680-455722/1-A	Method Blank	Total/NA	Water	200	
LCS 680-455722/2-A	Lab Control Sample	Total/NA	Water	200	

Analysis Batch: 455913

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-131408-6	KE-EXE-HBC-279	Total/NA	Water	200.8-1994 R5.4	455722
MB 680-455722/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	455722
LCS 680-455722/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	455722

Prep Batch: 456675

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-131408-7	KE-EXS-HBC-280	Total/NA	Water	200	
MB 680-456675/1-A	Method Blank	Total/NA	Water	200	
LCS 680-456675/2-A	Lab Control Sample	Total/NA	Water	200	

TestAmerica Savannah

QC Association Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Metals (Continued)

Analysis Batch: 457038

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
680-131408-7	KE-EXS-HBC-280	Total/NA	Water	200.8-1994 R5.4	456675
MB 680-456675/1-A	Method Blank	Total/NA	Water	200.8-1994 R5.4	456675
LCS 680-456675/2-A	Lab Control Sample	Total/NA	Water	200.8-1994 R5.4	456675

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Client Sample ID: KE-EXW-DW-274

Date Collected: 10/25/16 05:16

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455471	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 13:17	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-EXN-HBC-275

Date Collected: 10/25/16 05:22

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455471	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 13:25	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-EXN-HBC-276

Date Collected: 10/25/16 05:25

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455471	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 13:33	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-EXN-HBC-277

Date Collected: 10/25/16 05:28

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455471	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 13:20	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-EXN-HBC-278

Date Collected: 10/25/16 05:31

Date Received: 10/27/16 09:09

Lab Sample ID: 680-131408-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455479	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 23:01	BJB	TAL SAV
Instrument ID: ICPMSD										

Lab Chronicle

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Client Sample ID: KE-EXE-HBC-279

Lab Sample ID: 680-131408-6

Date Collected: 10/25/16 05:35

Matrix: Water

Date Received: 10/27/16 09:09

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455722	11/01/16 10:51	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455913	11/02/16 02:57	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-EXS-HBC-280

Lab Sample ID: 680-131408-7

Date Collected: 10/25/16 05:41

Matrix: Water

Date Received: 10/27/16 09:09

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	456675	11/07/16 15:05	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			457038	11/08/16 11:57	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-EXS-HBC-281

Lab Sample ID: 680-131408-8

Date Collected: 10/25/16 05:44

Matrix: Water

Date Received: 10/27/16 09:09

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455471	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 14:02	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-Garage-HBC-282

Lab Sample ID: 680-131408-9

Date Collected: 10/25/16 05:50

Matrix: Water

Date Received: 10/27/16 09:09

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455471	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 13:36	BJB	TAL SAV
Instrument ID: ICPMSD										

Client Sample ID: KE-Garage-HBC-283

Lab Sample ID: 680-131408-10

Date Collected: 10/25/16 05:51

Matrix: Water

Date Received: 10/27/16 09:09

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	200			50 mL	50 mL	455479	10/30/16 13:01	AJR	TAL SAV
Total/NA	Analysis	200.8-1994 R5.4		1			455679	10/31/16 23:09	BJB	TAL SAV
Instrument ID: ICPMSD										

Laboratory References:

TAL SAV = TestAmerica Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

TestAmerica Savannah

Certification Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Laboratory: TestAmerica Savannah

The certifications listed below are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
New York	NELAP	2	10842	03-31-17

Laboratory: TestAmerica Buffalo

The certifications listed below are applicable to this report.

Authority	Program	EPA Region	Certification ID	Expiration Date
New York	NELAP	2	10026	03-31-17

Method Summary

Client: Sienna Environmental Technologies LLC
Project/Site: Kenmore Tonawanda CSD - East High School

TestAmerica Job ID: 680-131408-1
SDG: SET2845H

Method	Method Description	Protocol	Laboratory
200.8-1994 R5.4	Metals (ICP/MS)	EPA	TAL SAV

Protocol References:

EPA = US Environmental Protection Agency

Laboratory References:

TAL SAV = TestAmerica Savannah, 5102 LaRoche Avenue, Savannah, GA 31404, TEL (912)354-7858

Chain of Custody Record

Client Information		Lab PM: Dieyo, Melissa L		Carrier Tracking No(s):		COC No.			
Client Contact: Joe Pastore		E-Mail: melissa.deyo@testamericainc.com				Page of			
Company: Sienna Environmental Technologies LLC						Job #			
Address: 350 Elmwood Avenue Buffalo State, Zip NY, 14222		Due Date Requested: 10 TAT Requested (days): 10		Analysis Requested		Preservation Codes:			
Phone: 716-332-3134 x305		Purchase Order not required				M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2S2O3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4.5 Z - other (specify)			
Email: labresults@siennaet.com		Project #: SET2845H				Other:			
Site: Kenmore Tonawanda CSD - East High School		SSOW#							
Sample Identification		Sample Date	Sample Time	Sample Type (G=grab) (C=comp)	Matrix (W=water, S=solid, O=waste/oil)	Field Filtered Sample (Yes or No)	Perform MS/MSD (Yes or No)	Total Number of Containers	Special Instructions/Note:
KE-EXN-DW-274	10/25/16	0516	G	Water	N	X	1	Next to door #9	
KE-EXN-HBC-275	10/25/16	0522	G	Water	N			outside Rm 157	
KE-EXN-HBC-276	10/25/16	0525	G	Water	N			Outside Rm 151	
KE-EXN-HBC-277	10/25/16	0528	G	Water	N			Outside Rm 149	
KE-EXN-HBC-278	10/25/16	0531	G	Water	N			Outside Rm 141	
KE-EXN-HBC-279	10/25/16	0535	G	Water	N			outside Rm 121	
KE-EXS-HBC-280	10/25/16	0541	G	Water	N			outside Dec 1	
KE-EXS-HBC-281	10/25/16	0544	G	Water	N			Outside Rm 100	
KE-Gorge-HBC-282	10/25/16	0550	G	Water	N			Eastwall, left	
KE-Gorge-HBC-283	10/25/16	0551	G	Water	N			Eastwall, right	
			G	Water	N				
Possible Hazard Identification		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)							
Non-Hazard ☐ Flammable ☐ Skin Irritant ☐ Poison B ☐ Unknown ☐ Radiological ☐		Return To Client ☐ Archive For _____ Months							
Deliverable Requested: I, II, III, IV, Other (specify)		Special Instructions/QC Requirements:							
Empty Kit Relinquished by:		Date:		Time:		Method of Shipment:			
Relinquished by: <i>Randi P</i>		Date/Time: 10/25/16	Company: Sienna	Received by: <i>C. Webb</i>		Date/Time: 10/25/16	Company: TA		
Relinquished by: <i>Calvin Otha</i>		Date/Time: 10/26/16	Company: Deloitte	Received by: V. Sampson		Date/Time: 10/27/16	Company: TA		
Relinquished by:		Date/Time:	Company:	Received by:		Date/Time:	Company:		
Custody Seal No.: A Yes A No		Custody Seal Intact:		Cooler Temperature(s) °C and Other Remarks:		190 # 16-6/16.5			

Login Sample Receipt Checklist

Client: Sienna Environmental Technologies LLC

Job Number: 680-131408-1

SDG Number: SET2845H

Login Number: 131408

List Number: 1

Creator: Banda, Christy S


List Source: TestAmerica Savannah


Question	Answer	Comment
Radioactivity wasn't checked or is $\leq$ background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	N/A	Thermal preservation not required.
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	N/A	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is $<6\text{mm}$ (1/4").	N/A	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	



Appendix C Sample Location Maps

不



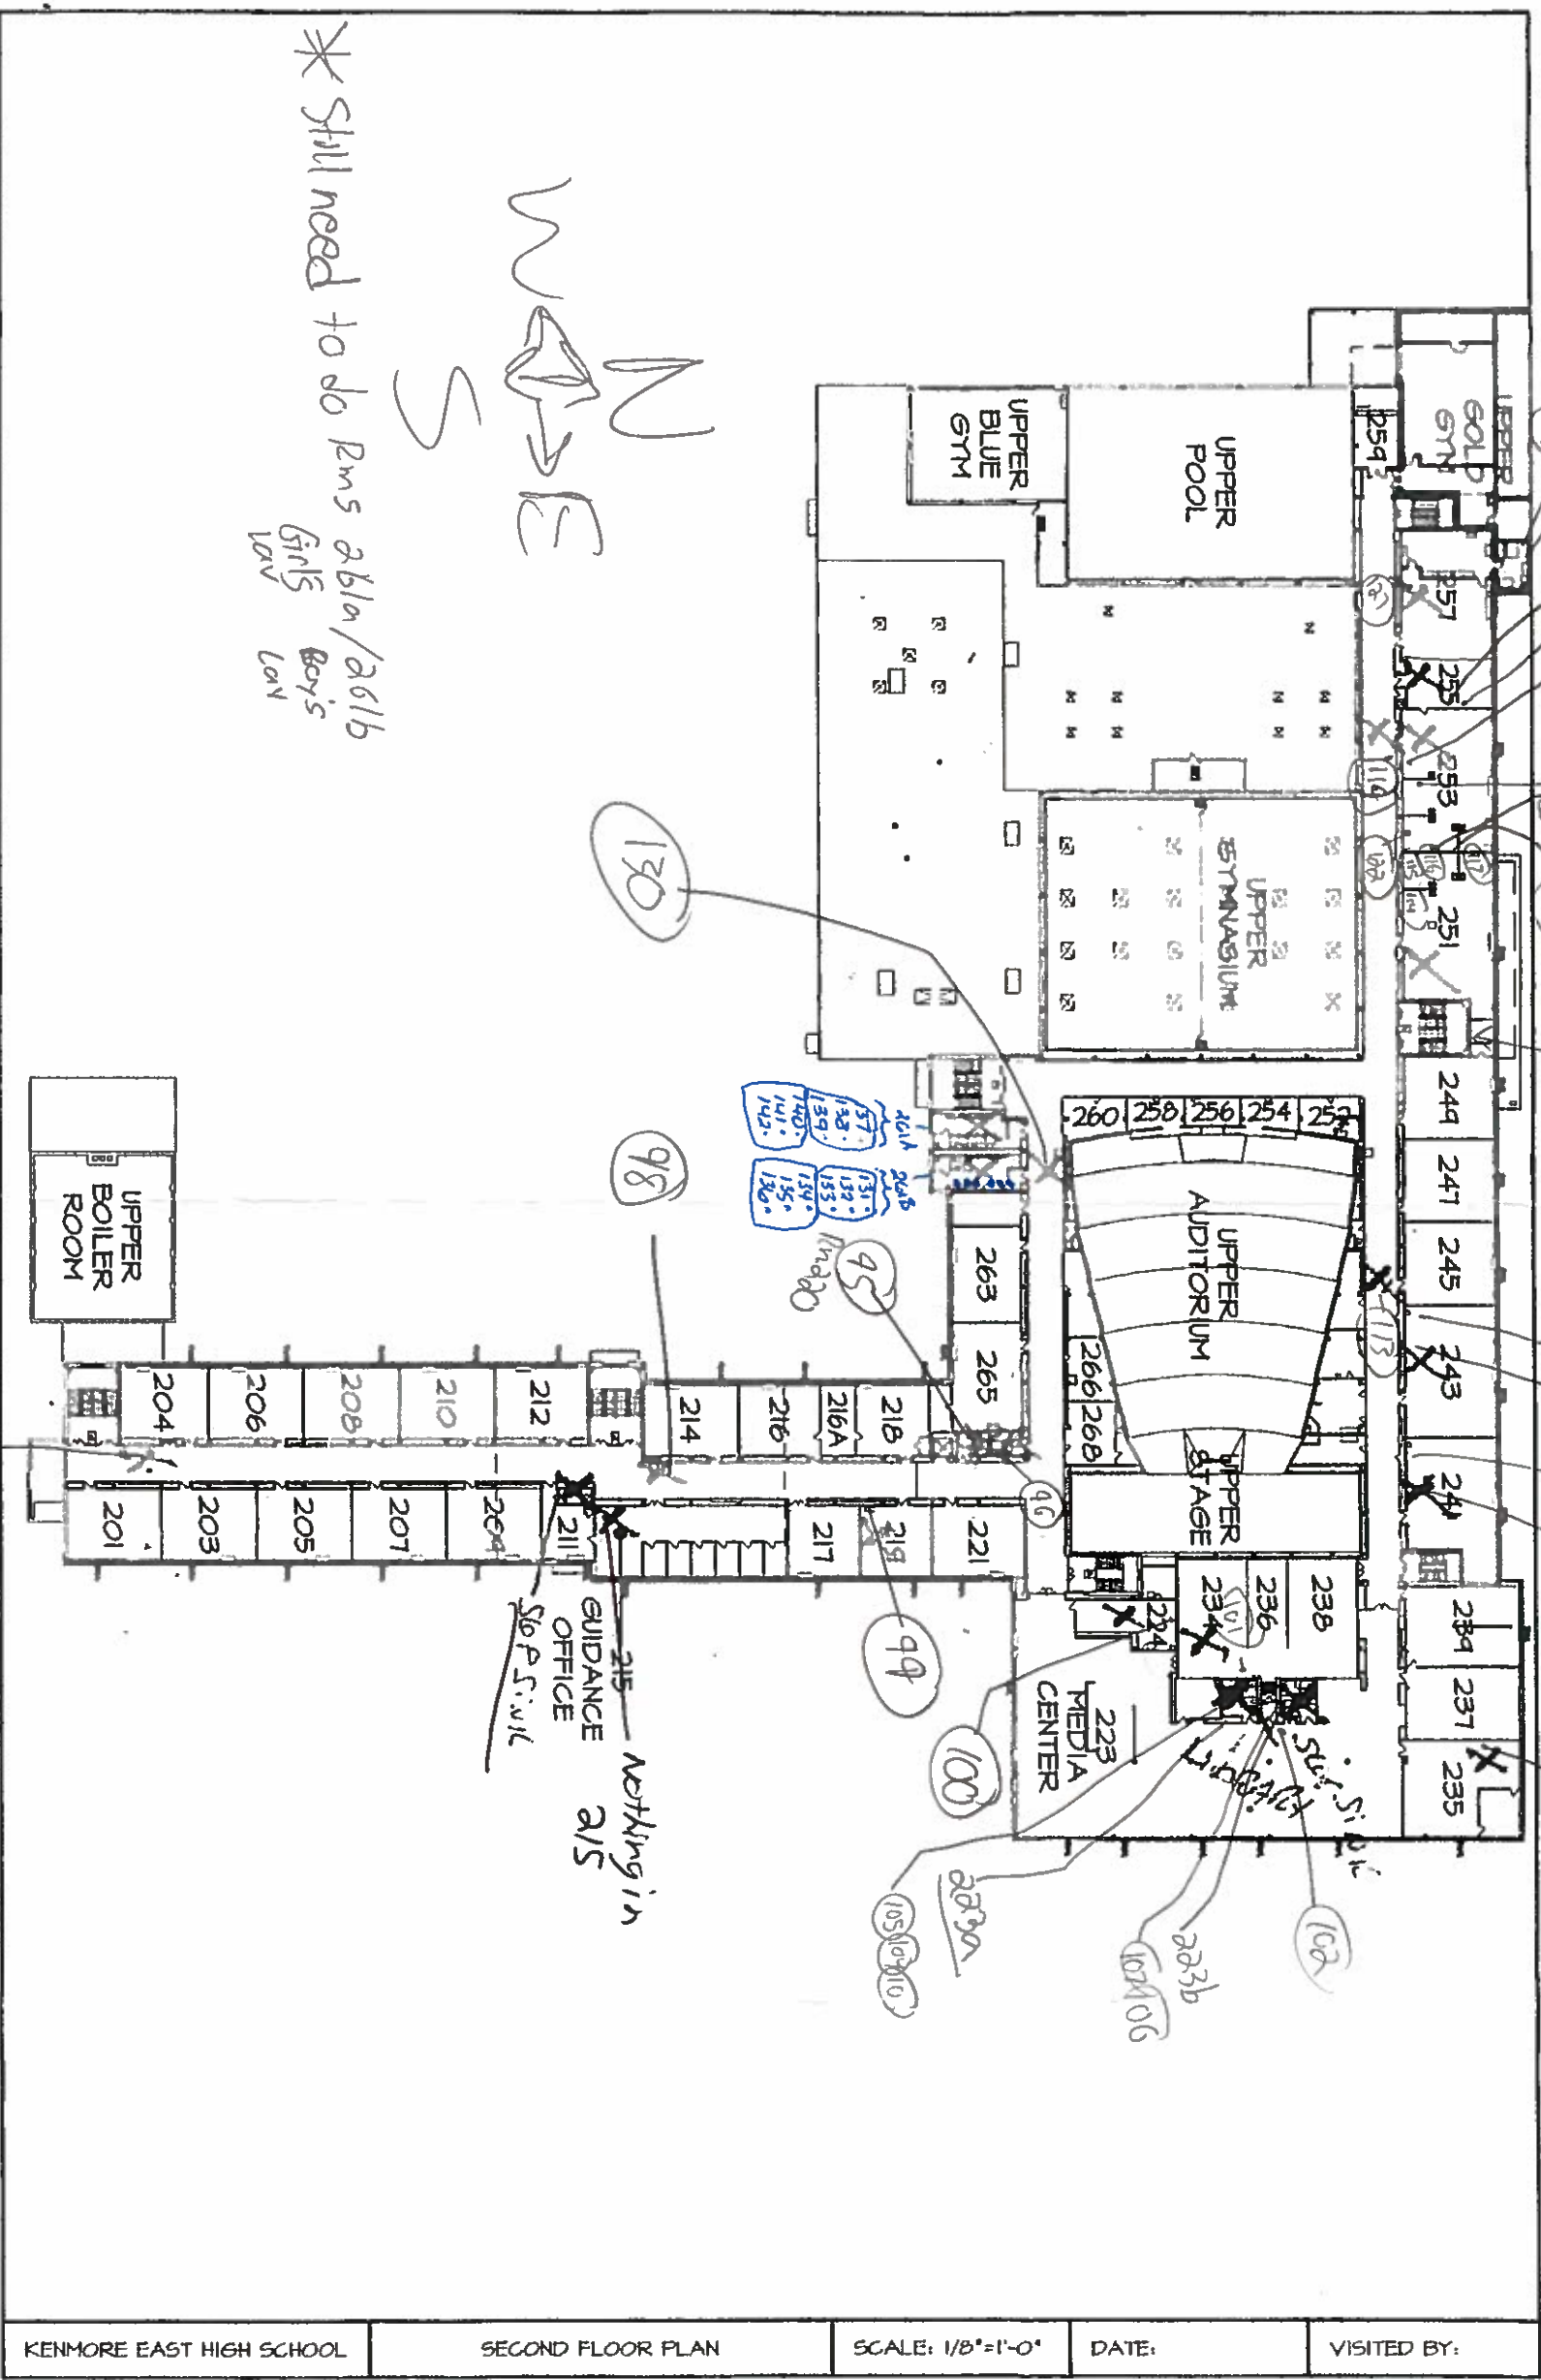



Appendix D NYCRR Title 10, Subpart 67-4

Pursuant to the authority vested in the Commissioner of Health by Public Health Law sections 1370-a and 1110, Subpart 67-4 of Title 10 (Health) of the Official Compilation of Codes, Rules and Regulations of the State of New York is added, to be effective upon filing with the Secretary of State, to read as follows:

SUBPART 67-4: Lead Testing in School Drinking Water

Section 67-4.1 Purpose.

This Subpart requires all school districts and boards of cooperative educational services, including those already classified as a public water system under 10 NYCRR Subpart 5-1, to test potable water for lead contamination and to develop and implement a lead remediation plan, where applicable.

Section 67-4.2 Definitions.

As used in this Subpart, the following terms shall have the stated meanings:

(a) *Action level* means 15 micrograms per liter ($\mu\text{g/L}$) or parts per billion (ppb). Exceedance of the action level requires a response, as set forth in this Subpart.

(b) *Building* means any structure, facility, addition, or wing of a school that may be occupied by children or students. The terms shall not include any structure, facility, addition, or wing of a school that is lead-free, as defined in section 1417 of the Federal Safe Drinking Water Act.

(c) *Commissioner* means the State Commissioner of Health.

(d) *Department* means the New York State Department of Health.

(e) *Outlet* means a potable water fixture currently or potentially used for drinking or cooking purposes, including but not limited to a bubbler, drinking fountain, or faucets.

(f) *Potable water* means water that meets the requirements of 10 NYCRR Subpart 5-1.

(g) *School* means any school district or board of cooperative educational services (BOCES).

Section 67-4.3 Monitoring.

(a) All schools shall test potable water for lead contamination as required in this Subpart.

(b) First-draw samples shall be collected from all outlets, as defined in this Subpart. A first-draw sample volume shall be 250 milliliters (mL), collected from a cold water outlet before any water is used. The water shall be motionless in the pipes for a minimum of 8 hours, but not more than

18 hours, before sample collection. First-draw samples shall be collected pursuant to such other specifications as the Department may determine appropriate.

(c) Initial first-draw samples.

(1) For existing buildings in service as of the effective date of this regulation, schools shall complete collection of initial first-draw samples according to the following schedule:

(i) for any school serving children in any of the levels prekindergarten through grade five, collection of samples is to be completed by September 30, 2016;

(ii) for any school serving children in any of the levels grades six through twelve that are not also serving students in any of the levels prekindergarten through grade five, and all other applicable buildings, collection of samples is to be completed by October 31, 2016.

(2) For buildings put into service after the effective date of this regulation, initial first-draw samples shall be performed prior to occupancy; provided that if the building is put into service between the effective date of this regulation but before October 31, 2016, the school shall have 30 days to perform first-draw sampling.

(3) Any first-draw sampling conducted consistent with this Subpart that occurred after January 1, 2015 shall satisfy the initial first-draw sampling requirement.

(d) Continued monitoring. Schools shall collect first-draw samples in accordance with subdivision (b) of this section again in 2020 or at an earlier time as determined by the commissioner. Schools shall continue to collect first-draw samples at least every 5 years thereafter or at an earlier time as determined by the commissioner.

(e) All first-draw samples shall be analyzed by a laboratory approved to perform such analyses by the Department's Environmental Laboratory Approval Program (ELAP).

Section 67-4.4 Response.

If the lead concentration of water at an outlet exceeds the action level, the school shall:

(a) prohibit use of the outlet until:

(1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and

(2) test results indicate that the lead levels are at or below the action level;

(b) provide building occupants with an adequate supply of potable water for drinking and cooking until remediation is performed;

(c) report the test results to the local health department as soon as practicable, but no more than 1 business day after the school received the laboratory report; and

(d) notify all staff and all persons in parental relation to students of the test results, in writing, as soon as practicable but no more than 10 business days after the school received the laboratory report; and, for results of tests performed prior to the effective date of this Subpart, within 10 business days of this regulation's effective date, unless such written notification has already occurred.

Section 67-4.5 Public Notification.

(a) List of lead-free buildings. By October 31, 2016, the school shall make available on its website a list of all buildings that are determined to be lead-free, as defined in section 1417 of the Federal Safe Drinking Water Act.

(b) Public notification of testing results and remediation plans.

(1) The school shall make available, on the school's website, the results of all lead testing performed and lead remediation plans implemented pursuant to this Subpart, as soon as practicable, but no more than 6 weeks after the school received the laboratory reports.

(2) For schools that received lead testing results and implemented lead remediation plans in a manner consistent with this Subpart, but prior to the effective date of this Subpart, the school shall make available such information, on the school's website, as soon as practicable, but no more than 6 weeks after the effective date of this Subpart.

Section 67-4.6 Reporting.

(a) As soon as practicable but no later than November 11, 2016, the school shall report to the Department, local health department, and State Education Department, through the Department's designated statewide electronic reporting system:

- (1) completion of all required first-draw sampling;
- (2) for any outlets that were tested prior to the effective date of this regulation, and for which the school wishes to assert that such testing was in substantial compliance with this Subpart, an attestation that:
 - (i) the school conducted testing that substantially complied with the testing requirements of this Subpart, consistent with guidance issued by the Department;
 - (2) any needed remediation, including re-testing, has been performed;
 - (3) the lead level in the potable water of the applicable building(s) is currently below the action level; and
 - (4) the school has submitted a waiver request to the local health department, in accordance with Section 67-4.8 of this Subpart; and

(3) a list of all buildings that are determined to be lead-free, as defined in section 1417 of the Federal Safe Drinking Water Act.

(b) As soon as practicable, but no more than 10 business days after the school received the laboratory reports, the school shall report data relating to test results to the Department, local health department, and State Education Department, through the Department's designated statewide electronic reporting system.

Section 67-4.7 Recordkeeping.

The school shall retain all records of test results, lead remediation plans, determinations that a building is lead-free, and waiver requests, for ten years following the creation of such documentation. Copies of such documentation shall be immediately provided to the Department, local health department, or State Education Department, upon request.

Section 67-4.8 Waivers.

(a) A school may apply to the local health department for a waiver from the testing requirements of this Subpart, for a specific school, building, or buildings, by demonstrating in a manner and pursuant to standards determined by the Department, that:

- (1) prior to the publication date of these regulations, the school conducted testing that substantially complied with the testing requirements of this Subpart;
- (2) any needed remediation, including re-testing, has been performed; and
- (3) the lead level in the potable water of the applicable building(s) is currently below the action level.

(b) Local health departments shall review applications for waivers for compliance with the standards determined by the Department. If the local health department recommends approval of the waiver, the local health department shall send its recommendation to the Department, and the Department shall determine whether the waiver shall be issued.

Section 67-4.9 Enforcement.

(a) Upon reasonable notice to the school, an officer or employee of the Department or local health department may enter any building for the purposes of determining compliance with this Subpart.

(b) Where a school does not comply with the requirements of this Subpart, the Department or local health department may take any action authorized by law, including but not limited to assessment of civil penalties as provided by law.

REGULATORY IMPACT STATEMENT

Statutory Authority:

The statutory authorities for the proposed regulation are set forth in Public Health Law §§ 1110 and 1370-a. Section 1110 of the PHL directs the Department of Health (Department) to promulgate regulations regarding the testing of potable water provided by school districts and boards of cooperative education services (BOCES) (collectively, “schools”) for lead contamination. Section 1370-a of the PHL authorizes the Department to establish programs and coordinate activities to prevent lead poisoning and to minimize the risk of exposure to lead.

Legislative Objective:

The legislative objective of PHL § 1110 is to protect children by requiring schools to test their potable water systems for lead contamination. Similarly, PHL § 1370-a authorizes the Department to establish programs and coordinate activities to prevent lead poisoning and to minimize the risk of exposure to lead. Consistent with these objectives, this regulation adds a new Subpart 67-4 to title 10 of the New York Codes, Rules, and Regulations, establishing requirements for schools to test their potable water outlets for lead contamination.

Needs and Benefits:

Lead is a toxic material that is harmful to human health if ingested or inhaled.

Children and pregnant women are at the greatest risk from lead exposure. Scientists have linked lead exposure with lowered IQ and behavior problems in children. It is also possible for lead to

be stored in bones and it can be released into the bloodstream later in life, including during pregnancy. Further, during pregnancy, lead in the mother's bloodstream can cross the placenta, which can result in premature birth and low birth weight, as well as problems with brain, kidney, or nervous system development, and learning and behavior problems. Studies have also shown that low levels of lead can negatively affect adults, leading to heart and kidney problems, as well as high blood pressure and nervous system disorders.

Lead is a common metal found in the environment. The primary source of lead exposure for most children is lead-based paint. However, drinking water is another source of lead exposure due to the lead content of certain plumbing materials and source water.

Laws now limit the amount of lead in new plumbing materials. However, plumbing materials installed prior to 1986 may contain significant amounts of lead. In 1986, the federal government required that only "lead-free" materials be used in new plumbing and plumbing fixtures.

Although this was a vast improvement, the law still allowed certain fixtures with up to 8 percent lead to be labeled as "lead free." In 2011, amendments to the Safe Drinking Water Act appropriately re-defined the definition of "lead-free." Although federal law now appropriately defines "lead-free," some older fixtures can still leach lead into drinking water.

Elevated lead levels are commonly found in the drinking water of school buildings, due to older plumbing and fixtures and intermittent water use patterns. Currently, only schools that have their own public water systems are required to test for lead contamination in drinking water.

In the absence of federal regulations governing all schools, the Department's regulations require all schools to monitor their potable drinking water for lead. The new regulations: establish an action level of 15 micrograms per liter (equivalent to parts per billion, or ppb) for lead in the drinking water of school buildings; establish initial and future monitoring requirements; require schools to develop remedial action plans if the action level is exceeded at any potable water outlet; conduct public notification of results to the school community; and report results to the Department. The Environmental Protection Agency's "3Ts for Reducing Lead in Drinking Water in Schools, Revised Technical Guidance" will be used as a technical reference for implementation of the regulation.

Compliance Costs:**Costs to Private Regulated Parties:**

These regulations only applies to public schools. No private schools are affected.

Costs to State Government and Local Government

These regulations applies to schools, which are a form of local government. There are approximately 733 school districts and 37 BOCES in New York State, which include over 5,000 school buildings that will be subject to this regulation.

The regulations require schools to test each potable water outlet for lead, in each school building occupied by children, unless the building is determined to be lead-free pursuant to federal standards. The cost for a single lead analysis ranges from \$20 - \$75 per sample. Initial monitoring requires one sample per outlet. The number of outlets will vary from building to building.

If lead is detected above 15 ppb at any potable water outlet, the outlet must be taken out of service and a remedial action plan must be developed to mitigate the lead contamination, at the school's initial expense. Remediation costs can vary significantly depending on the plumbing configuration and source of lead. The school will also incur minor costs for notification of the school community and local health department, posting the information on their website, and reporting electronically to the Department. Recently enacted legislation authorizes schools to receive State Aid through the State Education Department ("SED") to defray these costs.

Local health departments will also incur some administrative costs related to tracking local implementation, reviewing waiver applications, and compliance oversight. These activities will be eligible for State Aid through the Department's General Public Health Work program.

Local Government Mandates:

Schools, as a form of local government, are required to comply with the regulations, as detailed above.

Paperwork:

The regulation imposes recordkeeping requirements related to: monitoring of potable water outlets; notifications to the public and local health department; and electronic reporting to the Department.

Duplication:

There will be no duplication of existing State or Federal regulations.

Alternatives:

There are no significant alternatives to these regulations, which are being promulgated pursuant to recent legislation.

Federal Standards:

There are no federal statutes or regulations pertaining to this matter. However, the Department's regulations are consistent with the United States Environmental Protection Agency's guidance document titled *3Ts for Reducing Lead in Drinking Water in Schools, Revised Technical Guidance* (available at: https://www.epa.gov/sites/production/files/2015-09/documents/toolkit_leadschools_guide_3ts_leadschools.pdf). EPA's document will serve as guidance to schools for implementing the program.

Compliance Schedule:

For existing buildings put into service as of October 31, 2016, all sampling shall be performed by October 31, 2016. The Department will publish guidance for conducting a phased approach to testing across different grade levels. For buildings put into service after October 31, 2016, sampling shall be performed prior to occupancy.

Contact Person:

Katherine Ceroalo
New York State Department of Health
Bureau of House Counsel, Regulatory Affairs Unit
Corning Tower Building, Rm. 2438
Empire State Plaza
Albany, New York 12237
(518) 473-7488
(518) 473-2019 (FAX)
REGSQNA@health.ny.gov

REGULATORY FLEXIBILITY ANALYSIS FOR SMALL BUSINESS AND LOCAL GOVERNMENTS

Effect on Small Business and Local Governments:

This regulation applies to schools, which are a form of local government. As explained in the Regulatory Impact Statement, the new regulations: establish an action level of 15 micrograms per liter (equivalent to parts per billion, or ppb) for lead in the drinking water of school buildings; establish initial and future monitoring requirements; require schools to develop remedial action plans if the action level is exceeded at any potable water outlet; conduct public notification of results to the school community; and report results to the Department. The Environmental Protection Agency's *3Ts for Reducing Lead in Drinking Water in Schools, Revised Technical Guidance* will be used as a technical reference for implementation of the regulation. Local health departments will also incur some administrative costs related to tracking local implementation and oversight of the regulation.

Additionally, the regulations require the services of a laboratory certified by the Department under its Environmental Laboratory Approval Program (ELAP). Some schools may also wish to hire environmental consultants to assist with compliance. Some labs and environmental consultants qualify as small businesses and, at least initially, their services will be in greater demand due to the new regulation.

Compliance Requirements:

As noted above, the new regulations: establish an action level of 15 micrograms per liter (equivalent to parts per billion, or ppb) for lead in the drinking water in school buildings; establish initial and future monitoring requirements; require schools to develop remedial action plans if the action level is exceeded at any potable water outlet; conduct public notification of results to the school community; and requiring reporting of results to the Department.

Reporting and Recordkeeping:

The regulation will impose new monitoring, reporting, and public notification requirements for schools.

Professional Services:

As noted above, the regulations require the services of a laboratory certified by the Department under its Environmental Laboratory Approval Program (ELAP). Some schools may also wish to hire environmental consultants to assist with compliance.

Compliance Costs:

The regulation will require schools to test each potable water outlet for lead, in each school building occupied by children. The cost for a single lead analysis ranges from \$20 - \$75 per sample. Initial monitoring requires one sample per outlet. The number of outlets will vary from building to building.

If lead is detected above 15 ppb at any potable water outlet, the outlet must be taken out of service and a remedial action plan must be developed to mitigate the lead contamination, at the

school's expense. Remediation costs can vary significantly depending on the plumbing configuration and source of lead. The school will also incur minor costs for notification of the school community and local health department, posting the information on their website, and reporting electronically to the Department. Recently enacted legislation authorizes schools to receive State Aid through the State Education Department ("SED") to defray these costs.

Local health departments will also incur some administrative costs related to tracking local implementation, reviewing waiver applications, and compliance oversight. These activities will be eligible for State Aid through the Department's General Public Health Work program.

Cost to Private Parties:

There are no costs to private parties.

Economic and Technological Feasibility:

The technology for lead testing of drinking water is well-established. With respect to schools' costs of compliance, State Aid will be available through the State Education Department to ensure that compliance is feasible. Local health department activities will be eligible for State Aid through the Department's General Public Health Work program.

Minimizing Adverse Impact:

Any school that has already performed testing in compliance with these regulations, as far back as January 1, 2015, does not need to perform sampling again. Further, consistent with the requirements of PHL § 1110, if a school has performed testing that substantially complies with

the regulations, the school may apply to the Department for a waiver, so that additional testing is not required. In either case, the requirement to report sample results, and other requirements, remain in place.

School buildings that are determined to be “lead-free,” as defined in section 1417 of the Federal Safe Drinking Water Act, do not need to test their outlets. School will be required to make available on their website a list of all buildings that are determined to be lead-free.

Small Business and Local Government Participation:

Although small businesses were not consulted on these specific regulations, the dangers of lead in school drinking water has garnered significant local, state, and national attention. The New York State School Board Association (NYSSBA) requested a meeting with the Department to discuss the impacts of the enabling legislation. NYSSBA provided feedback on testing, prior monitoring, and other matters. The Department took this feedback into consideration when drafting the regulation. The Department will also conduct public outreach, and there will be an opportunity to comment on the proposed permanent regulations. The Department will review all public comments received.

RURAL AREA FLEXIBILITY ANALYSIS

Pursuant to Section 202-bb of the State Administrative Procedure Act (SAPA), a rural area flexibility analysis is not required. These provisions apply uniformly throughout New York State, including all rural areas. The proposed rule will not impose an adverse economic impact on rural areas, nor will it impose any disproportionate reporting, recordkeeping or other compliance requirements on the regulated entities in rural areas.

JOB IMPACT STATEMENT

The Department expects there to be a positive impact on jobs or employment opportunities. Some school districts will likely hire firms or individuals to assist with regulatory compliance. Schools impacted by this amendment will require the professional services of a certified laboratory to perform the analyses for lead, which will create a need for additional laboratory capacity.

Categories and Numbers Affected:

The Department anticipates no negative impact on jobs or employment opportunities as a result of the proposed regulations.

Regions of Adverse Impact:

The Department anticipates no negative impact on jobs or employment opportunities in any particular region of the state.

Minimizing Adverse Impact:

Not applicable.

EMERGENCY JUSTIFICATION

Lead exposure is associated with impaired cognitive development in children. The known adverse health effects for children from lead exposure include reduced IQ and attention span, learning disabilities, poor classroom performance, hyperactivity, behavioral problems, and impaired growth. Although measures can be taken to help children overcome any potential impairments on cognition, the effects are considered irreversible.

Lead can enter drinking water from the corrosion of plumbing materials. Facilities such as schools, which have intermittent water use patterns, may have elevated lead concentration due to prolonged water contact with plumbing material. This source is increasingly being recognized as an important relative contribution to a child's overall lead exposure. Recent voluntary testing by school districts in New York State and other jurisdictions demonstrate the need to provide clear direction to schools on the requirements and procedures to sample drinking water for lead.

Every school should supply drinking water to students that meets or exceeds federal and state standards and guidelines. Although the federal Environmental Protection Agency ("EPA") has established a voluntary testing program—known as the "3Ts for Reducing Lead in Drinking Water in Schools"—there is no federal law that requires schools to test their drinking water for lead or that requires an appropriate response, if lead is determined to be present in school drinking water.

To help ensure that children are protected from lead exposure while in school, the Commissioner of Health has determined it necessary to file these regulations on an emergency basis. State Administrative Procedure Act § 202(6) empowers the Commissioner to adopt emergency regulations when necessary for the preservation of the public health, safety or general welfare and that compliance with routine administrative procedures would be contrary to the public interest.